

PLOT TIME:

GENERAL NOTES:

- 1. CONTACT THE ENGINEERING INSPECTORS WITH THE CITY'S ENGINEERING DEPARTMENT AT (281) 275-2780 PRIOR TO STARTING WORK TO SCHEDULE A PRE-CONSTRUCTION MEETING.
2. CONTRACTOR IS RESPONSIBLE FOR HAVING ALL BURIED UTILITIES IDENTIFIED, PROTECTED, REPLACED AND/OR PROPERLY REPAIRED IF DAMAGED. REPAIRS/REPLACEMENT SHALL BE AT CONTRACTOR'S EXPENSE.
3. CONTRACTOR SHALL OBTAIN AND MAINTAIN ON SITE ALL APPLICABLE PERMITS AND AN APPROVED COPY OF THE PLANS AND SPECIFICATIONS. NOTIFY THE CITY'S ENGINEERING DEPARTMENT 48 HOURS PRIOR TO COMMENCEMENT OF WORK.
4. CONTRACTOR IS RESPONSIBLE FOR NOTIFYING THE CITY'S ENGINEERING DEPARTMENT 24 HOURS PRIOR TO WEEKDAY WORK REQUIRING INSPECTION INCLUDING, BUT NOT LIMITED TO, LIMING, PAVING OPERATIONS, CONCRETE PLACEMENT, FORMING AND SET-UP, DENSITIES, PIPE INSTALLATION, AND ANY TESTING BY LABORATORIES. THE ENGINEERING DEPARTMENT MAY BE REACHED AT 281-275-2780 OR BY CONTACTING THE ASSIGNED INSPECTOR.
5. ALL SATURDAY WORK SHALL BE REQUESTED, IN WRITING, WITH THE CITY'S ENGINEERING DEPARTMENT AT LEAST 48-HOURS IN ADVANCE. SUNDAY AND HOLIDAY WORK REQUIRES 72 HR. WRITTEN REQUESTS AND MUST BE APPROVED BY THE CITY ENGINEER. FAXES MAY BE SENT TO (281) 275-2771. REQUIRED INSPECTIONS MAY BE SUBJECT TO INSPECTION FEES. NON-NOTIFICATIONS MAY RESULT IN NON-COMPLIANCE, WORK ORDERED STOPPAGE AND DOUBLE INSPECTION FEES.
6. FULL-TIME RESIDENT INSPECTION BY THE PROJECT ENGINEER'S REPRESENTATIVE SHALL BE PROVIDED AT ALL CRITICAL POINTS OF CONSTRUCTION OR AS DEEMED NECESSARY BY THE CITY OF SUGAR LAND.
7. FOLLOW-UP INSPECTIONS OF ALL PUBLIC INFRASTRUCTURE SHALL BE SCHEDULED WITHIN 60 DAYS OF THE INITIAL INSPECTION. A COMPLETE RE-INSPECTION AND A NEW PUNCH LIST MAY BE REQUIRED AFTER THE 60 DAY PERIOD.
8. DESIGN AND CONSTRUCTION SHALL CONFORM TO THE TEXAS COMMISSION OF ENVIRONMENTAL QUALITY RULES AND REGULATIONS FOR PUBLIC WATER SYSTEMS, THE CITY OF SUGAR LAND DESIGN MANUAL (ISSUED 2007), AND THE CITY OF SUGAR LAND STANDARD DETAIL SHEETS. THE CITY OF SUGAR LAND DESIGN STANDARDS SHALL BE ACQUIRED (AND USED) FROM THE ENGINEERING DEPARTMENT. THE LATEST REVISIONS AND/OR AMENDMENTS SHALL BE OBSERVED. WHERE CONFLICT MAY ARISE BETWEEN INFORMATION ON APPROVED CONSTRUCTION DRAWINGS AND/OR PROJECT SPECIFICATIONS AND CITY OF SUGAR LAND STANDARDS, THEN THE CITY DESIGN STANDARDS SHALL GOVERN.
9. ALL STATIONS ARE CENTERLINE OF STREET RIGHT-OF-WAY UNLESS OTHERWISE NOTED ON THE PLANS EXCEPT IN SIDE OR BACK LOT EASEMENTS WHERE CENTERLINE IS CENTER OF PIPE. IN EASEMENTS WHERE SANITARY AND STORM SEWER ARE PRESENT PARALLEL, STATIONS SHALL BE BASED ON CENTERLINE OF STORM SEWER PIPING.
10. ADEQUATE DRAINAGE SHALL BE MAINTAINED AT ALL TIMES DURING CONSTRUCTION. ANY DRAINAGE AREA OR STRUCTURE DISTURBED, DURING CONSTRUCTION, SHALL BE RESTORED TO THE SATISFACTION OF THE CITY OF SUGAR LAND. ALL CONSTRUCTION STORM RUNOFF SHALL COMPLY WITH THE REQUIREMENTS OF THE CITY OF SUGAR LAND DESIGN STANDARDS. IF NON-COMPLIANCE OCCURS, CONTRACTOR SHALL REMEDY IMMEDIATELY AT HIS OWN EXPENSE.
11. ANY POLLUTION CONTROL DEVICE, SOD, OR SEEDED AREA DAMAGED, DISTURBED, OR REMOVED SHALL BE REPLACED OR REPAIRED AT THE CONTRACTOR'S EXPENSE. THE CONTRACTOR IS RESPONSIBLE FOR WATERING ANY SEED OR SOD WHICH HE HAS INSTALLED UNTIL ADEQUATE GROWTH IS ACHIEVED TO PREVENT EROSION.
12. STORM WATER POLLUTION PROTECTION SHALL BE DESIGNED, CONSTRUCTED, MAINTAINED AND SHALL BE IN TOTAL COMPLIANCE WITH THE STORM WATER QUALITY MANUAL OF THE CITY OF SUGAR LAND.
13. ANY MATERIALS OR WORKMANSHIP NOT MEETING OR EXCEEDING CITY OF SUGAR LAND STANDARDS IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND WILL BE REPAIRED OR REPLACED AT THE CONTRACTOR'S EXPENSE.
14. THE CONTRACTOR SHALL KEEP THE STREETS, RIGHT-OF-WAY, AND WORK AREA CLEAN OF DIRT, MUD, AND DEBRIS AS NEEDED OR AS REQUIRED BY CITY STAFF.
15. THE CONTRACTOR SHALL PROVIDE AND MAINTAIN ALL REQUIRED TRAFFIC SAFETY CONTROL DEVICES UP TO AND INCLUDING FLAGMEN OR POLICE OFFICERS, IF DEEMED NECESSARY BY THE CITY OF SUGAR LAND.
16. THE CONTRACTOR SHALL CONTACT THE CITY OR LOCAL MUD AS APPROPRIATE TO OPERATE EXISTING UTILITIES AND PRIOR TO MAKING TIE-INS.
17. ALL BACKFILL WITHIN PUBLIC RIGHTS-OF-WAY OR EASEMENTS SHALL BE COMPACTED TO 95% STANDARD PROCTOR DENSITY (IN 8 INCH LIFTS) AND TESTED FOR ±2% OPTIMUM MOISTURE BY AN APPROVED LAB.
18. IT IS PERMISSIBLE TO USE A BACKHOE FOR TRENCH EXCAVATION IN LIEU OF A TRENCHING MACHINE.
19. THE CONTRACTOR SHALL NEVER UNLOAD ANY TRACK-TYPE VEHICLE OR EQUIPMENT ON ANY EXISTING PAVEMENT OR CROSS OVER ANY EXISTING PAVEMENT OR CURB.
20. ALL FINISH GRADES ARE TO CONFORM TO A MINIMUM SLOPE OF 6" PER 100 FT. POSITIVE DRAINAGE IS DEPICTED BY ARROWS.
21. CONTRACTOR SHALL UNCOVER EXISTING UTILITIES AT ALL "POINTS OF CROSSING" TO DETERMINE IF CONFLICTS EXIST BEFORE COMMENCING ANY CONSTRUCTION. NOTIFY THE ENGINEER AT ONCE OF ANY CONFLICT.
22. ALL FINISHED GRADES SHALL VARY UNIFORMLY BETWEEN FINISHED ELEVATIONS.
23. ALL TESTING PROCEDURES SHALL CONFORM TO THE CITY OF SUGAR LAND STANDARDS. THE INITIAL TESTING EXPENSE SHALL BE BORNE BY THE OWNER. IF ANY OF THE TESTS DO NOT MEET THE TESTING STANDARDS, IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REMOVE OR REPLACE SUCH MATERIAL SO THE TESTING STANDARDS CAN BE MET. ADDITIONAL TESTING TO MEET COMPLIANCE SHALL BE AT THE CONTRACTOR'S EXPENSE.
24. CONTRACTOR SHALL PROVIDE SHEETING, SHORING, AND BRACING AS NECESSARY TO PROTECT WORKMEN AND EXISTING UTILITIES DURING ALL PHASES OF CONSTRUCTION AS PER O.S.H.A. REQUIREMENTS.
25. ALL MATERIALS AND WORKMANSHIP NOT GOVERNED BY CITY STANDARDS SHALL CONFORM TO THE LATEST VERSION OF THE TXDOT STANDARD SPECIFICATIONS AND THE TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES, AND ANY REVISIONS THERETO.
26. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SAFEGUARDING AND PROTECTING ALL MATERIALS AND EQUIPMENT STORED ON THE JOBSITE IN A SAFE AND WORKMAN-LIKE MANNER (DURING AND AFTER WORKING HOURS), UNTIL JOB COMPLETION.
27. THE LOADING AND UNLOADING OF ALL PIPE, VALVES, HYDRANTS, MANHOLES, AND OTHER ACCESSORIES SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDED PRACTICES AND SHALL BE PERFORMED WITH CARE TO AVOID ANY DAMAGE TO THE MATERIAL. THE CONTRACTOR SHALL LOCATE AND PROVIDE THE NECESSARY STORAGE AREAS FOR MATERIAL AND EQUIPMENT.
28. THE CONTRACTOR SHALL FURNISH ALL MATERIALS, EQUIPMENT, AND LABOR FOR EXCAVATION, INSTALLATION, AND COMPLETION OF THE PROJECT AS SHOWN ON THE PLANS AND SPECIAL PROVISIONS TO COMPLY WITH CITY OF SUGAR LAND STANDARDS.
29. NO PRIVATE UTILITIES (I.E., PHONE, CABLE T.V., ELECTRICITY, ETC.) SHALL BE INSTALLED WITHIN 4 FEET BACK OF CURB.
30. PLANS DO NOT EXTEND TO OR INCLUDE DESIGNS OR SYSTEMS PERTAINING TO THE SAFETY OF THE CONTRACTOR OR ITS EMPLOYEES, AGENTS, OR REPRESENTATIVES IN THE PERFORMANCE OF THE WORK. THE SEAL OF THE REGISTERED PROFESSIONAL ENGINEER(S) HEREON DOES NOT EXTEND TO ANY SUCH SYSTEMS THAT MAY NOW OR HEREAFTER BE INCORPORATED IN THE PLANS. THE CONTRACTOR SHALL PREPARE OR OBTAIN THE APPROPRIATE SAFETY SYSTEMS, INCLUDING CURRENT OSHA STANDARDS FOR TRENCH SAFETY SYSTEMS. SEALED BY A LICENSED PROFESSIONAL ENGINEER. APPROPRIATE TRENCH SAFETY PLANS SHALL BE SUBMITTED BY THE CONTRACTOR PRIOR TO EXECUTION OF A CONTRACT FOR HIS WORK.
31. FOR TRAFFIC SIGNAL CONSTRUCTION, CONTACT THE CITY OF SUGAR LAND INFORMATION TECHNOLOGY DEPARTMENT TO OBTAIN IP ADDRESSES FOR SIGNAL CABINET EQUIPMENT. ALLOW 5 WORKING DAYS FOR THE ADDRESS. ONCE EQUIPMENT HAS BEEN INSTALLED AND COMMUNICATIONS ESTABLISHED WITH THE TRAFFIC MANAGEMENT CENTER, IT WILL COMMISSION THE COMMUNICATION LINK. ALLOW 10 WORKING DAYS FOR COMMISSIONS.

CONCRETE/PAVING NOTES:

- 1. CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL PERMITS AND AUTHORIZATION REQUIRED BY CITY OF SUGAR LAND.
2. CONTRACTOR SHALL HAVE ALL UTILITIES LOCATED PRIOR TO CONSTRUCTION AND WILL REPAIR OR REPLACE ANY DAMAGE AT CONTRACTOR'S EXPENSE.
3. PAVING CONTRACTOR SHALL PROTECT WATER, SEWER, AND DRAINAGE FACILITIES AND WILL REPLACE ANY DAMAGED FACILITIES AT HIS OWN EXPENSE. ALL MANHOLES AND VALVES WITHIN THE PAVEMENT AREA SHALL BE ADJUSTED TO FINISH GRADE BY THE PAVING CONTRACTOR WITH THE USE OF APPROVED BLOCKOUTS.
4. WHEN THE TOP OF CURB OR BOTTOM OF SIDEWALK SLAB ELEVATION VARIES FROM THE NATURAL GROUND, THE PAVING CONTRACTOR SHALL BACKFILL IN LAYERS NOT EXCEEDING 8-INCHES IN DEPTH. EACH LAYER WILL BE COMPACTED TO A MINIMUM OF 95% STANDARD PROCTOR DENSITY. THE DISTURBED AREA SHALL BE SEED, SODDED, FERTILIZED, AND/OR SILT BARRIER FENCED WITHIN 10 WORKING DAYS. THE TYPE OF POLLUTION CONTROL WILL BE DETERMINED BY THE APPROVED PLANS AND/OR THE CITY OF SUGAR LAND CITY ENGINEER.
5. ALL PAVING SHALL BE IN ACCORDANCE WITH THE CITY OF SUGAR LAND DESIGN STANDARDS, APPROVED PLANS AND SPECIFICATIONS WITH THE LATEST REVISIONS OR AMENDMENTS. IN THE EVENT OF A CONFLICT, THE CITY OF SUGAR LAND DESIGN STANDARDS GOVERNS.
6. PAVING CONTRACTOR SHALL PROVIDE AND MAINTAIN SILT PROTECTION FENCES ON ALL STAGE I CURB INLETS. THE PAVING CONTRACTOR SHALL MAINTAIN ANY OTHER POLLUTION CONTROLS ESTABLISHED, I.E., ADDITIONAL SILT BARRIERS, SAND BAGS, ETC., FOR THE DURATION OF THE PROJECT. ANY DAMAGED OR MISSING DEVICES SHALL BE REPAIRED OR REPLACED AT THE CONTRACTOR'S EXPENSE.
7. EXISTING PAVEMENTS, CURBS, SIDEWALKS, DRIVEWAYS, ETC., DAMAGED OR REMOVED DURING CONSTRUCTION SHALL BE REPLACED TO THE CITY OF SUGAR LAND STANDARDS AT THE CONTRACTOR'S EXPENSE.
8. CONDITION OF THE WORK AREA (INCLUDING ROADS, RIGHT-OF-WAYS, ETC.) UPON COMPLETION OF THE JOB SHALL BE AS GOOD OR BETTER THAN THE CONDITION PRIOR TO STARTING THE WORK.
9. ALL DRIVEWAYS WILL BE LOCATED TO AVOID EXISTING CURB INLET STRUCTURES.
10. REDWOOD AND KEYSWAYS SHALL NOT INTERSECT WITHIN 2 FEET OF AN INLET.
11. AT INITIAL AND FINAL INSPECTIONS THE PAVEMENT WILL BE FLOODED TO CHECK FOR BIRDBATHS AND CRACKS. FLOODING OF STREETS SHALL OCCUR 1 HOUR PRIOR TO INSPECTION.
12. ALL CONCRETE PLACED SHALL BE UNIFORMLY SPRAYED WITH A MEMBRANE CURING COMPOUND AS DESCRIBED IN ITEM 526 IN THE TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION. IMPROPER APPLICATION WILL RESULT IN THE REJECTION OF THE CONCRETE.
13. SIX (6) INCH, 5.5 SK, 3500 PSI @ 28 DAYS, REINFORCED WITH #4 REBAR, 24" C.C. EACH WAY IS THE MINIMUM ACCEPTABLE CONSTRUCTION FOR LOCAL STREETS.
14. SEVEN (7) INCH, 5.5 SK, 3500 PSI @ 28 DAYS, REINFORCED WITH #4 REBAR, 18" C.C. EACH WAY IS THE MINIMUM ACCEPTABLE PAVEMENT CONSTRUCTION FOR COLLECTOR STREETS.
15. EIGHT (8) INCH, 5.5 SK, 3500 PSI @ 28 DAYS, REINFORCED WITH #4 18" C.C. EACH WAY IS THE MINIMUM ACCEPTABLE FOR ARTERIAL STREETS.
16. WHEN CONCRETE PAVEMENT INTERSECTS THICKER PAVEMENT, THE THICKER PAVEMENT SHALL BE CONSTRUCTED TO THE ENDS OF ALL CURB RETURNS.
17. ALL RETURNS SHALL HAVE A MIN. 25 FT. RADIUS AT THE FACE OF CURB UNLESS OTHERWISE NOTED.
18. ALL INTERSECTIONS SHALL BE CONSTRUCTED WITH WHEELCHAIR RAMPS IN ACCORDANCE WITH THE TEXAS ACCESSIBILITY STANDARD, THE AMERICAN DISABILITIES ACT, AND THE CITY OF SUGAR LAND STANDARDS (LATEST REVISIONS). (NO BLOCKOUTS)
19. CONCRETE SIDEWALKS SHALL BE CONSTRUCTED WITHIN EACH STREET RIGHT-OF-WAY IN ACCORDANCE WITH CITY OF SUGAR LAND, THE A.D.A., AND THE T.A.S. STANDARDS (LATEST REVISIONS).
20. CRACKS LARGER THAN 1/16-INCH ARE NOT ACCEPTABLE IN NEW PAVEMENT. CRACKS 1/16-INCH OR LESS SHALL BE ADDRESSED ON AN INDIVIDUAL BASIS BY DRILL AND EPOXY INJECTION, SUBJECT TO APPROVAL OR REJECTION.
21. PROPER TESTING AND LAB DOCUMENTATION IS REQUIRED. FAILURE TO MEET THE MINIMUM PAVEMENT REQUIREMENTS WILL RESULT IN THE REJECTION OF SAID PAVEMENT. IMMEDIATE REMOVAL AND REPLACEMENT OF SUBSTANDARD PAVEMENT SECTIONS WILL BE NECESSARY TO SATISFY THESE REQUIREMENTS.
22. 4-CONCRETE CYLINDERS, SLUMP, AND AIR ENTRAINMENT TESTS ARE REQUIRED FOR EACH 100 CUBIC YARDS OF CONCRETE PAVING WITH A MINIMUM OF ONE SET OF 4 PER PLACEMENT. THE CITY OF SUGAR LAND RESERVES THE RIGHT TO REQUEST ANY ADDITIONAL TESTS AT THE CONTRACTOR'S EXPENSE, IF ANY MATERIAL APPEARS BELOW STANDARDS.
23. NO. 3 REBAR, 18-INCH C.C. E.W. IS THE MINIMUM ACCEPTABLE FOR SIDEWALKS, NUMBER 4-REBAR, 24-INCH C-C. EACH WAY IS THE MINIMUM ACCEPTABLE FOR COMMERCIAL APPROACHES, HANDICAP RAMPS, RESIDENTIAL APPROACHES AND DRIVEWAYS.
24. COLD WEATHER PRECAUTIONS. CONCRETE PAVEMENT SHALL NOT BE PLACED WHEN THE AMBIENT TEMPERATURE IS 40°F AND FALLING. CONCRETE MAY BE PLACED IF THE AMBIENT TEMPERATURE IS 35° AND RISING. CONTRACTOR SHALL PROVIDE AN APPROVED COVERING MATERIAL (COTTON MATS, POLYETHYLENE SHEETING, ETC.) IN THE EVENT TEMPERATURE SHOULD FALL BELOW 32°F. NO SALT OR OTHER CHEMICALS SHALL BE ADDED TO CONCRETE TO PREVENT FREEZING.
25. HOT WEATHER. NO CONCRETE PAVEMENT MIXTURE SHALL BE PLACED IF THE MIXTURE TEMPERATURE IS ABOVE 95°F. AIR AND WATER REDUCER ARE REQUIRED IF MIXTURE TEMPERATURE REACHES 85°F OR ABOVE.
26. IF NO AIR AND WATER REDUCER HAS BEEN ADDED, NO CONCRETE SHALL BE PLACED IF MORE THAN 60 MINUTES PAST BATCH TIME. IF AIR AND WATER REDUCER HAS BEEN ADDED, NO CONCRETE SHALL BE PLACED IF MORE THAN 90 MINUTES PAST BATCH TIME.
27. STRUCTURE TEMPERATURES AND TIMING FOR CONCRETE PLACEMENT MAY VARY. REFER TO TXDOT STANDARDS ITEM 420 FOR DETAILS.
28. TRANSVERSE EXPANSION JOINTS SHALL BE PLACED AT ALL POINTS OF CURVATURE, POINTS OF TANGENCY AND ALL INTERSECTION CURB RETURN POINTS. MAXIMUM SPACING SHALL BE 200' AND BE SEALED WITH SEALANT CONFORMING TO TXDOT ITEM 360 (& ITEM 438) AND TXDOT DMS-6310, CLASS-2.
29. CONTROL JOINTS SHALL BE PLACED AT 20' C-C.
30. EXPANSION JOINT LAYOUT FOR INTERSECTIONS SHALL BE PROVIDED BY ENGINEER FOR CITY APPROVAL.
31. NO WIRE MESH IS ALLOWED IN ANY CONCRETE WITHIN THE CITY LIMITS OR ETJ.
32. ALL REBAR SHALL BE 100% TIED. OVERLAPS SHALL BE DOUBLE TIED MINIMUM. REINFORCED STEEL BE A MINIMUM 60% COVERAGE.
33. ALL NEW CURB REQUIRES 3,000 P.S.I. @ 28-DAYS. 4 CONCRETE CYLINDERS, SLUMP, AND AIR ENTRAINMENT TESTS ARE REQUIRED FOR EACH 50 CUBIC YARDS OF CONCRETE CURB WITH A MINIMUM OF ONE SET OF 4 PER PLACEMENT.
34. A CITY INSPECTOR MUST BE PRESENT ON ALL PROOF ROLLS, LIME DEPTH CHECKS AND DENSITY TESTS AND MUST BE CONTACTED AT LEAST 24 HOURS PRIOR TO THE TEST.
35. CONCRETE MIX DESIGN MUST BE SENT TO THE CITY FOR APPROVAL A MINIMUM 72 HOURS BEFORE THE FIRST CONCRETE POUR
36. FOR A REGULAR MIX, SLUMP SHALL BE A MAXIMUM OF 5". FOR A MIX WITH A WATER REDUCER, SLUMP SHALL BE A MAXIMUM OF 6".
37. VEHICLES OF ALL TYPES ARE PROHIBITED FROM DRIVING ON NEW PAVEMENTS SEVEN (7) DAYS AFTER THE CONCRETE POUR AND UNTIL THE CONCRETE HAS REACHED A MINIMUM OF 3,000 PSI. PAVEMENT PROTECTION SUCH AS A DIRT LAYER OF AT LEAST 12" IS REQUIRED FOR TRACK EQUIPMENT AT PAVEMENT CROSSINGS.
38. IN LIEU OF MECHANICALLY CONTROLLED VIBRATORS CONTROLLED BY A SLIP-FORM PAVING MACHINE, HAND MANIPULATED MECHANICAL VIBRATORS SHALL BE USED FOR PROPER CONSOLIDATION OF CONCRETE IN ALL PAVEMENT AREAS (ALONG FORMS, AT JOINTS, ETC.)
39. ALL CONCRETE STREETS AND BRIDGE SURFACES SHALL HAVE A "BAKER BROOM" FINISH, WHILE ALL OTHER CONCRETE PLACEMENT SHALL HAVE A MEDIUM BROOM FINISH.
40. ALL PAVEMENT MARKINGS TO BE DONE IN CONFORMANCE WITH THE LATEST VERSION OF TMUTCD AND TXDOT STANDARD SPECIFICATIONS AND ANY REVISIONS THERETO.
41. REFER TO GENERAL NOTES.

CEMENT STABILIZED SAND:

- 1. ALL STABILIZED SAND SHALL BE A MINIMUM OF 1.5 SK PER CUBIC YARD.
2. CEMENT STABILIZED SAND (C.S.S.) SHALL ACHIEVE A MINIMUM OF 100 PSI WITHIN 48 HOURS.
3. A MINIMUM OF 2 RANDOM SAMPLES SHALL BE TAKEN EACH WEEK. (FOR SMALLER PROJECTS, ONE SAMPLE MAY SUFFICE WITH CITY OF SUGAR LAND APPROVAL.) THE CITY OF SUGAR LAND RESERVES THE RIGHT TO REQUIRE ADDITIONAL TESTS, AT THE CONTRACTOR'S EXPENSE IF IT IS DEEMED NECESSARY.
4. ANY C.S.S. NOT MEETING CITY OF SUGAR LAND STANDARDS SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE.
5. BOTH CEMENT CONTENT AND COMPRESSIVE TESTS SHALL BE CONDUCTED ON C.S.S. SAMPLES.
6. ALL C.S.S. SHALL BE COMPACTED IN MAXIMUM OF 8-INCH LIFTS AND REQUIRED TO REACH A MINIMUM DENSITY OF 95%. 7. REFER TO GENERAL NOTES.

BANK SAND:

- 1. BANK SAND IS DEFINED AS A WELL-GRADED SAND, FREE OF SILT, CLAY, FRIBLOR SOLUBLE MATERIALS AND ORGANIC MATTER, MEETING THE UNIFIED SOILS CLASSIFICATIONS SYSTEM GROUP SYMBOL SW CRITERIA WITH A PLASTICITY INDEX OF LESS THAN 10. NO MORE THAN 12% OF MATERIAL CAN PASS THE No. 200 SIEVE.

ASPHALT - OILS AND EMULSIONS:

- 1. CONTRACTOR SHALL VERIFY LINES AND GRADES AND THAT COMPACTED BASE IS READY TO SUPPORT LOADS.
2. BASE MATERIAL SHALL BE DRY AND THOROUGHLY CLEAN OF LOOSE MATERIAL PRIOR TO APPLICATION.
3. OILS & EMULSION SHALL BE DISTRIBUTED EVENLY AND SMOOTHLY UNDER PRESSURE NECESSARY FOR PROPER DISTRIBUTION.
4. MAINTAIN REQUIRED SURFACE CONDITIONS UNTIL ACCEPTED BY THE CITY OF SUGAR LAND.
5. PRIME COAT SHALL BE M.C.-30, M.C.-70 OR E.P.R.1 PRIME AND SHALL COMPLY WITH TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION OF HIGHWAYS, STREETS, AND BRIDGES (1993) AND ITS LATEST REVISIONS.
6. TACK COAT SHALL BE SS-1 AND SHALL COMPLY TO TXDOT, S.S.C.H.S. & B. (1993) AND ITS LATEST REVISIONS.
7. M.C.-30 AND M.C.-70 AND EPR-1 PRIME SHALL BE DISTRIBUTED AT A RATE OF .25 TO .35 GALLONS PER SQUARE YARD. AND MAY NOT BE APPLIED WHEN AMBIENT TEMPERATURE IS 50°F AND FALLING. (NOTICE: CUTBACK ASPHALTS MAY NOT BE USED DURING THE PERIOD OF APRIL 16 THROUGH SEPT. 15 AS PER ASTM D-244.)
8. EPR-1 MAXIMUM WATER DILUTION IS 3 PARTS WATER TO ONE PART EPR-1.
9. SS-1 TACK COAT SHALL BE APPLIED AT A RATE NOT TO EXCEED 0.06 GAL. PER SQUARE YARD OF SURFACE AREA. CONTACT JOINTS, CURBS, ETC. SHALL BE PAINTED WITH AN EVEN THIN COAT APPLIED BY BRUSH OR BROOM. COATING MATERIAL SHALL BE HEATED TO 125°F TO 180°F WHEN APPLIED. TACK COAT MAY BE APPLIED WHEN AMBIENT TEMPERATURES ARE 40°F AND RISING. TACK COAT MAY NOT BE APPLIED IF AMBIENT AIR IS 50°F AND FALLING.

LIMING SUBGRADE:

- 1. LIME SHALL BE A "SLURRY" AS PER TXDOT 260 UNLESS SPECIFICALLY RECOMMENDED BY THE GEOTECHNICAL ENGINEER AND APPROVED BY THE CITY ENGINEER.
2. ALL LIME SLURRIES SHALL BE FURNISHED AT OR ABOVE THE MINIMUM "DRY SOLIDS" CONTENTS AS APPROVED BY THE ENGINEER.
3. SUBGRADES SHALL BE STABILIZED WITH A MINIMUM SIX PERCENT (6%) LIME BY WEIGHT, EIGHT INCHES (8") THICK THE INITIAL MIX TO REDUCE PLASTICITY INDEX (PI) TO 20 OR LESS AS DETERMINED BY THE LIME SERIES. THE FINAL MIX SHALL BE AT SIX INCHES (6") THICK.
4. LIME DRY SOLID CONTENT TESTS SHALL BE CONDUCTED ON SITE, ONCE PER ONE-HUNDRED (100) TONS OF MATERIAL DISTRIBUTED, UNLESS OTHERWISE NOTED.
5. THE SUBGRADE SHALL BE SHAPED AND GRADED TO CONFORM TO THE TYPICAL SECTIONS, AS SHOWN ON THE PLANS. PRIOR TO TREATING THE EXISTING MATERIAL.
6. UNLESS APPROVED BY THE CITY ENGINEER, LIME OPERATIONS SHALL NOT BE STARTED WHEN THE AMBIENT AIR TEMPERATURE IS BELOW 40°F AND FALLING. LIMING MAY, WITH APPROVAL, BE STARTED WHEN THE AMBIENT AIR TEMPERATURE IS 35°F AND RISING. LIME SHALL NOT BE PLACED WHEN WEATHER CONDITIONS, IN THE ENGINEER'S OPINION, ARE UNSUITABLE.
7. THE SUBGRADE MATERIAL AND SLURRY SHALL BE THOROUGHLY MIXED, BROUGHT TO THE PROPER MOISTURE CONTENT (±2) AND LEFT TO CURE USUALLY 3 DAYS (72 HRS.) MINIMUM AS APPROVED BY THE CITY ENGINEER.
8. AFTER CURING, THE SUBGRADE SHALL BE REMIXED UNTIL PULVERIZATION REQUIREMENTS ARE MET, AS PER TXDOT.
TEX-101-E, PART III.
PERCENT MINIMUM PASSING 1-3/4" SIEVE.....100
PERCENT MINIMUM PASSING 3/4" SIEVE.....85
PERCENT MINIMUM PASSING No.4 SIEVE.....60
9. SIEVE TESTS SHALL BE CONDUCTED EVERY 150 LF ON ALTERNATING LANES OF TRAFFIC OR EVERY 300 LF ON SINGLE LANES AS REQUIRED. AT LEAST ONE TEST SHALL BE CONDUCTED ON EACH ROADWAY OR CUL-DE-SAC.
10. THE MATERIAL SHALL BE AERATED OR MOISTENED TO + OR -2% OPTIMUM PRIOR TO COMPACTION. COMPACTION TO A MINIMUM 95% DENSITY SHALL BEGIN IMMEDIATELY AFTER ALL PULVERIZATION AND MOISTURE REQUIREMENTS ARE MET. THROUGHOUT THIS ENTIRE OPERATION, THE SURFACE SHALL BE SMOOTH AND IN CONFORMITY WITH THE LINES AND GRADES ON THE PLANS.
11. WHEN THE SUBGRADE FAILS TO MEET DENSITY REQUIREMENTS OR SHOULD IT LOSE THE REQUIRED STABILITY, DENSITY OR FINISH, IT SHALL BE REWORKED IN ACCORDANCE WITH TXDOT SUBARTICLE 260.4(7) "REWORKING A SECTION", WHICH MAY REQUIRE AN ADDITIONAL 25% OF THE SPECIFIED LIME AMOUNT.
12. THE TREATED SUBGRADE SHALL BE KEPT MOIST AND PREVENTED FROM DRYING. IN THE EVENT OF A ONE-HALF (1/2) INCH RAINFALL AND/OR IF THE MATERIAL BECOMES DRY AND IS NOT IN COMPLIANCE WITH THE ±2% OPTIMUM MOISTURE, DENSITY AND MOISTURE TESTS SHALL BE RETAKEN.
13. LIME DEPTH DETERMINATIONS WILL BE CONDUCTED AT EACH LOCATION OF DENSITY TESTING, LIME-STABILIZED SUBGRADE SHALL BE A MINIMUM OF 6% AT 8" UNLESS OTHERWISE DIRECTED BY CITY ENGINEER. DENSITY TESTING SHALL BE DONE IMMEDIATELY PRIOR TO PLACEMENT OF REINFORCING STEEL, AND SHALL BE COMPACTED TO A MINIMUM OF 95%. LIME DEPTH TESTS SHALL BE CONDUCTED AT EVERY 150 LF OF ROADWAY ON ALTERNATING LANES OR EVERY 300 LF OF SINGLE LANE. AT LEAST ONE TEST SHALL BE CONDUCTED ON EACH ROADWAY AND/OR CUL-DE-SAC.
14. NO SUBGRADE SHALL BE COVERED WITH ANOTHER MATERIAL UNLESS APPROVED BY THE CITY OF SUGAR LAND AND LIME DEPTH TESTS HAVE BEEN COMPLETED.

HOT MIX ASPHALTIC BASE COURSE:

- 1. NO HOT MIX ASPHALTIC BASE MAY BE INSTALLED UNTIL THE SUBGRADE HAS BEEN PROPERLY PREPARED AND TESTED AS PER THE PLANS AND SPECIFICATIONS. THE SUBGRADE SHALL BE INSPECTED AND APPROVED BY THE CITY OF SUGAR LAND BEFORE ANY BASE MATERIALS ARE INSTALLED.
2. HOT MIX ASPHALTIC BASE MATERIALS, HANDLING, AND INSTALLATION SHALL COMPLY WITH TXDOT STANDARDS FOR CONSTRUCTION OF HIGHWAYS, STREETS, AND BRIDGES 1995 (SECTION 02711) AND ITS LATEST REVISIONS.
3. HOT MIX ASPHALTIC MATERIALS SHALL BE AT TEMPERATURES BETWEEN 250°F AND 325°F, WHEN PLACED.
4. MATERIALS MAY NOT BE PLACED IN WET CONDITIONS OR IF THE AMBIENT TEMPERATURE IS BELOW 50°F AND FALLING. MATERIALS MAY BE INSTALLED IF THE AMBIENT TEMPERATURE IS TAKEN IN THE SHADE AND IS 40°F AND RISING.
5. PLACE BASE COURSES 4 INCHES OR GREATER IN THICKNESS IN TWO OR MORE LAYERS, EACH HAVING A COMPACTED THICKNESS OF NOT GREATER THAN 4 INCHES.
6. BASE MATERIAL MAY ONLY BE PLACED AGAINST CLEAN, STRAIGHT EDGES. SAW CUTTING, FULL DEPTH, IS REQUIRED IF EXISTING EDGES ARE ROUGH OR UNEVEN.
7. COMPACTION SHALL BEGIN WHILE MATERIAL IS STILL HOT AND AS SOON AS IT WILL BEAR THE ROLLER OR COMPACTOR WEIGHT WITHOUT UNDUE DISPLACEMENT OR HAIR CRACKING.
8. COMPACT SURFACE UNIFORMLY WITH ROLLERS OR TAMPERS IN LOCATIONS NOT READILY ACCESSIBLE (I.E., ALONG CURBS, WALLS, ETC.).
9. UNLESS OTHERWISE SPECIFIED, COMPACT DENSITY TO NOT LESS THAN 95% OF MAXIMUM POSSIBLE DENSITY.
10. A CERTIFIED LAB SHALL BE ON SITE AT ALL TIMES TO TEST AND PROPERLY DOCUMENT THE CONSTRUCTION METHODS AND QUALITY OF MATERIALS.
11. ALL MATERIALS AND WORKMANSHIP SHALL COMPLY TO A.S.T.M. ASPHALT INSTITUTE AND CITY OF SUGAR LAND REQUIREMENTS. FAILURE TO COMPLY WILL RESULT IN REJECTION OF SAID MATERIALS AND SUCH SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.
12. DO NOT OPEN BASE TO TRAFFIC UNTIL IT CAN BE MAINTAINED IN GOOD CONDITION AND IS CAPABLE OF SUPPORTING VEHICLE WEIGHT WITHOUT DAMAGE OR DEGRADATION.
13. DENSITIES SHALL BE TAKEN AT A MINIMUM OF AT LEAST ONCE PER 300 LF OF DRIVE LANE OR ONCE PER 250 SQ. YD., WHICHEVER MAY APPLY AND SHALL BE STAGGERED RELATIVE TO TESTING SITES IN ADJUTING TRAFFIC LANES. FAILURE TO MEET MINIMUM REQUIREMENTS SHALL RESULT IN THE REPLACEMENT OF SAID MATERIAL AT CONTRACTOR'S EXPENSE.

Table with 3 columns: No., DATE, REVISION

SEAL:
DESIGN ENGINEER: \_\_\_\_\_ DATE \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS
ENGINEERING DEPARTMENT





CONSTRUCTION PLANS FOR:

GENERAL CONSTRUCTION NOTES I

Table with 2 columns: JOB No., DATE, DESIGNED BY, DRAWN BY, CHECKED BY, SCALE; and SHEET OF (SL-01)

REVISION DATE: OCTOBER 2021



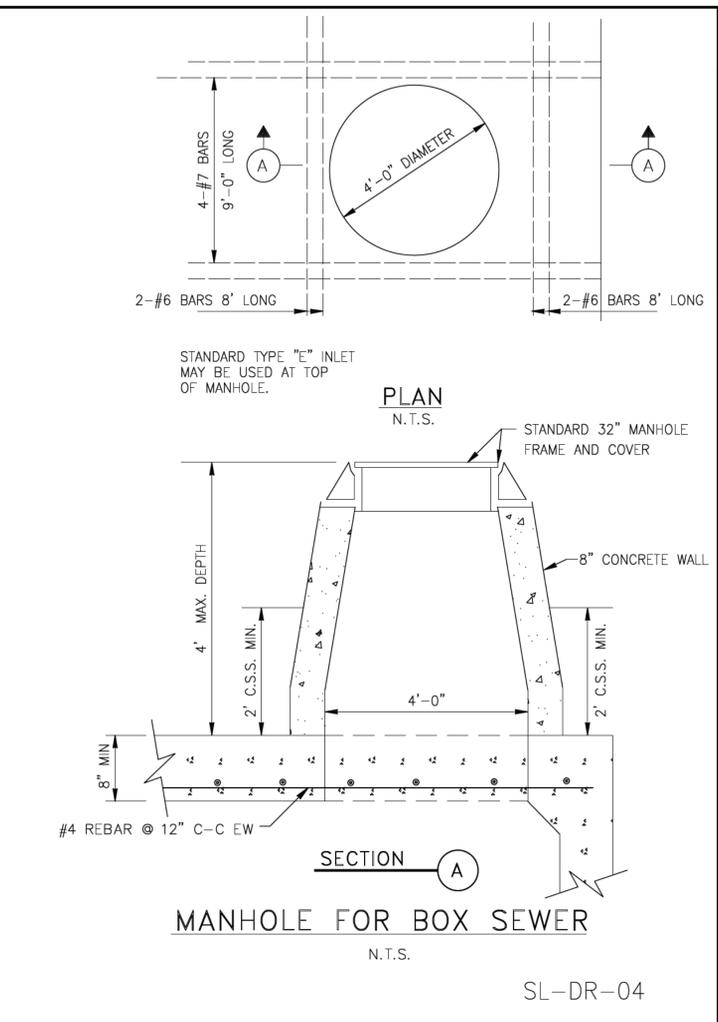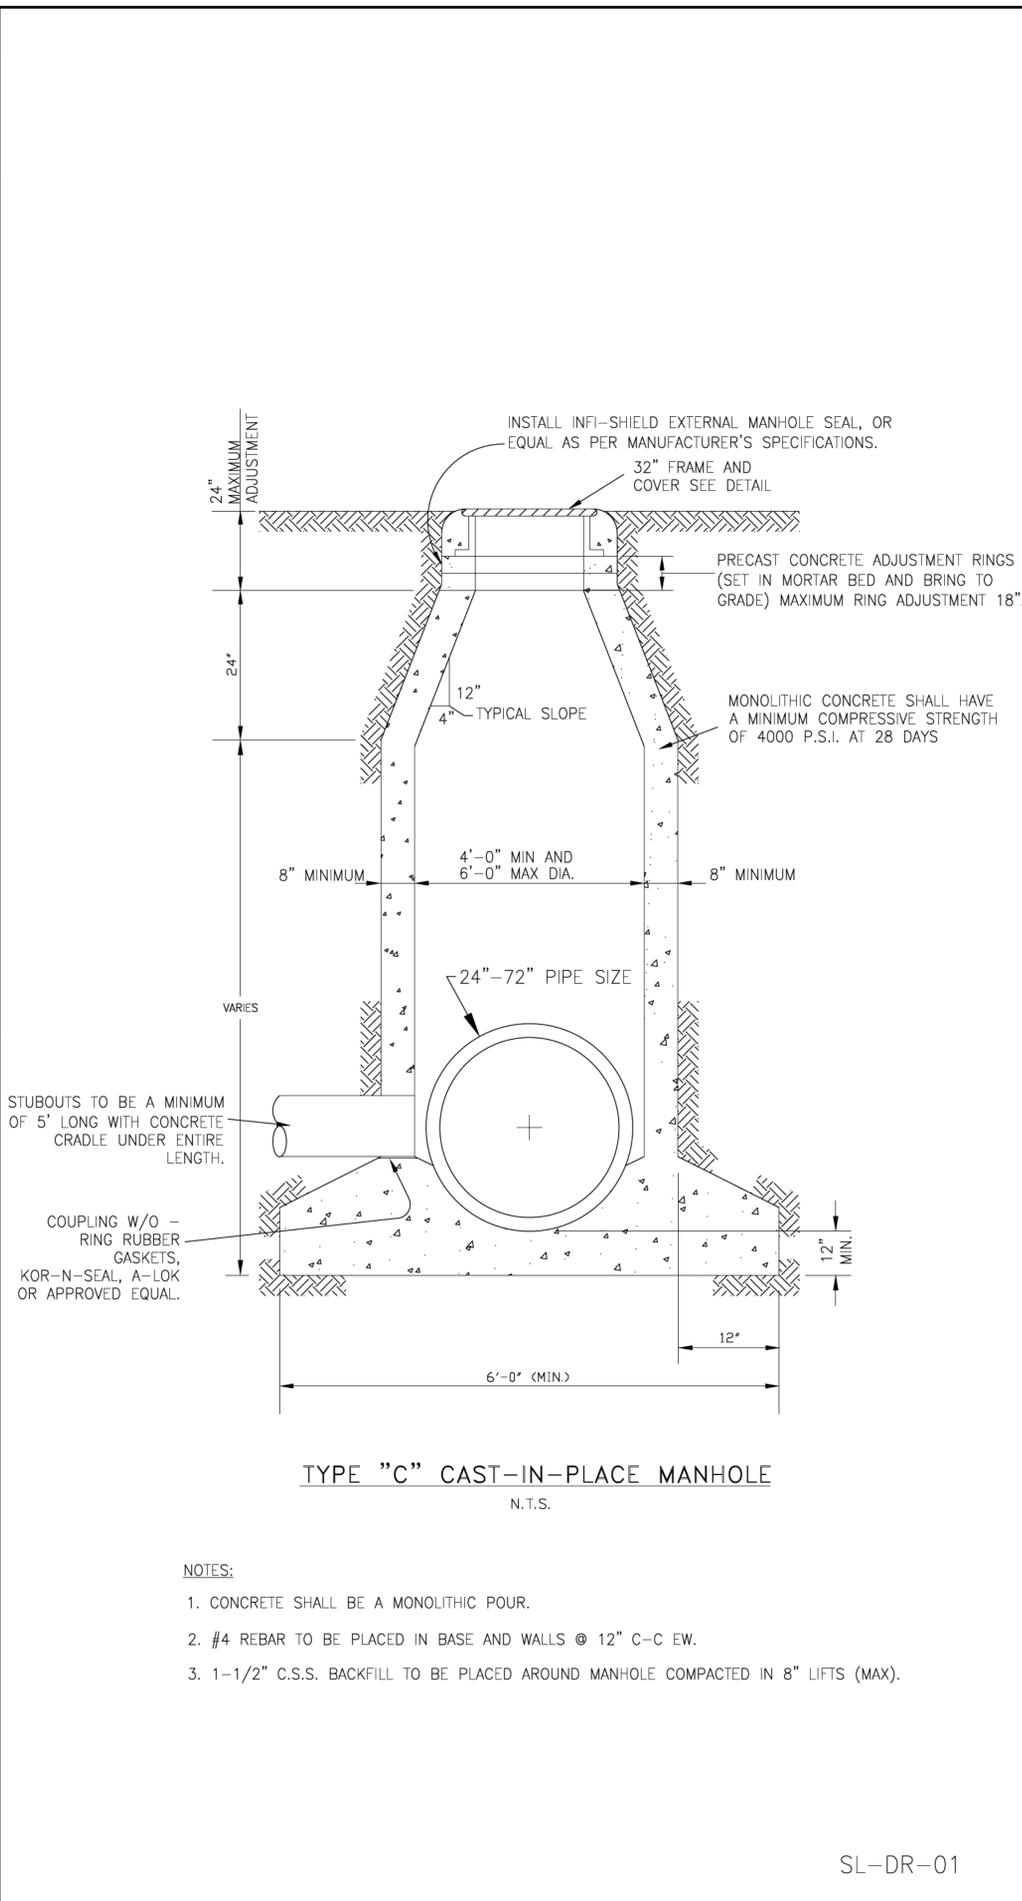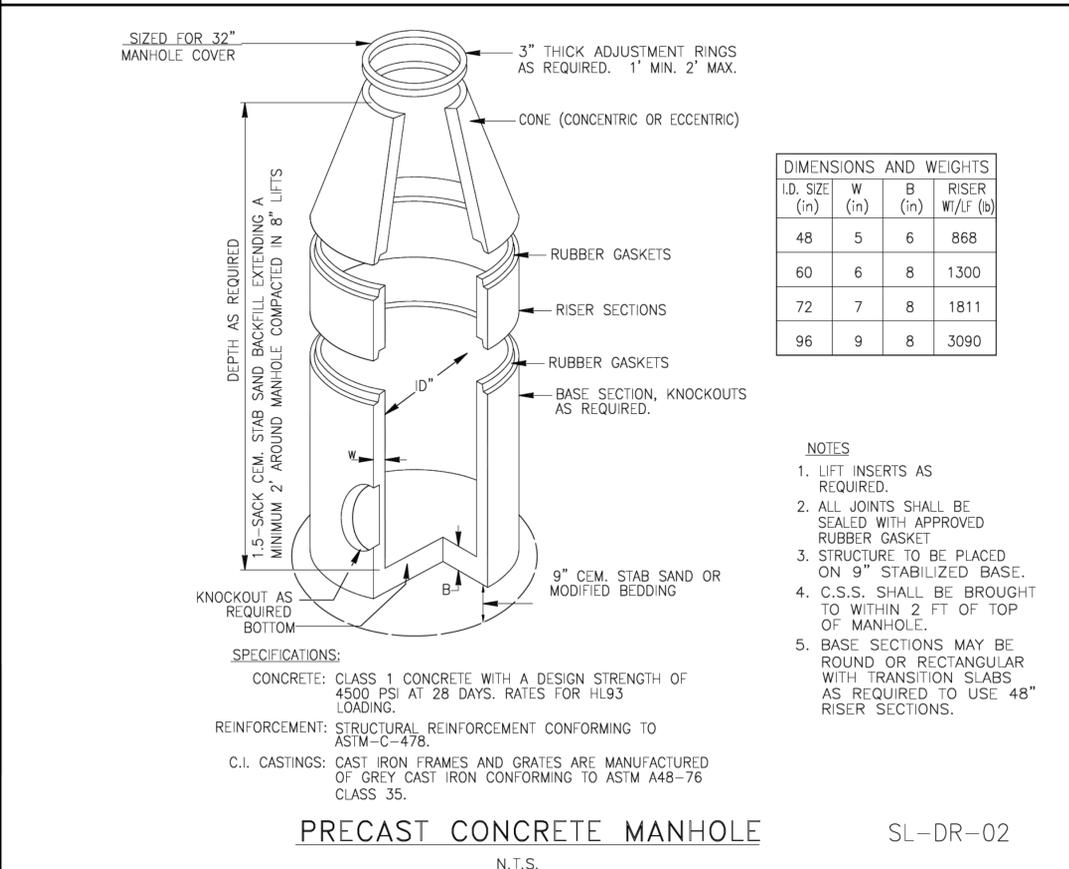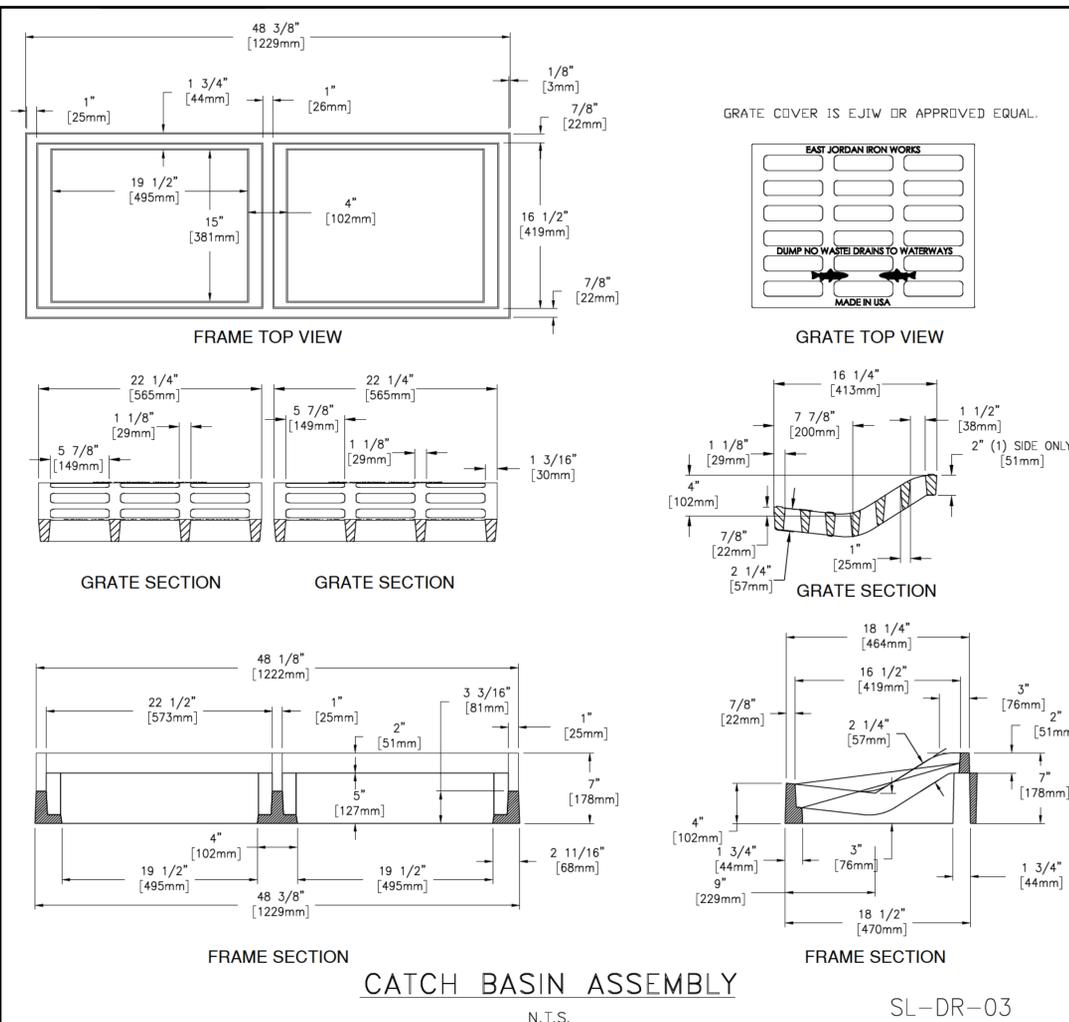

GENERAL CONSTRUCTION NOTES:

- ALL CAST CONCRETE BASES AND WALLS SHALL HAVE # 4 REBAR @ 12" C-C EW
- CONCRETE SHALL BE 3000 PSI MIN.
- USE C.S.S. BEDDING AS PER DETAILS. 1 1/2 SK, COMPACTED 8" LIFTS (MAX.) TO 95% STANDARD.

REVISION

No.	DATE	REVISION

DESIGN ENGINEER: \_\_\_\_\_ DATE \_\_\_\_\_

CITY OF SUGAR LAND TEXAS

CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:

STORM SEWER MANHOLE  
CONSTRUCTION DETAILS

REFER TO:

- GENERAL NOTES, C.S.S & CONCRETE NOTES
- STORM SEWER NOTES

JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_



SL-03

SHEET OF

REVISION DATE: OCTOBER 2021







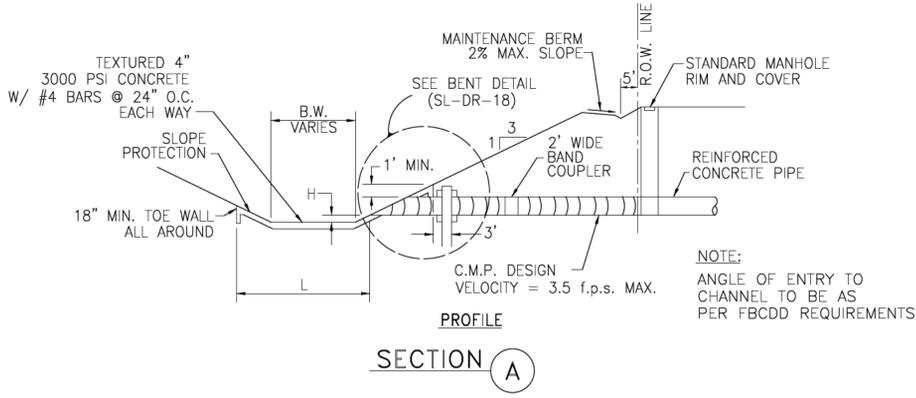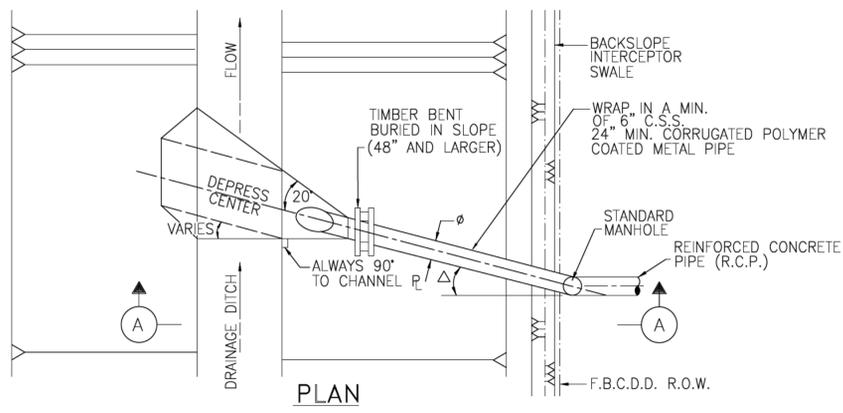


STORM SEWER OUTFALL  
N.T.S.

SL-DR-15

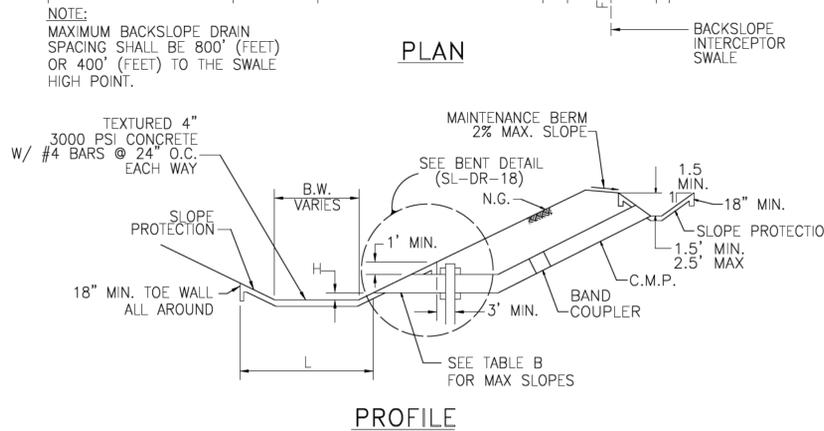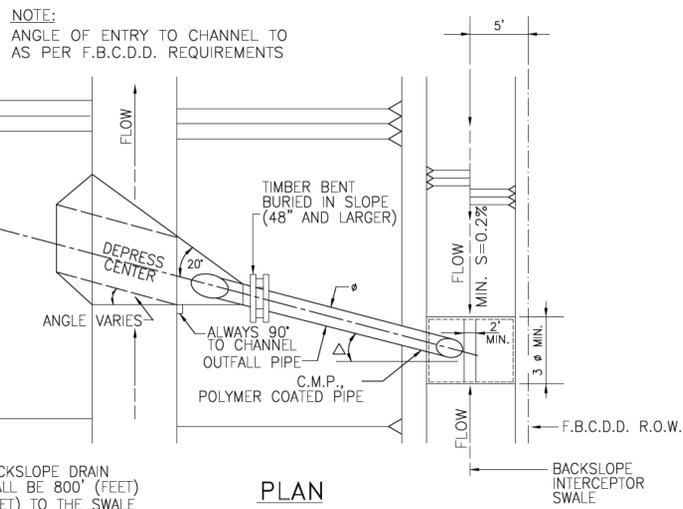


BACKSLOPE INLET & OUTFALL  
N.T.S.

SL-DR-16

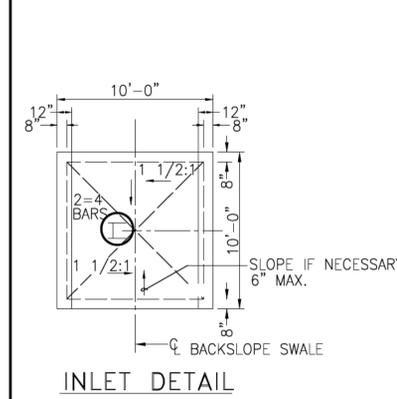

SL-DR-20

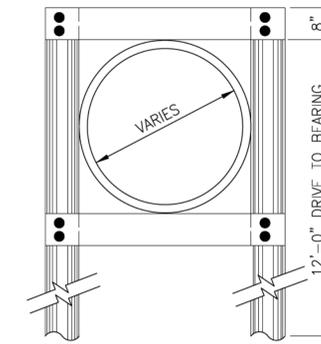

END VIEW OF OUTFALL  
SL-DR-21

TABLE A

SIZE 2 2/3" X 1/2" CORRUGATION	PIPE GAUGE	BAND COUPLER GAUGE	SIZE 3'X1' & 5'X1' CORRUGATION	PIPE GAUGE	BAND COUPLER GAUGE
24"	12	12			
30"	12	12			
36"	12	12			
42"	12	12			
48"	12	12	48"	12	12
54"	12	12	54"	12	12
60"	12	12	60"	12	12
66"	10	12	66"	12	12
72"	10	12	72"	12	12
78"	8	10	78"	12	12
84"	8	10	84"	12	12

TABLE B


PIPE DIA.	SLOPE	VELOCITY
24"	0.6%	3.25 f.p.s
36"	0.3%	3.00 f.p.s
42"	0.2%	2.75 f.p.s
48"	0.2%	3.00 f.p.s
54"	0.2%	3.25 f.p.s

SL-DR-19

CONSTRUCTION NOTES:

L :  $\frac{B.W.}{PIPE \phi} \leq 7'-6" \Rightarrow$  LENGTH WILL EXTEND ONE-HALF PIPE  $\phi$  ABOVE  $\phi$  ON OPPOSITE BANK (MIN. 36") OR A MINIMUM OF 6-PIPE  $\phi$  TOWARDS OPPOSITE BANK OF CHANNEL, WHICH EVER IS THE LESSER.

$\Delta$  : PROP. 24" TO 42"  $\Delta = 15'$   
PROP. 48" AND LARGER  $\Delta = 30'$   
H : FOR PIPE SIZES 24" TO 42"  
H=3' MAX. AND 1' MIN.  
FOR PIPE SIZES 48" AND LARGER  
H=1' MAX. AND MIN.

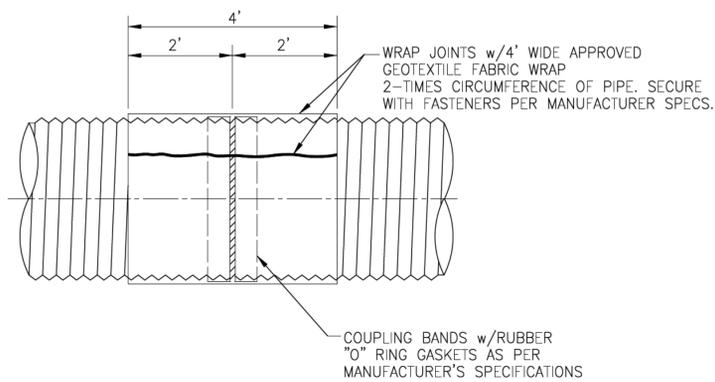


- NOTES:
1. ANY PIPE DEFLECTED MORE THAN 2% SHALL BE REJECTED AND REPLACED AT CONTRACTOR'S EXPENSE.
  2. INSTALLATION SHALL BE AS PER MANUFACTURER'S RECOMMENDATIONS INCLUDING ITEMS AS DETAILED IN INSTALLATION MANUAL FOR CORRUGATED STEEL DRAINAGE STRUCTURES.

STORM SEWER JOINT WRAP DETAIL  
N.T.S.

SL-DR-17

- CONSTRUCTION NOTES:
- 4" CONCRETE THICKNESS, 18" TOE WALL ON ALL SIDES, 24" MINIMUM ALL DIRECTIONS AROUND PIPE, WEEP HOLES SUFFICIENT TO RELEASE HYDROSTATIC PRESSURE, FIBERBOARD EXPANSION JOINTS.

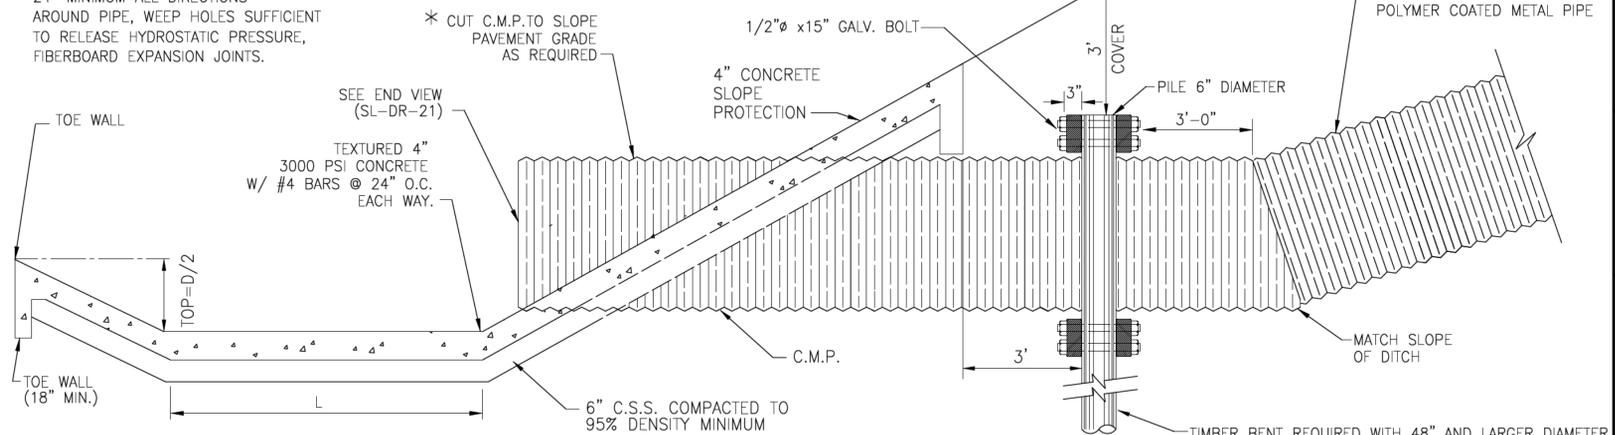

- NOTES:
1. OUTFALL PIPE SHALL BE POLYMER-COATED, CORRUGATED, METAL PIPE. ALUMINUM PIPE OR ALUMINIZED COAT IS NOT ALLOWED.
  2. STONE RIP RAP IS NOT ALLOWED.
  3. SEE GENERAL, C.S.S. AND CONCRETE NOTES.
  4. SEE END VIEW DETAIL (THIS SHEET).
  5. ALL CONNECTING BANDS MUST HAVE AN APPROVED RUBBER GASKET.

TIMBER BENT DETAIL FOR  
CORRUGATED METAL PIPE OUTFALL

N.T.S.

SL-DR-18

No.	DATE	REVISION

SEAL: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGN ENGINEER: \_\_\_\_\_





CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:  
STORM SEWER OUTFALL  
CONSTRUCTION DETAILS




JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-06  
SHEET OF \_\_\_\_\_




REVISION DATE: OCTOBER 2021

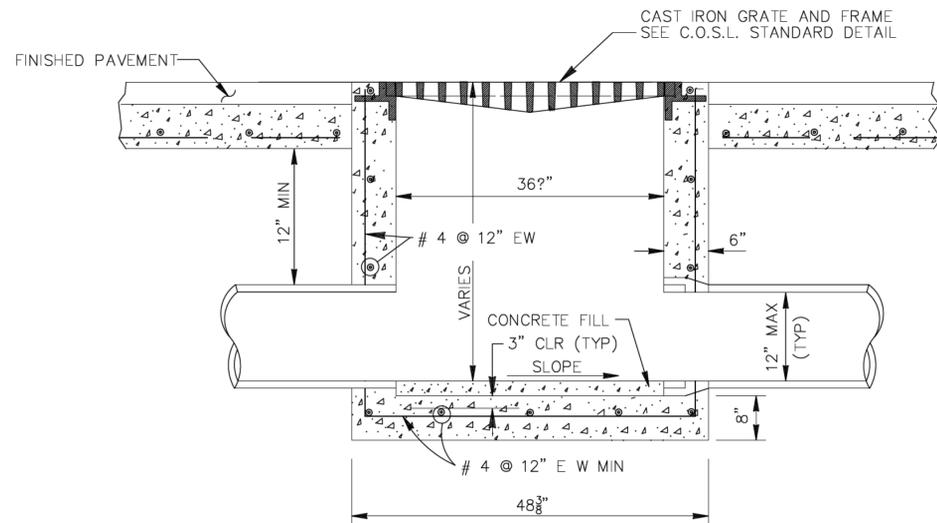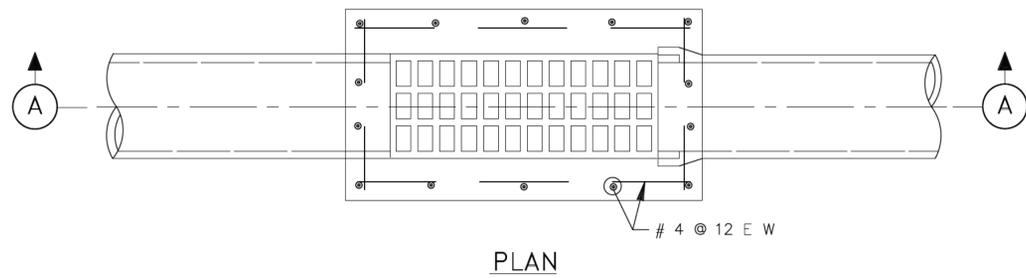

SL-DR-24

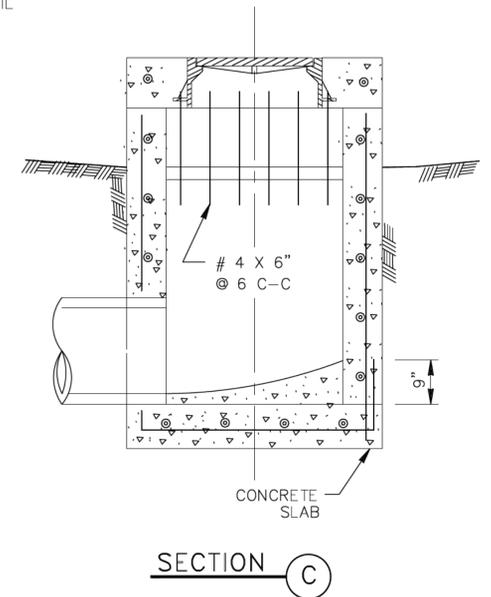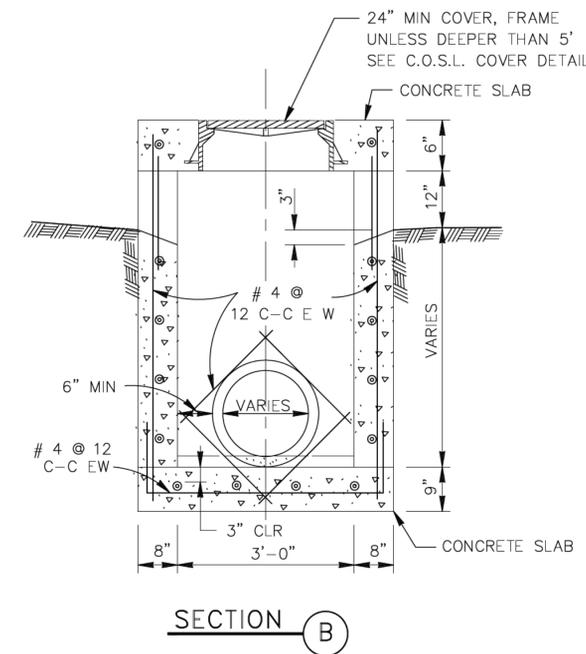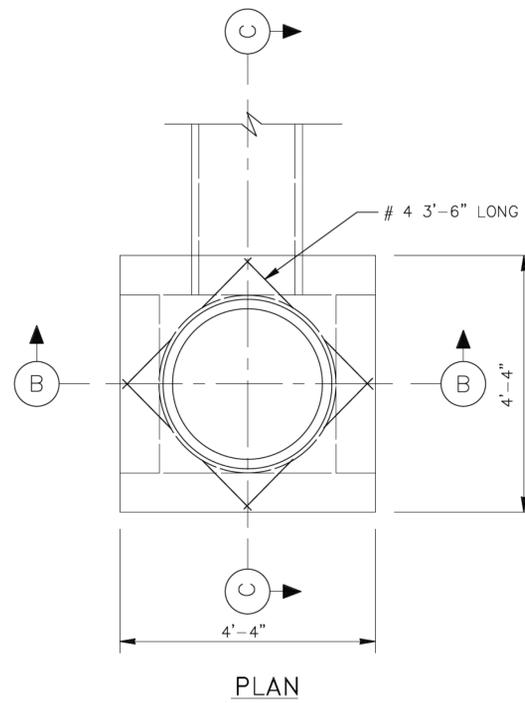

SL-DR-22

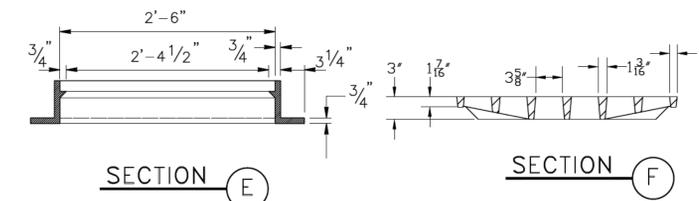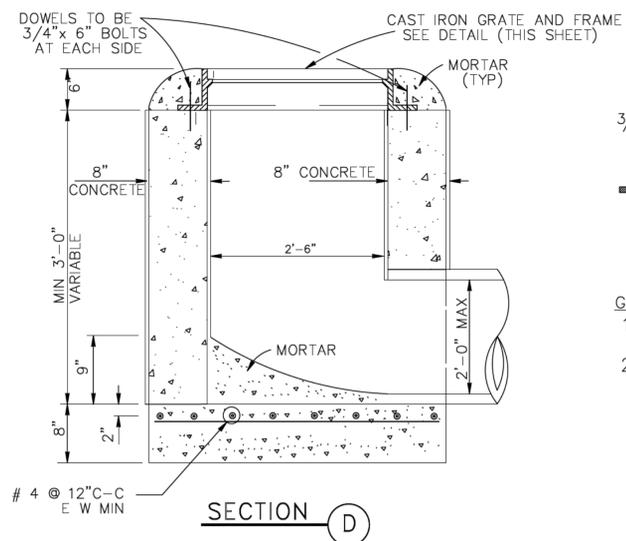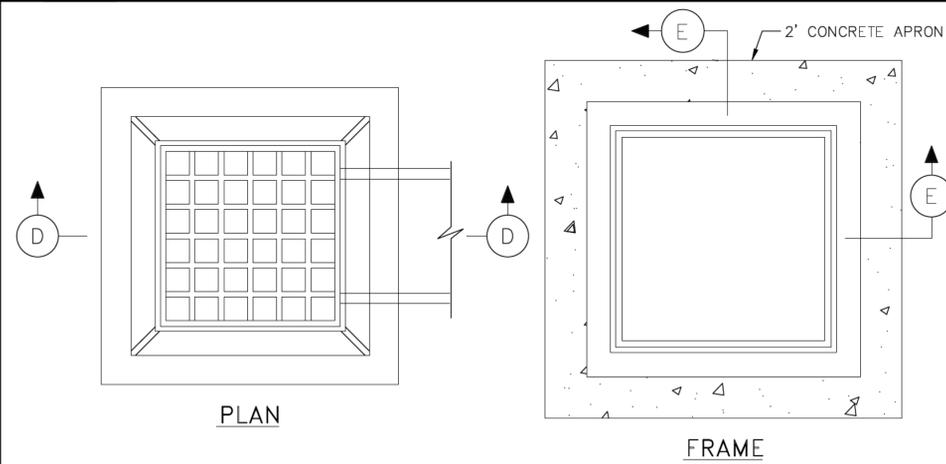

- GENERAL CONSTRUCTION NOTES:
1. CONCRETE CAST WALLS SHALL HAVE #4 REBAR PLACED @ 12" C-C EW.
  2. GRATE LID IS EAST JORDAN IRON WORKS OR APPROVED EQUAL

SL-DR-23

REFER TO:

1. GENERAL NOTES, C.S.S. & CONCRETE NOTES
2. STORM SEWER NOTES

No.	DATE	REVISION

SEAL:

DESIGN ENGINEER: \_\_\_\_\_ DATE \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:

STORM SEWER INLET  
CONSTRUCTION DETAILS I






JOB No.:  
DATE:  
DESIGNED BY:  
DRAWN BY:  
CHECKED BY:  
SCALE:

SL-07

SHEET OF





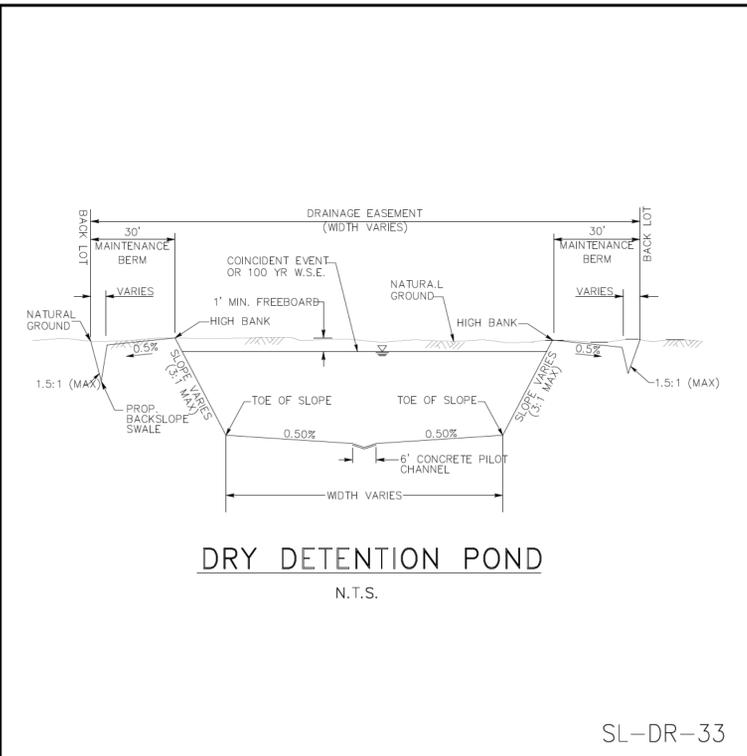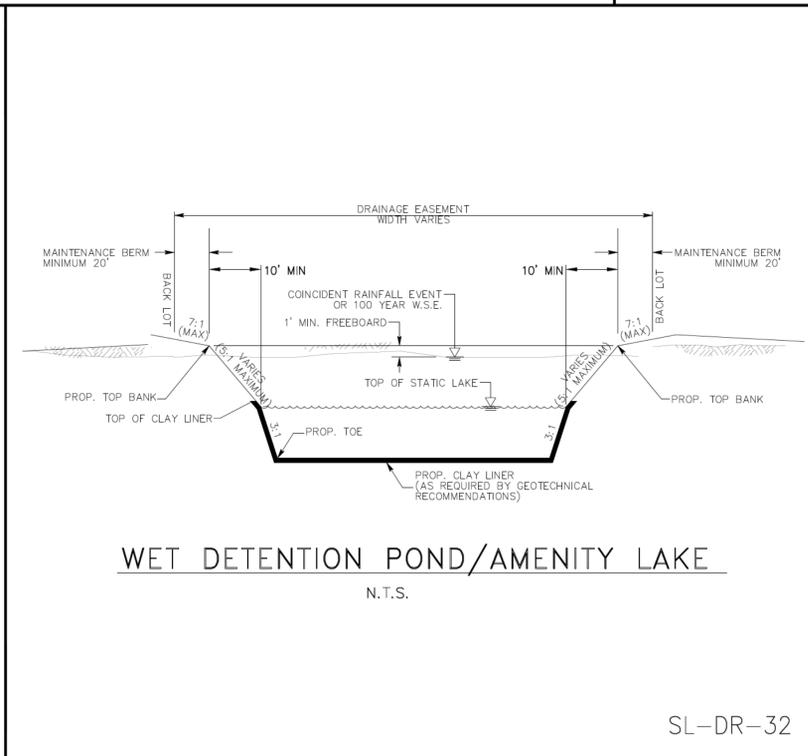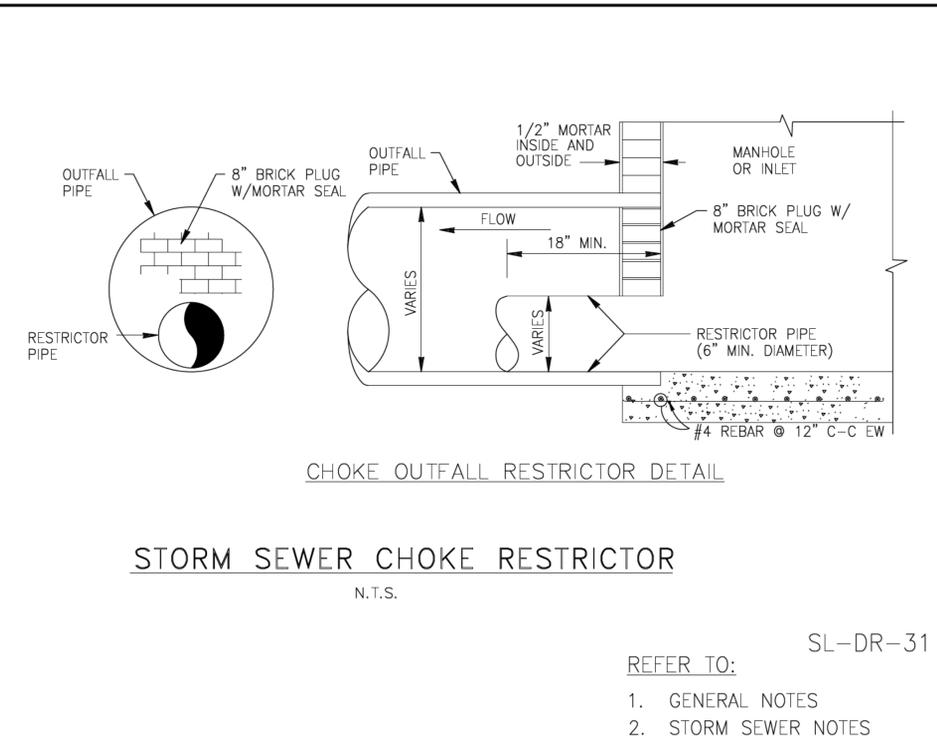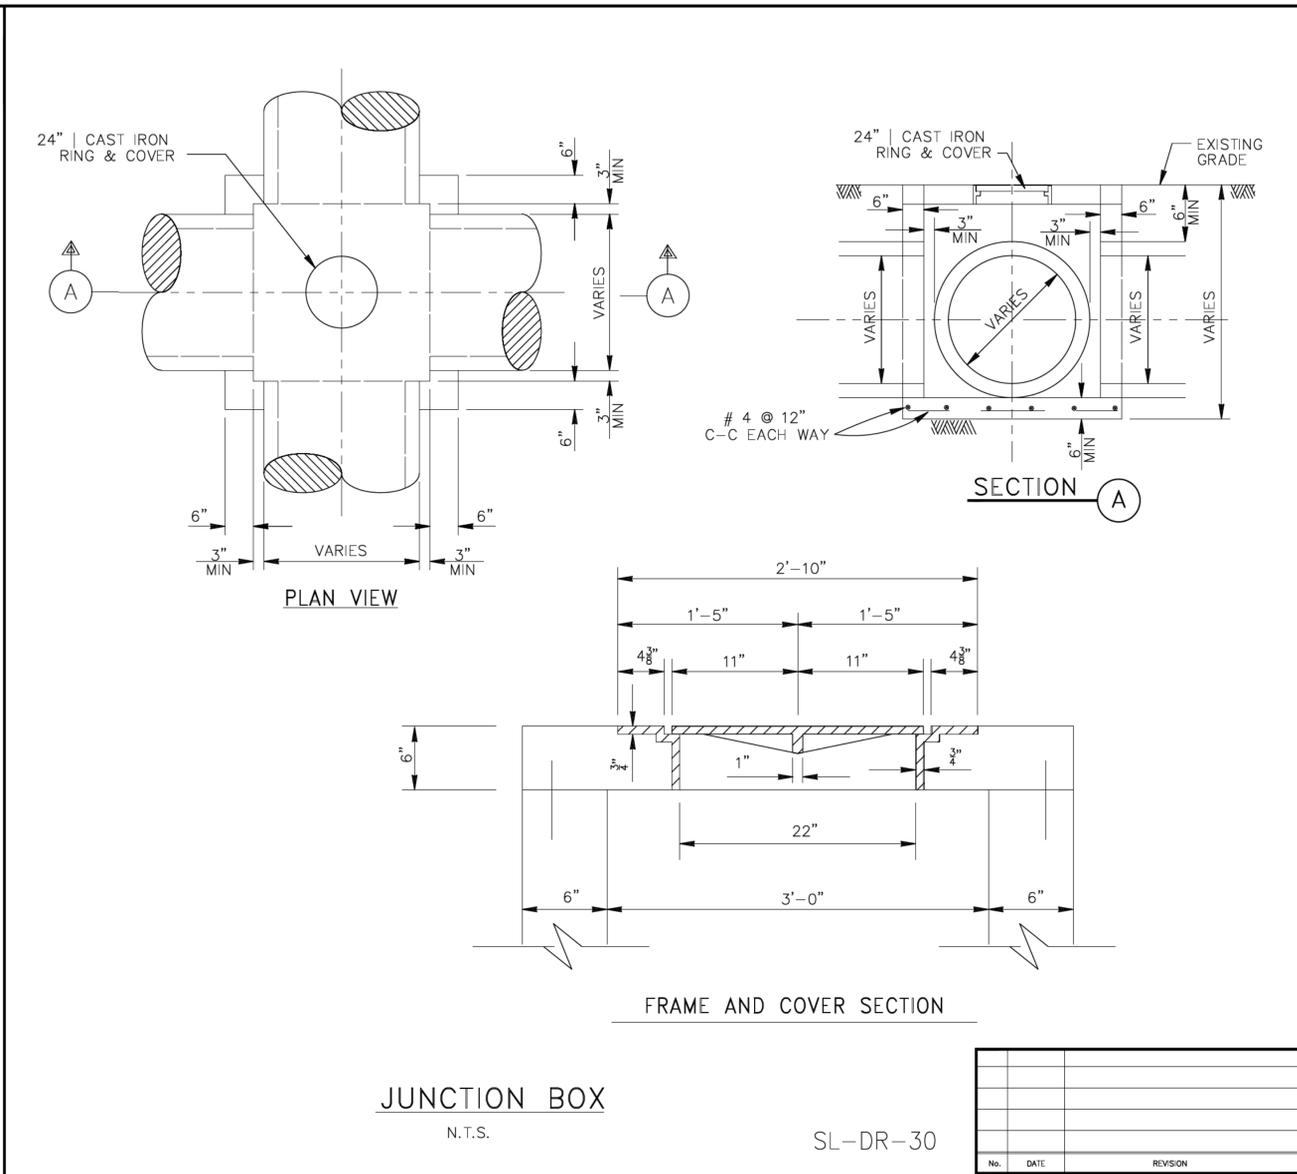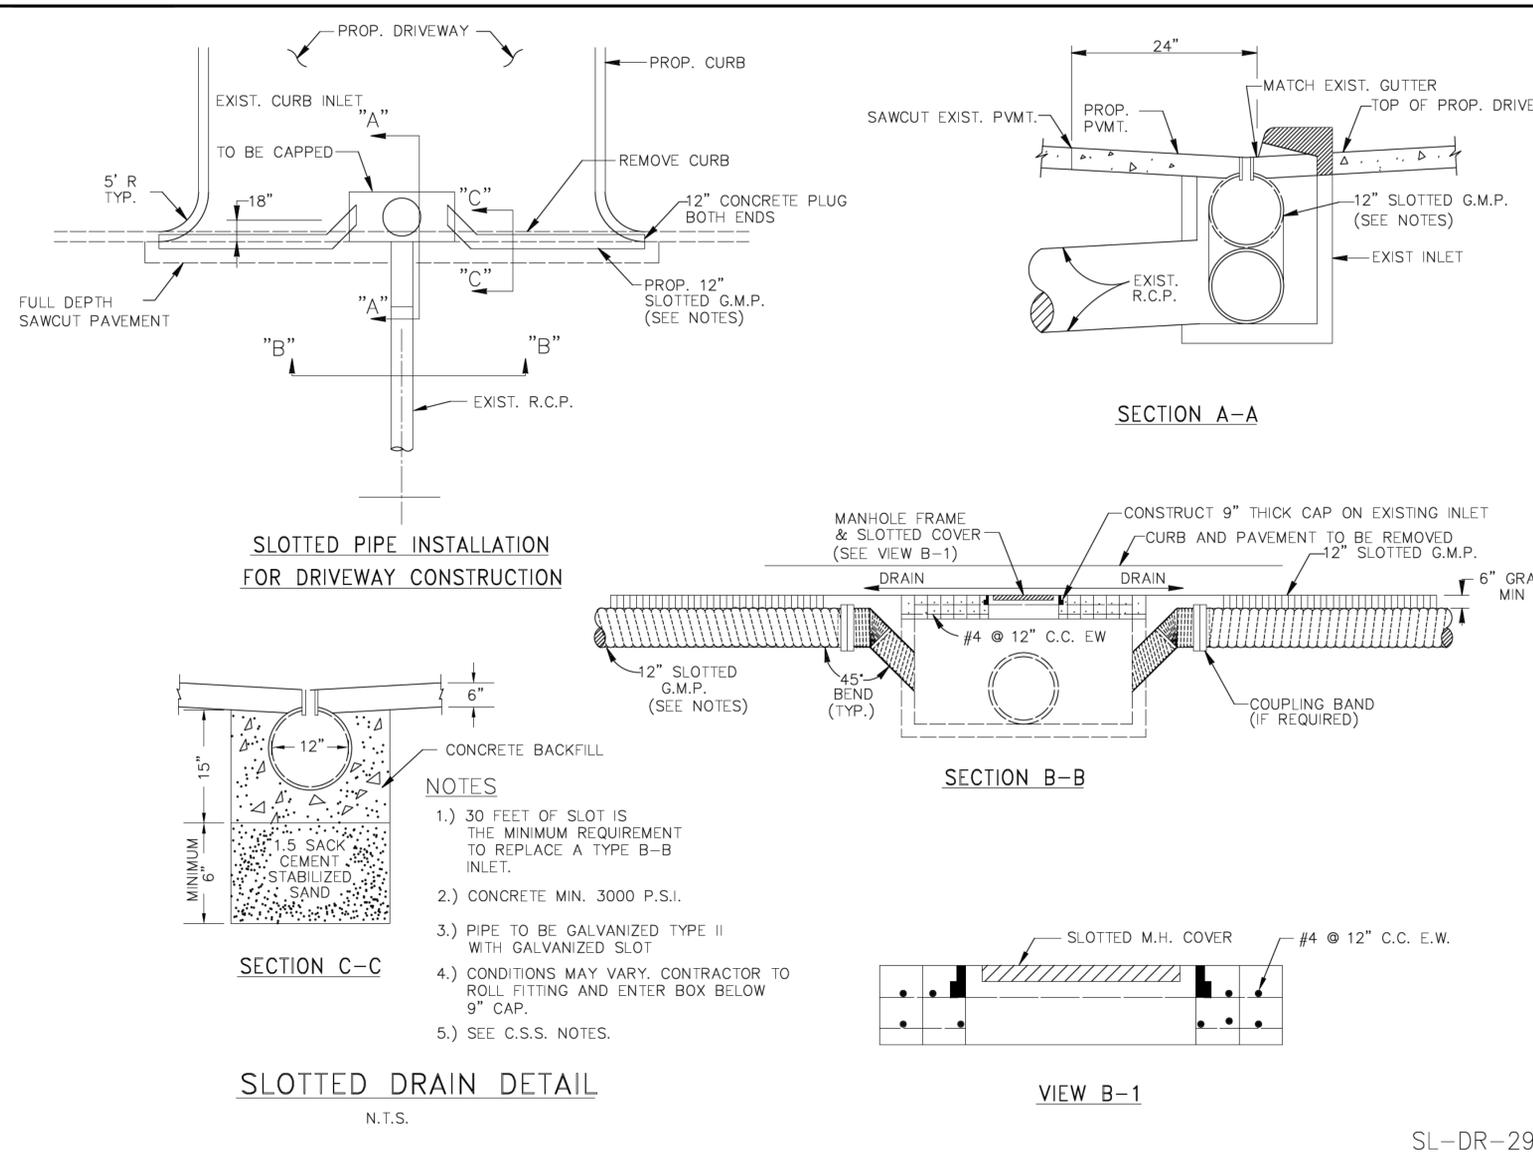

No.	DATE	REVISION

SEAL: \_\_\_\_\_

DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_

**CITY OF SUGAR LAND, TEXAS**

CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT


CONSTRUCTION PLANS FOR:

**STORM SEWER CONSTRUCTION DETAILS**


JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-10  
SHEET OF \_\_\_\_\_

REVISION DATE: OCTOBER 2021

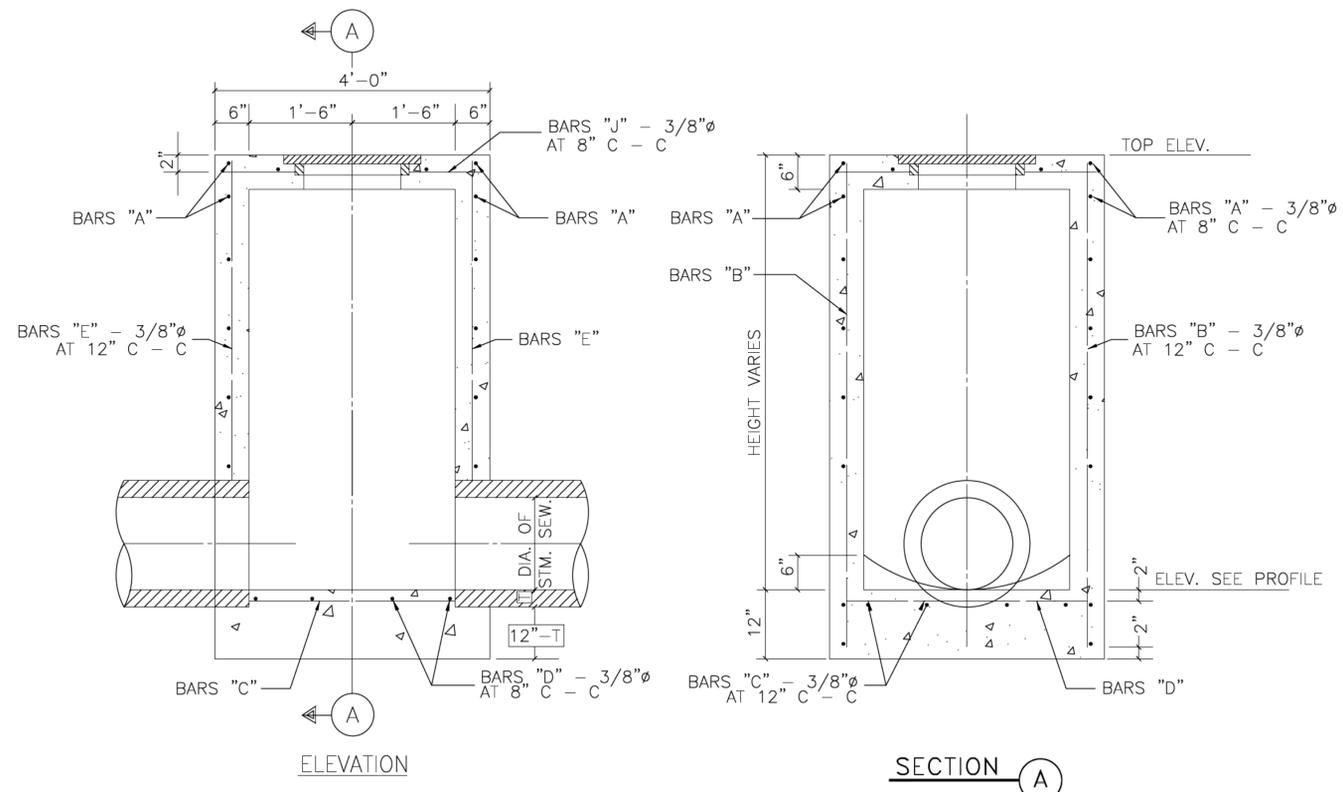

**STORM SEWER TYPE A MANHOLE**  
MAX. PIPE SIZE 30" – N.T.S.

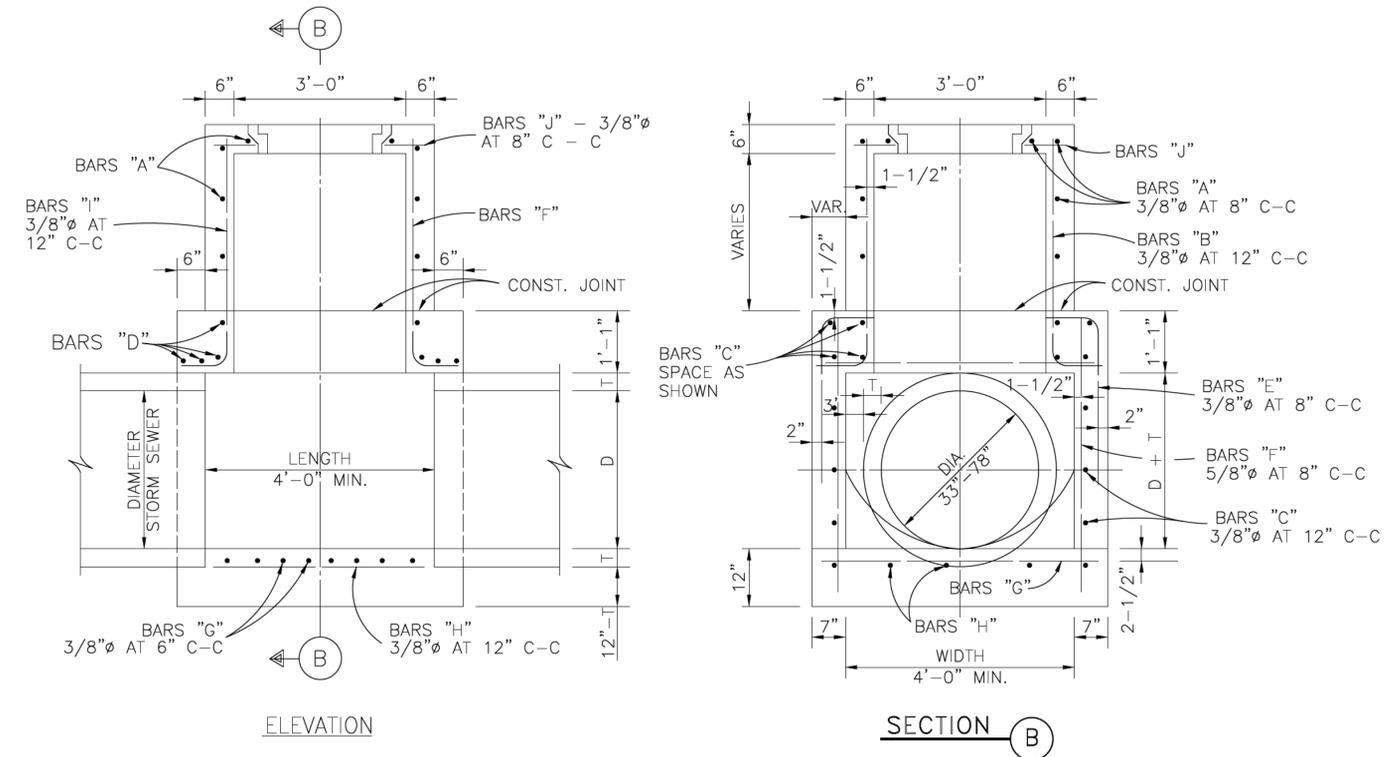


**TYPE B STORM SEWER MANHOLE**  
MAX. PIPE SIZE 78" – N.T.S.


SL-DR-41

No.	DATE	REVISION
SEAL:		
DESIGN ENGINEER: _____ DATE _____		
 CITY OF SUGAR LAND, TEXAS ENGINEERING DEPARTMENT		
CONSTRUCTION PLANS FOR:		
JUNCTION BOX MANHOLES		
JOB No.:	DESIGNED BY:	SL-11
DATE:	DRAWN BY:	
CHECKED BY:	SCALE:	
SHEET		OF

REVISION DATE: OCTOBER 2021

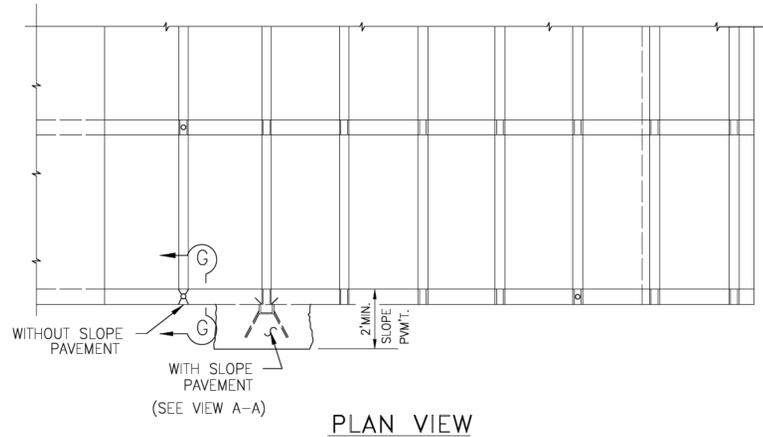

SL-DR-34

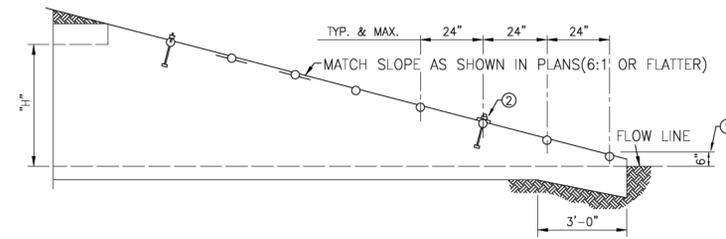


END TREATMENT  
SINGLE & MULTIPLE  
BOX CULVERTS

N.T.S.

SL-DR-36

- ① TOP OF SAFETY PIPE RUNNER (TYP.)
- ② THIRD PIPE RUNNER TO HAVE BOLTED CONNECTION FOR CLEANOUT ACCESS.

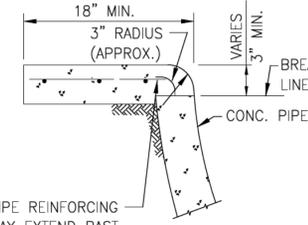

PIPE REINFORCING MAY EXTEND PAST BREAK AND BE FIELD BENT INTO SLOPE PAVEMENT


SECTION D

SL-DR-35

NOTES:

1. THESE DETAILS ARE TO BE USED AS A GUIDE FOR INSTALLATION OF SAFETY PIPE RUNNERS FOR CROSS-DRAINAGE STRUCTURES WHERE OUT OF CONTROL VEHICLES MAY TRAVERSE THE OPENING APPROXIMATELY PERPENDICULAR TO THE SAFETY PIPE RUNNER. SOME INSTALLATIONS MAY REQUIRE THE PREPARATION OF SPECIAL DETAILS. IN GENERAL, SAFETY PIPE RUNNERS ARE INSTALLED ON CROSS-DRAINAGE STRUCTURES AT MAXIMUM SPACINGS OF APPROXIMATELY 24 INCHES. SINGLE AND MULTIPLE 24" (IN.) OR SMALLER DIAMETER PIPES ARE PERMISSIBLE WITHOUT PIPE RUNNERS. SINGLE OR MULTIPLE BOX CULVERTS WITH SPANS OF 24" OR LESS ARE ALSO PERMISSIBLE WITHOUT SAFETY PIPE RUNNERS. DESIGN: SAFETY PIPE RUNNERS ARE DESIGNED FOR A TRAVERSING LOAD OF 1,800 POUNDS AT YIELD AS RECOMMENDED BY RESEARCH REPORT 280-J, SAFETY TREATMENT OF ROADSIDE CROSS-DRAINAGE STRUCTURES, TEXAS TRANSPORTATION INSTITUTE, MARCH 1981.
2. SEE STORM OUTFALL DETAILS FOR SLOPE PAVEMENT REQUIREMENTS.


DIA.	WALL	O.D.	SLOPE	PIPE LGTH	TYPE	A INCH	B INCH	C INCH	D INCH	L	LENGTH END SEC FT.
24"	3"	30"	3:1	2-6"	2	3	9	36	54	7'-6"	11.27
			4:1	2-6"	2	3	9	24	48	5'-3"	12.33
			6:1	3-6"	3	3	9	36	72	12'-2"	18.23
36"	4"	44"	3:1	2-7"	2	4	10	36	54	10'-8"	14.75
			4:1	3-6"	3	4	10	26	60	13'-0"	18.21
42"	4"	51"	3:1	2-7"	2	4	10	27	45	11'-3"	15.81
			4:1	3-7"	3	4	10	51	75	16'-5"	21.9
48"	5"	58"	3:1	3-6"	3	5	11	36	54	13'-6"	18.44
			4:1	3-7"	3	5	11	39	63	17'-3"	23.27
54"	5"	65"	3:1	3-6"	3	5	11	27	45	14'-3"	19.5
			4:1	4-6"	4	5	11	36	60	19'-0"	25.43
60"	6"	72"	3:1	5-7"	5	5	11	63	99	29'-3"	38.27
			4:1	3-7"	3	6	12	45	63	17'-3"	22.64
60"	6"	72"	4:1	4-7"	4	6	12	60	84	23'-0"	29.98
			6:1	5-7"	5	6	12	45	81	30'-9"	40.28

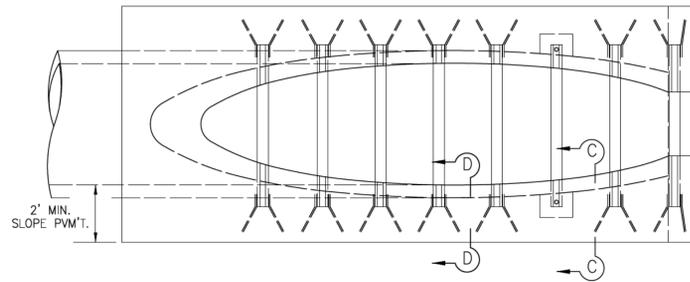

PLAN VIEW  
CONCRETE PIPE

NOTE:  
24" (IN.) TREATMENT REQUIRES NO BARS.  
36" (IN.) AND LARGER REQUIRES BARS.  
ALL BOLTED BARS ARE ACCEPTABLE


SL-DR-34

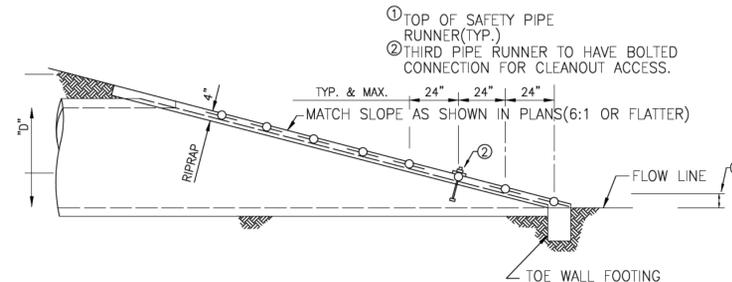

END TREATMENT  
CONCRETE PIPE

N.T.S.


SL-DR-36

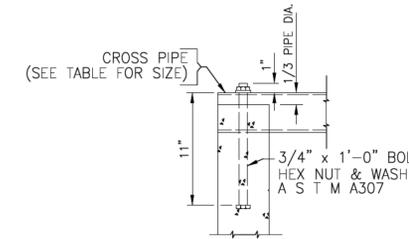

SECTION G

SL-DR-35


SL-DR-39

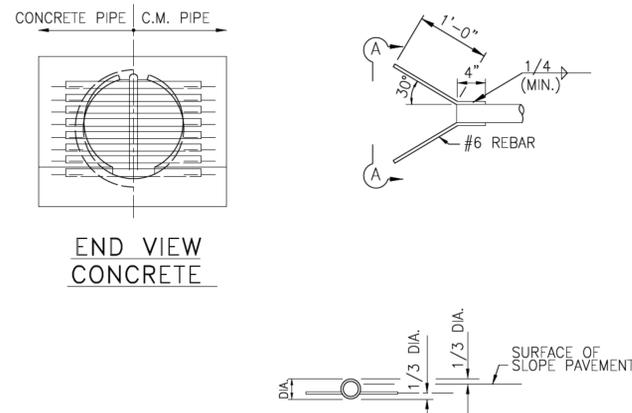

END VIEW  
CONCRETE

VIEW A-A

SL-DR-37

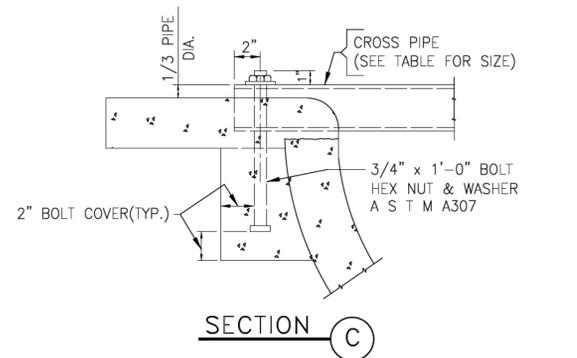

SECTION C


DEEPEN AND WIDEN SLOPE PAVEMENT AROUND END OF CROSS PIPE AND PROVIDE BOLTED CONNECTION TO ALLOW CLEANOUT ACCESS.

SL-DR-35

CULVERT SIZE	PIPE RUNNER LENGTH	REQUIRED PIPE SIZES FOR GIVEN PIPE YIELD								
		35 KS: ASTM A53, TX E & S GR. B			42 KS: ASTM A500, GR. B			52 KS: API 5LX52		
		NOM.	O.D.	I.D.	NOM.	O.D.	I.D.	NOM.	O.D.	I.D.
36"	48"	3" XXS	3.500	2.300	3" x S	3.500	2.900	3" STD.	3.500	3.068
		3 1/2" XS	4.000	3.364	3 1/2" STD.	4.000	3.548			
		4" STD.	4.500	4.026	4" STD.	4.500	4.026			
42"	54"	3" XXS	3.500	2.300	3" XXS	3.500	2.300	3" XS	3.500	2.900
		3 1/2" XS	4.000	3.364	3 1/2" XS	4.000	3.364	3 1/2" STD.	4.000	3.548
		4" STD.	4.500	4.026	4" STD.	4.500	4.026			
48"	60"	3" XXS	3.500	2.300	3" XXS	3.500	2.300	3" XXS	3.500	2.300
		4" XS	4.500	3.826	4" XS	4.000	3.364	3 1/2" STD.	4.000	3.548
54"	66"	4" XS	4.500	3.826	3" XXS	3.500	2.300	3" XXS	3.500	2.300
		5" STD.	5.563	5.047	4" STD.	4.500	4.026	3 1/2" XS	4.000	3.364
60"	72"	4" XS	4.500	3.826	4" XS	4.500	3.826	3" XXS	3.500	2.300
		5" STD.	5.563	5.047	5" STD.	5.563	5.047	3 1/2" XS	4.000	3.364

No.	DATE	REVISION

DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_

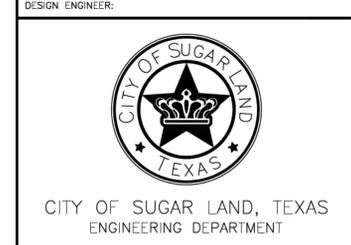

CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT


CONSTRUCTION PLANS FOR:

SLOPE END TREATMENT


JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-12

SHEET OF

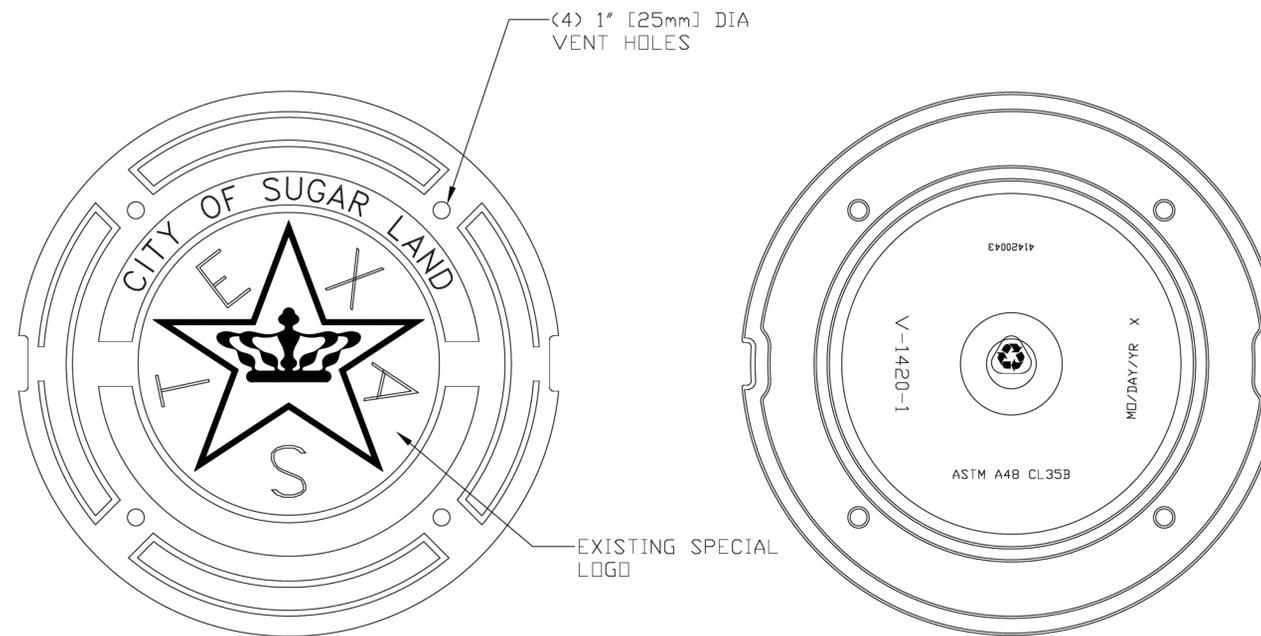

**BOTTOM VIEW OF COVER**

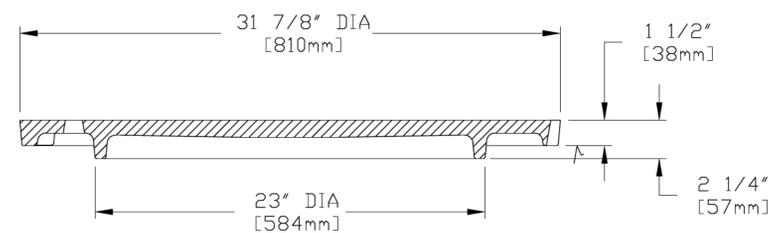

**COVER SECTION**

**32" MANHOLE COVER**  
N.T.S.

— DUCTILE IRON  
EAST JORDAN IRON WORKS OR APPROVED EQUAL

✓ MACHINED SURFACE

SL-SS-02

No.	DATE	REVISION

SEAL:

DESIGN ENGINEER: \_\_\_\_\_ DATE \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT


CONSTRUCTION PLANS FOR:

SANITARY SEWER MANHOLE  
CONSTRUCTION DETAILS

JOB No.:  
DATE:  
DESIGNED BY:  
DRAWN BY:  
CHECKED BY:  
SCALE:

SL-13


SHEET OF

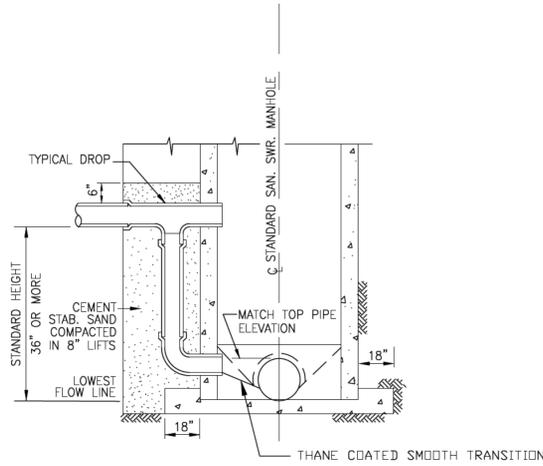

**STANDARD DROP DETAIL**

(SEE C.S.S. NOTES)

SL-SS-05

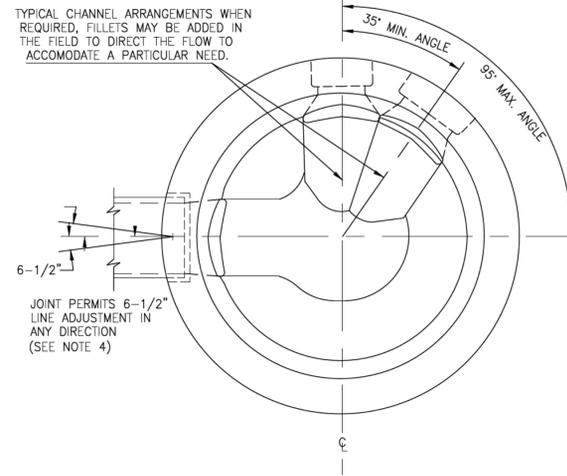

**PIPING CONNECTIONS DETAIL**

SL-SS-05A


**NOTE:**

1. INFLUENT AND EXFLUENT PIPING CONNECTIONS TO MANHOLE SHALL BE ALIGNED TO PREVENT REVERSE FLOW.
2. INFLUENT AND EXFLUENT CONNECTIONS ARE LIMITED TO A MAXIMUM 90° INCLUDED ANGLE OF CONVERGENCE.
3. MINIMUM 35° AND MAXIMUM 90° INCLUDED ANGLES MUST BE PROVIDED BETWEEN MULTIPLE INFLUENT CONNECTIONS.
4. ANGLE OF DEFLECTION AT PIPING JOINTS AS PER MANUFACTURE'S RECOMMENDATIONS.

**NOTES:**

1. CONTRACTOR SHALL CONTACT CITY OF SUGAR LAND ENGINEERING DEPARTMENT AT (281) 275-2780 IF WET SAND OR OTHER UNSTABLE SOIL CONDITIONS, HIGH WATER TABLE AND/OR UNDERGROUND OBSTRUCTIONS ARE ENCOUNTERED.
2. SHOULD A CONFLICT ARISE BETWEEN INFORMATION DEPICTED ON APPROVED CONSTRUCTION DRAWINGS AND INFORMATION INCLUDED IN PROJECT SPECIFICATIONS, CITY OF SUGAR LAND DESIGN STANDARDS SHALL GOVERN.
3. SANITARY SEWER MANHOLES SHALL BE CONSTRUCTED A MINIMUM OF FOUR FOOT FROM BACK OF CURB ON CURB AND GUTTER ROADWAYS AND THREE FEET FROM EDGE OF TRAVELLED ROADWAY ON THOSE THOROUGHFARES HAVING NO CURBING, MEASURED FROM OUTSIDE DIAMETER OF MANHOLE. SANITARY SEWER MANHOLES SHALL NOT BE INSTALLED BENEATH STREET PAVING EXCEPT WHERE SPECIFICALLY AUTHORIZED BY CITY ENGINEER AND SO DESIGNATED ON APPROVED CONSTRUCTION DRAWINGS.
4. ALL SUCH MANHOLE COVERS SHALL HAVE THE CITY OF SUGAR LAND EMBLEM AND THE WORDS "SUGAR LAND" AND "SANITARY SEWER" CAST IN RAISED RELIEF AS DEPICTED IN CITY OF SUGAR LAND STANDARD CONSTRUCTION DETAILS SHEETS. ALL SANITARY SEWER MANHOLES SHALL INCORPORATE INFLOW PROTECTORS.
5. MANHOLE RIM ELEVATIONS SHOWN ON PLANS ARE APPROXIMATE ONLY. CONTRACTORS SHALL ADJUST RIM ELEVATIONS TO 0.4 FEET ABOVE FINISHED GRADE WITHIN RIGHTS-OF-WAY AND EASEMENTS AT EACH MANHOLE LOCATION AFTER FINAL GRADING. ADJUSTMENTS TO MANHOLE RIM ELEVATIONS SHALL BE ACCOMPLISHED BY THE USE OF THROAT RINGS ONLY (MAX. OF 24 INCHES PERMITTED). THE AREA ADJACENT TO SANITARY SEWER MANHOLE LOCATIONS SHALL BE GRADED AWAY FROM SUCH MANHOLES SO AS PREVENT ENTRY OF STORM WATER RUNOFF TO THE SANITARY SEWER SYSTEM.
6. DROP CONNECTIONS ARE REQUIRED WHEN INVERT ELEVATION OF SEWER LINE TO BE CONNECTED EXCEEDS 36 INCHES DISTANCE ABOVE INVERT ELEVATION OF MANHOLE BASE. ALL DROP CONNECTIONS SHALL BE CONSTRUCTED OF SAME MATERIALS AS SEWER AND SHALL BE CONSTRUCTED EXTERIOR TO MANHOLE. INSIDE DROP ALLOWED ON MANHOLES 12-FT & DEEPER. PIPE CONNECTIONS TO MANHOLES SHALL BE SO CONSTRUCTED AS TO BE WATERTIGHT AND TO ALIGN UPPER INSIDE PIPE WALL ELEVATIONS OF ALL PIPING CONNECTED TO BASE OF MANHOLE UNIFORMLY, REGARDLESS OF PIPE DIAMETERS. DROP ASSEMBLIES SHALL BE BEDDED IN CEMENT STABILIZED SAND. CEMENT STABILIZED SAND SHALL EXTEND A MINIMUM OF SIX INCHES PAST PIPING LATERALLY FROM BASE OF MANHOLE UPWARD TO A POINT SIX INCHES (MINIMUM) ABOVE THE HORIZONTAL SEWER PIPING WHERE CONNECTED TO THE MANHOLE ABOVE THE VERTICAL DROP.
7. CONNECTIONS TO EXISTING AND/OR NEW SANITARY SEWER MANHOLES CONSTRUCTED OF PRECAST CONCRETE NOT HAVING PRECORED HOLES OF CORRECT DIAMETER, LOCATION AND FIELD CORING ONLY SHALL ACCOMPLISH INVERT ELEVATION. IN NO INSTANCE WILL EITHER MANUAL OR PNEUMATIC CHISELS AND/OR HAMMER DRILLS BE UTILIZED TO BREAK HOLES IN PRECAST CONCRETE MANHOLES, PIPE SEGMENTS OR OTHER PRECAST STRUCTURES SUCH AS LIFT STATIONS.
8. BEDDING AND BACKFILL OF SANITARY SEWER PIPING AND MANHOLES SHALL BE ACCOMPLISHED IN ACCORDANCE WITH CITY OF SUGAR LAND DESIGN STANDARDS. A 1.5-SACK MIX IS REQUIRED FOR ALL CEMENT STABILIZED SAND BEDDING AND SUCH BEDDING SHALL BE INSTALLED IN LIFTS OF EIGHT INCHES MAXIMUM.
9. SOLVENT WELDED JOINTS ARE NOT AN ACCEPTABLE JOINING METHOD FOR SANITARY SEWERS CONSTRUCTED OF PVC PIPING MATERIALS AND LOCATED WITHIN RIGHTS-OF-WAY OR EASEMENTS. RUBBER GASKETED BELL AND SPIGOT SANITARY SEWER JOINTS ARE MANDATORY. BELL (FEMALE) ENDS OF PIPE SHALL BE INSTALLED ON UPSTREAM SIDE WITH SPIGOT (MALE) ENDS ORIENTED DOWNSTREAM.
10. SANITARY SEWER SERVICE LEADS SHALL BE EXTENDED TO RIGHTS-OF-WAY AND/OR EASEMENT LINES AS APPLICABLE AND CAPPED/PLUGGED FOR FUTURE CONNECTIONS. SERVICE LEADS ARE TO BE INSTALLED SO AS TO PASS UNDER POTABLE WATER PIPING AT CROSSINGS WHERE POSSIBLE.
11. EACH SANITARY SEWER SERVICE LEAD STUB, PLUGGED WYE BRANCH OUTLET AND STACK SHALL BE MARKED WITH A PRESSURE TREATED 4 X 4 TIMBER AT THE TIME OF CONSTRUCTION, BEGINNING AT THE INVERT ELEVATION OF THE STUB OR WYE AND AT AN ELEVATION TWO FEET BELOW THE CAPPED TERMINATION POINT OF THE STACK AND EXTENDING TWO FEET ABOVE FINISHED GRADE. EACH TIMBER MARKER SHALL BE PAINTED RED AND LABELED "SANITARY SEWER STUB", "SANITARY SEWER WYE" OR "SANITARY SEWER STACK" AS APPROPRIATE WITH STUB, WYE BRANCH OUTLET OR STACK SIZE NOTED.
12. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING LOCATION OF ALL EXISTING UTILITIES PRIOR TO EXCAVATION. DURING THE COURSE OF ANY AND ALL CLEARING, GRUBBING, FILL, GRADING, EXCAVATION OR OTHER CONSTRUCTION, CONTRACTOR SHALL ENSURE THAT STORM DRAINAGE PATHWAYS ARE MAINTAINED AND REMAIN OPEN TO ENSURE POSITIVE DRAINAGE AND THAT SUCH CONVEYANCES ARE NOT IMPEDED OR BLOCKED IN ANY WAY. STORM SEWER INLETS SHALL BE PROTECTED FROM ENTRY OF SILT, TRASH, DEBRIS AND ANY SUBSTANCES DELETERIOUS TO THE STORM SEWER SYSTEM AND/OR WATERWAYS RECEIVING STORM WATER RUNOFF. CONTRACTOR SHALL AT COMPLETION OF WORK, FILL LOW SPOTS AND GRADE ALL RIGHTS-OF-WAY AND UTILITY EASEMENTS AND REGRADE/RESTORE DITCHES AS NECESSARY TO MAINTAIN AND/OR ESTABLISH POSITIVE DRAINAGE.
13. ALL SANITARY SEWER PIPING AND BEDDING SHALL BE INSPECTED BY CITY CONSTRUCTION INSPECTOR FOR CONFORMANCE WITH CITY INFRASTRUCTURE STANDARDS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROPERLY NOTIFY THE CITY OF ALL CONSTRUCTION ACTIVITIES AND TO CONFORM TO CITY OF SUGAR LAND PUBLIC WORKS DEPARTMENT INSPECTION POLICY.
14. C.S.S. 1' ABOVE PIPE AND 6" BELOW PIPE MINIMUM.
15. SEE GENERAL NOTES AND C.S.S. NOTES.
16. CAST IN PLACE MANHOLES ACCEPTED, 4500 PSI CONCRETE.

SL-SS-07

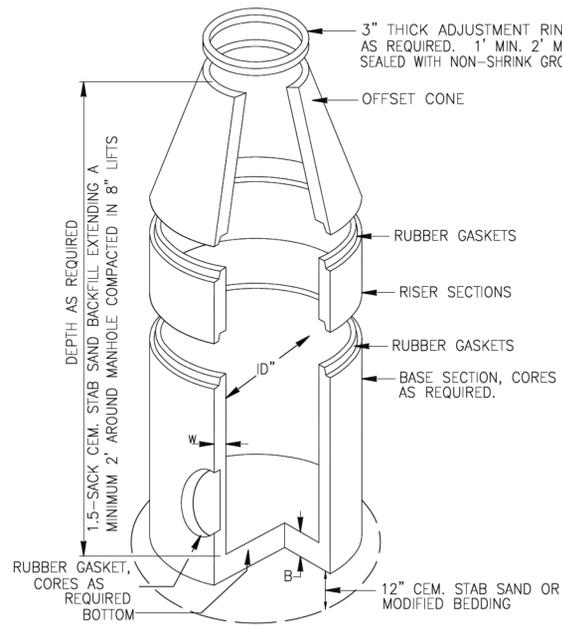

**SPECIFICATIONS:**

- CONCRETE: CLASS 1 CONCRETE WITH A DESIGN STRENGTH OF 4500 PSI AT 28 DAYS. RATES FOR HL93 LOADING.
- REINFORCEMENT: STRUCTURAL REINFORCEMENT CONFORMING TO ASTM-C-478.
- C.I. CASTINGS: CAST IRON FRAMES AND LIDS ARE MANUFACTURED OF GREY CAST IRON CONFORMING TO ASTM A48-76 CLASS 35.


**NOTES**

1. LIFTING INSERTS AS REQUIRED.
2. ALL JOINTS SHALL BE SEALED WITH APPROVED RUBBER GASKET
3. STRUCTURE TO BE PLACED ON 12" STABILIZED BASE.
4. C.S.S. SHALL BE BROUGHT TO WITHIN 2-FT OF TOP OF MANHOLE.
5. PRE-CAST MANHOLE SHALL BE IN COMPLIANCE APPROVED PRODUCT LIST.
6. THANE COAT SHALL BE IN COMPLIANCE WITH APPROVED PRODUCT LIST.
7. INVERTS SHALL COMPLY WITH C.O.S.L., DESIGN MANUAL SPECIFICATIONS.
8. INFLOW PROTECTORS REQUIRED ON ALL SANITARY MANHOLES.
9. REFER TO SANITARY MANHOLE LIDS, C.S.S. NOTES, MODIFIED BEDDING DETAILS AND NOTES.

**PRECAST SANITARY MANHOLE**

N.T.S.

SL-SS-03

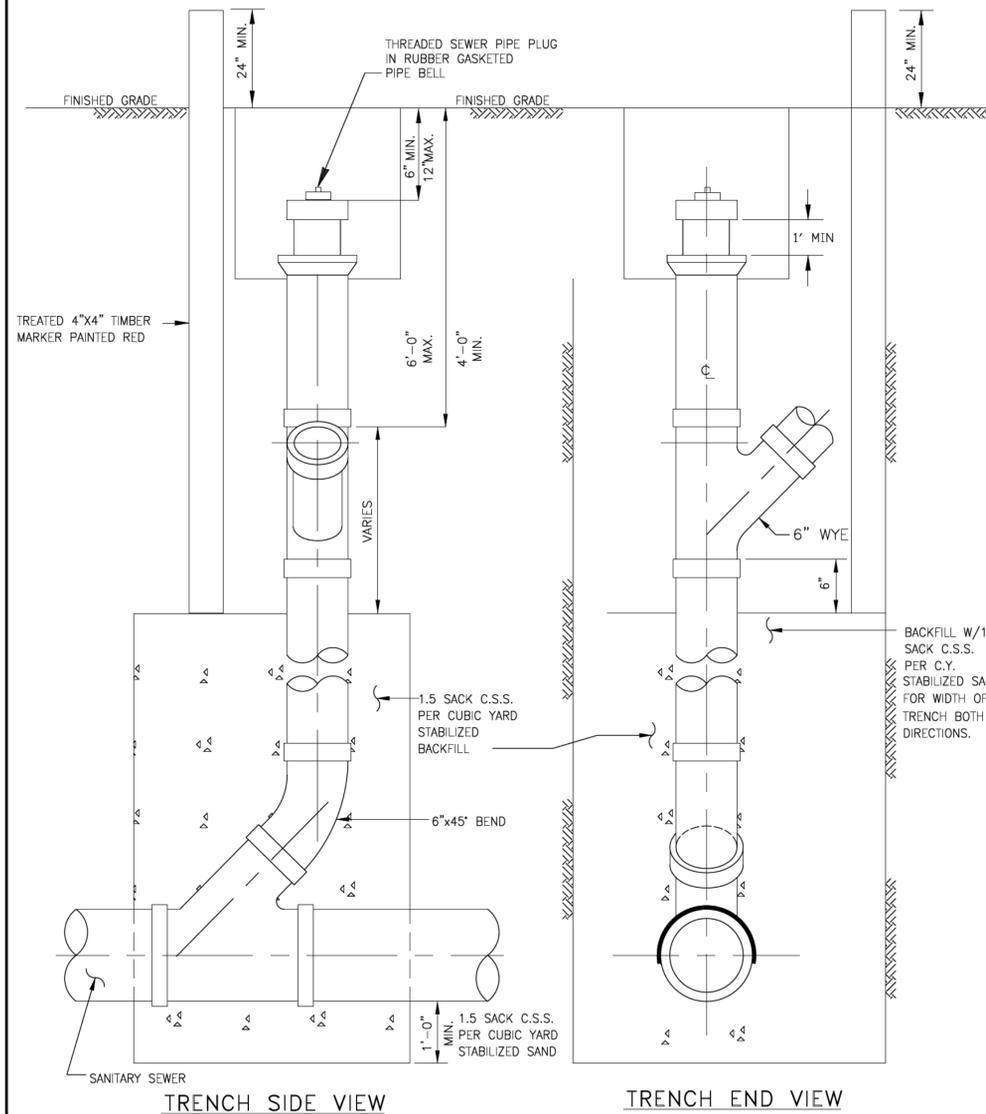


**STACK DETAIL**

N.T.S.

SL-SS-04

**NOTES:**

- A.) NO STACKS ON MAINS OVER 16' DEEP OR IN WET SAND CONDITIONS.
- B.) ALL STACK CONNECTIONS SHALL BE IN-LINE FITTINGS.

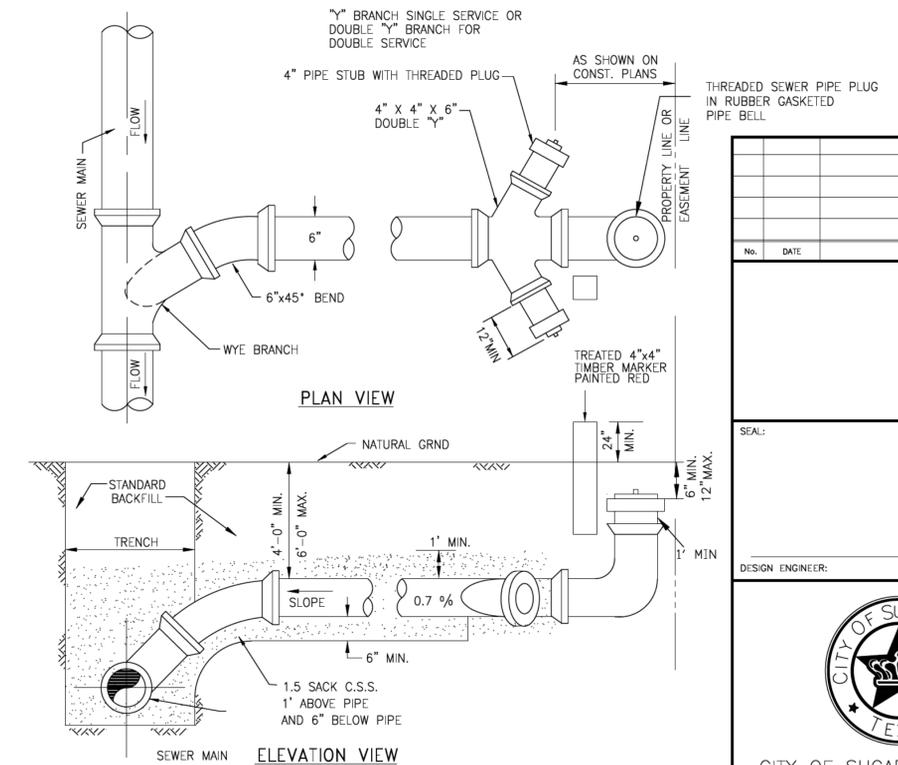

**SANITARY SEWER SERVICE CONNECTION**

N.T.S.

SL-SS-06

No.	DATE	REVISION

SEAL: \_\_\_\_\_ DATE \_\_\_\_\_  
DESIGN ENGINEER: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:

SANITARY SEWER  
CONSTRUCTION DETAILS


JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-14

SHEET OF




NEW POTABLE WATERLINE CROSSING NEW PRESSURE RATED WASTEWATER LINE WITH SEGMENT LENGTHS OF EIGHTEEN (18) FEET OR GREATER, HAVING 6 INCHES OF VERTICAL CLEARANCE AND 4 FEET OF HORIZONTAL CLEARANCE

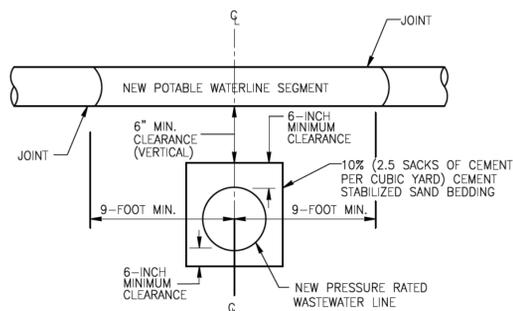

- WHENEVER POSSIBLE, THE CROSSING SHALL BE CENTERED BETWEEN JOINTS OF THE WASTEWATER LINE.
- MINIMUM WASTEWATER PIPE STIFFNESS OF 115 PSI AT 5% DEFLECTION.
- EMBED WASTEWATER LINE IN CEMENT STABILIZED SAND TO AT LEAST 12" INCHES BEYOND EACH JOINT OF CROSSED SECTION OF PIPE.


SL-WA-10

NEW POTABLE WATERLINE CROSSING NEW PRESSURE RATED WASTEWATER LINE

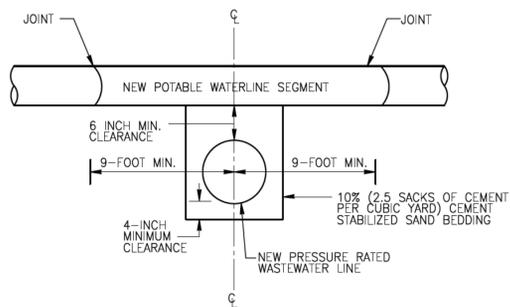

- WHENEVER POSSIBLE, THE CROSSING SHALL BE CENTERED BETWEEN JOINTS OF THE WASTEWATER LINE.
- MINIMUM WASTEWATER PIPE STIFFNESS OF 115 PSI AT 5% DEFLECTION.
- EMBED WASTEWATER LINE IN CEMENT STABILIZED SAND TO AT LEAST 12" INCHES BEYOND EACH JOINT OF CROSSED SECTION OF PIPE.

SL-WA-11

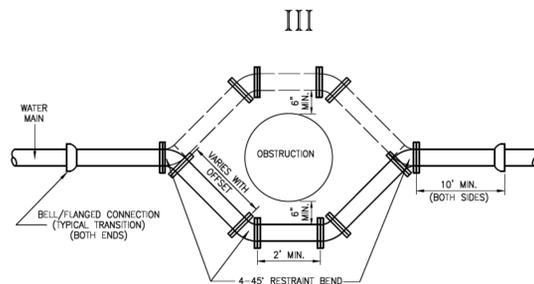

FOR A LINE TO PASS OVER AN OBSTRUCTION RATHER THAN UNDER, IT MUST HAVE ADEQUATE COVER AND BE APPROVED BY THE ENGINEERING DEPARTMENT.


- NOTES:
1. PIPE MATERIAL SHALL BE AWWA C900 PVC, DR-14, 200 PSI WITH INTEGRAL PVC RESTRAINED JOINTS.
  2. OFFSET ASSEMBLY MUST PASS OVER THE OBSTRUCTION AS LONG AS THE MINIMUM CLEARANCE IS MAINTAINED. SPECIFIC APPROVAL FROM THE UTILITIES DEPARTMENT MUST BE GRANTED FOR THE OFFSET TO PASS UNDER THE OBSTRUCTION.
  3. MATERIAL AND COATINGS SHALL BE IN ACCORDANCE WITH WATER MAIN STANDARD SPECIFICATIONS.
  4. RESTRAIN EXISTING PIPING BEYOND OFFSET SECTION AS REQUIRED TO PREVENT MOVEMENT.
  5. ALL PVC PRODUCTS MUST BE LISTED ON CITY OF SUGAR LAND'S APPROVED PRODUCTS LIST.

MIN. PIPE WALL THICKNESS	
4"	- 0.250"
6"	- 0.280"
8"	- 0.322"
12"	- 0.375"
AND LARGER	

PVC WATER PIPE  
OFFSET ASSEMBLY

SL-WA-12

DETAIL OF WATER LINE CROSSING WASTEWATER FACILITIES WHERE SEPARATION IS LESS THAN 9' (NINE FEET)





ENCASING PIPE

- 150 PSI PRESSURE CLASS PIPE MINIMUM 18 FEET LONG DIAMETER = 2 X WATERLINE DIAMETER
- SPACE AROUND CARRIER PIPE SHALL BE SUPPORTED AT FIVE (5) FOOT (OR LESS INTERVALS WITH SPACERS)
- CENTERED ON CROSSING
- BOTH ENDS SEALED WITH CEMENT GROUT OR A MANUFACTURED WATER TIGHT SEAL.

MANHOLE CLEARANCE

SL-WA-13

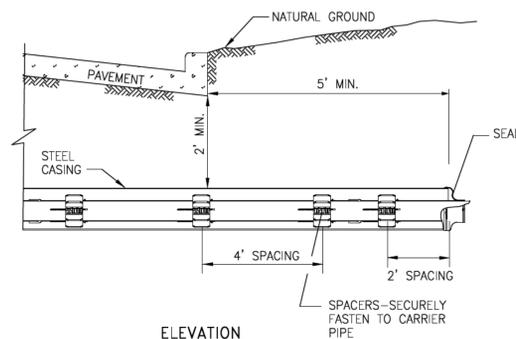

CASING SCHEDULE		
CARRIER PIPE	NOMINAL CASING	MIN. WALL THICKNESS (IN.)
6"	12"	0.11
8"	14"	0.15
10"	16"	0.18
12"	18"	0.20


1. CASING SIZE AND THICKNESS SHALL CONFORM TO THE MINIMUM REQUIREMENTS AS SHOWN ON CASING SCHEDULE, OTHER PERMITS AS REQUIRED.
2. MAINTAIN 1/2" MINIMUM CLEARANCE BETWEEN THE MAXIMUM OUTSIDE DIAMETER OF CARRIER PIPE AND CASING AT ALL LOCATIONS.
3. DIMENSIONS ARE APPROXIMATE ONLY. CONTRACTOR SHALL INSTALL ADEQUATELY SIZED CASING TO ACCOMMODATE THE CARRIER PIPE.
4. RESTRAINED JOINT PIPING IS REQUIRED WHEN USED IN CASING.

SL-WA-14

IV

ENCASED WASTEWATER LINE

NEW POTABLE WATERLINE CROSSING NEW PRESSURE RATED WASTEWATER LINE WITH SEGMENT LENGTHS OF OF LESS THAN EIGHTEEN (18) FEET

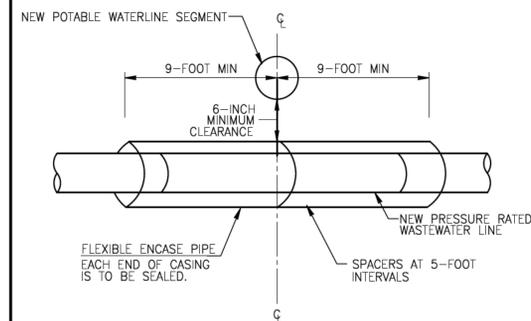

- MINIMUM CASING PIPE STIFFNESS OF 115 PSI AT 5% DEFLECTION.
- MINIMUM CASING PIPE DIAMETER \* 2 X WASTEWATER LINE DIAMETER.
- THE SPACE AROUND THE CARRIER PIPE SHALL BE SUPPORTED AT FIVE (5) FOOT (OR LESS) INTERVALS WITH SPACERS
- EACH END CASING IS TO BE SEALED WITH WATER TIGHT NO-SHRINK GROUT OR MANUFACTURED WATER TIGHT SEAL.

SL-WA-18

SL-WA-19

No.	DATE	REVISION

DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:

WATER LINE  
CROSSING DETAILS

JOB No.:  
DATE:  
DESIGNED BY:  
DRAWN BY:  
CHECKED BY:  
SCALE:


SL-16

SHEET OF


SL-WA-15

SL-WA-16

SL-WA-17

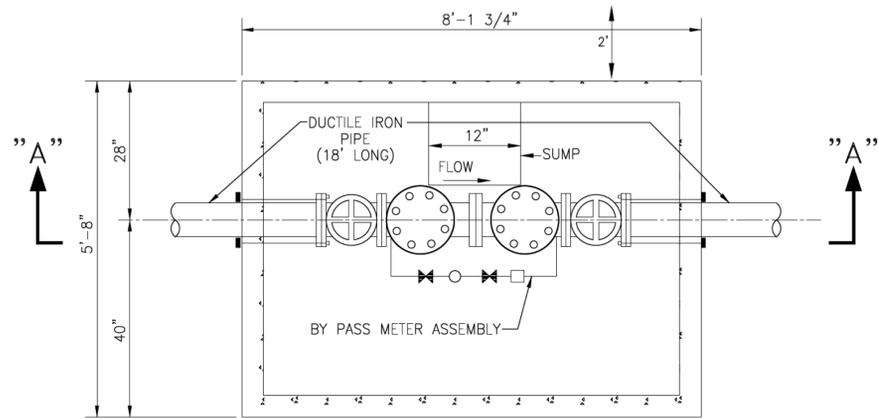

PLAN VIEW

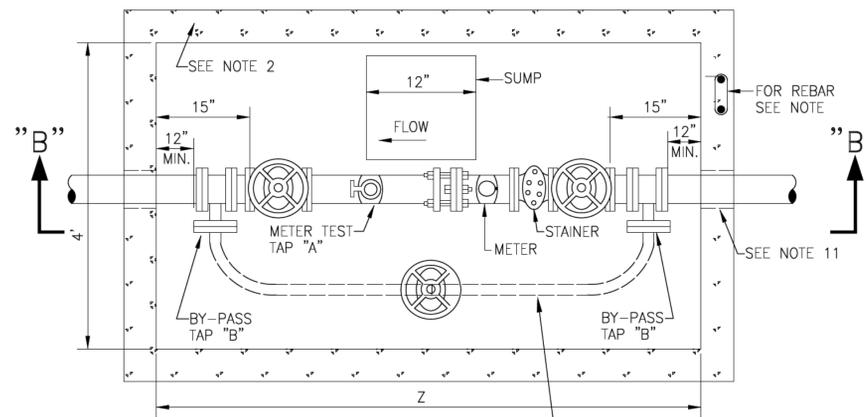


PLAN VIEW


DUCTILE IRON BYPASS FOR 3" AND ABOVE

NOTES:

1. NOTIFY THE ENGINEERING DEPARTMENT AT (281) 275-2780 PRIOR TO CONSTRUCTION OF VAULT OR BY-PASS ASSEMBLY.
2. THE METER VAULT CAN BE EITHER POURED IN PLACE OR PREFABRICATED. CONCRETE SHALL BE SIX INCHES (6") THICK AND BE 3,000 PSI WITH #4 REINFORCEMENT STEEL ON TWELVE INCH (12") CENTERS EACH WAY IF THE VAULT IS POURED IN PLACE. PREFABRICATED VAULTS SHALL BE FOUR INCHES (4") THICK AND BE 4,500 PSI CONCRETE WITH #4 REINFORCEMENT STEEL ON EIGHT INCH (8") CENTERS EACH WAY. THESE ARE MINIMAL SPECIFICATIONS.
3. THE VAULT WILL NOT BE LOCATED IN ANY DRIVE OR PARKING AREAS AND MUST BE LOCATED IN A WATER METER EASEMENT.
4. THE VAULT LID SHALL BE A BILCO LID, TYPE Q-4 SINGLE LEAF DESIGN. ANGLE FRAME IS 1/4-INCH STEEL WITH STRAP ANCHORS BOLTED TO THE EXTERIOR. THE LEAF IS 1/4-INCH STEEL DIAMOND PATTERN PLATE, PIVOTING ON TORSION BARS FOR EASY OPERATION. THE MINIMUM LIVE LOAD CAPACITY IS 150 POUNDS PER SQUARE FOOT. THE SIZE OF THE DOOR IS THREE FEET (3') BY THREE FEET (3').
5. THE LID SHALL BE PAINTED WITH 43-38 TNEMEC DIFFUSED ALUMINUM PAINT OR APPROVED EQUAL, AND CENTERED OVER METER/NO.
6. THE BY-PASS AND METER TEST TAP SHALL BE INSTALLED INSIDE THE VAULT. TAP "A" MUST BE AT LEAST TWO (2) PIPE DIAMETERS DOWNSTREAM OF THE METER. TAPS "B" AND "C" MUST BE MADE AT APPROXIMATE FORTY-FIVE DEGREE (45°) ANGLE ON EACH END OF THE PIPE AND CENTERED TEN INCHES (10") AWAY FROM THE WALL. ALL TAPS SHALL BE TWO INCHES (2") AND SHALL BE HARD PIPED.
7. THE STRAINER, METER AND FLEXIBLE COUPLING WILL NOT BE SET UNTIL THE METER VAULT AND TAPS ARE ACCEPTED BY THE DISTRICT OPERATOR. ALL UTILITIES MUST ALSO HAVE BEEN ACCEPTED AND RELEASED BY THE CITY OF SUGAR LAND PUBLIC WORKS DEPARTMENT PRIOR TO METER.
8. THE VALVES SHALL BE ANY RESILIENT WEDGE DESIGN GATE VALVE WHICH HAS RECEIVED FORMAL APPROVAL FROM THE CITY OF SUGAR LAND ENGINEERING DEPARTMENT. ALL VALVES SHALL BE FLANGED BOTH ENDS AND HAVE HAND WHEELS.
9. THE METER VAULT SHALL BE SET ON 12" C.S.S. BEDDING AS SHOWN ON DETAIL DRAWINGS. A SUMP FOUR-INCHES (4") DEEP AND TWELVE INCHES (12") IN DIAMETER SHALL BE INSTALLED TO ONE SIDE IN THE CENTER OF THE BOTTOM SLAB. IF PRECAST VAULT IS USED, RAM-NEK SHALL BE USED TO SEAL ALL COLD JOINTS.
10. ALL THE WALL PENETRATIONS SHALL BE MADE WITH A CAST IN PLACE WALL SLEEVE AS APPROVED BY THE CITY OF SUGAR LAND ENGINEERING DEPARTMENT. BREAKING OUT THE WALL USING A JACKHAMMER OR USING KNOCKOUT PANELS WILL NOT BE ALLOWED.
11. A CONCRETE SUPPORT WILL BE INSTALLED UNDER EACH VALVE.
12. DEPTH OF VAULT SHALL BE A MINIMUM OF 4-1/2' AND A MAXIMUM OF 6'
13. ALL PIPING INSIDE THE VAULT SHALL BE DUCTILE IRON WITH FLANGE FITTINGS. ALL PIPING SHALL CONFORM TO THE REQUIREMENTS OF THE CITY OF SUGAR LAND ENGINEERING DEPARTMENT
14. THE TYPE OF METER, TURBINE OR COMPOUND, WILL BE DETERMINED BASED ON THE APPLICATION AND APPROVED BY THE ENGINEERING DEPARTMENT.

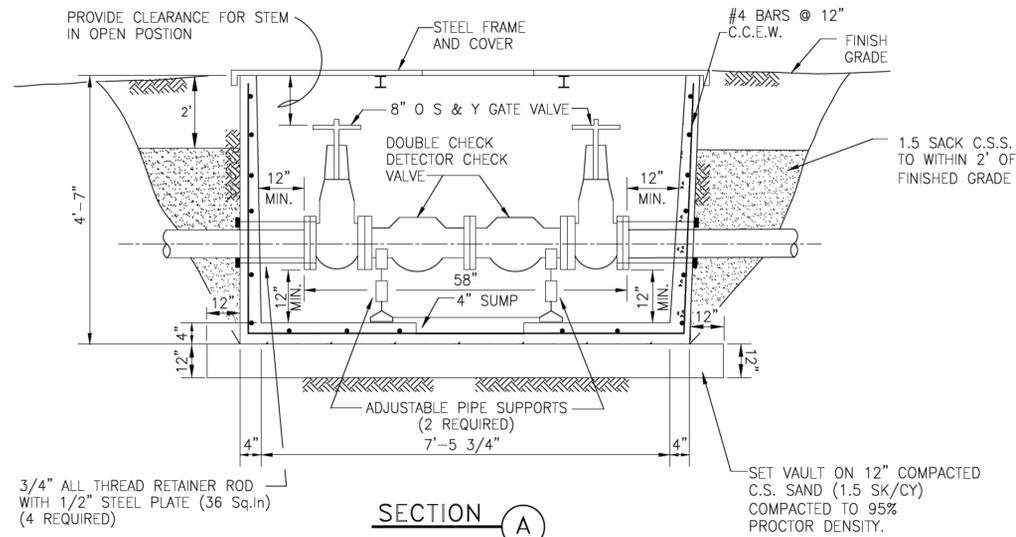

SECTION A

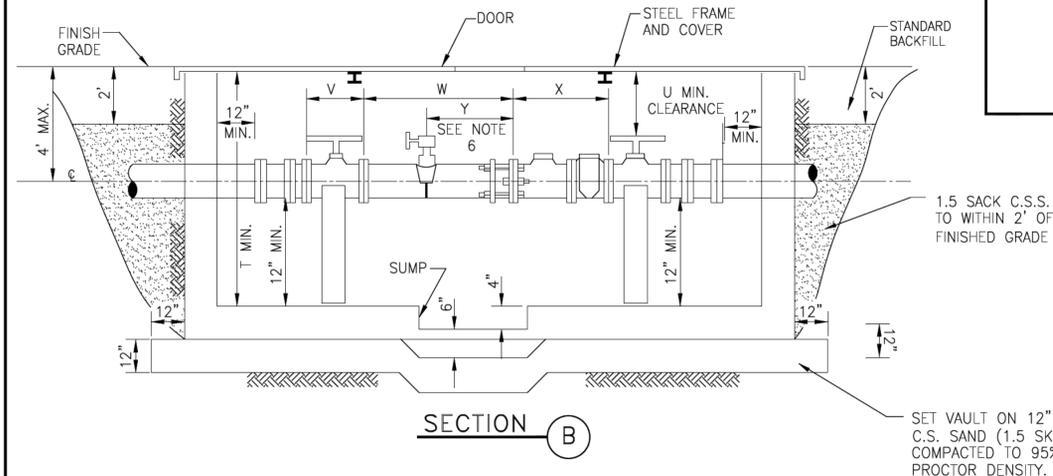

SECTION B

3/4" ALL THREAD RETAINER ROD WITH 1/2" STEEL PLATE (36 Sq.in) (4 REQUIRED)

SET VAULT ON 12" COMPACTED C.S. SAND (1.5 SK/CY) COMPACTED TO 95% PROCTOR DENSITY.

SET VAULT ON 12" INCHES C.S. SAND (1.5 SK/CY) COMPACTED TO 95% PROCTOR DENSITY.

- NOTES:
1. SIAMESE CONNECTION MAY BE ALLOWED WITHIN THE VAULT WHEN APPROVED BY THE ENGINEERING DEPARTMENT.
  2. FIRE VALVE MAY BE SUBSTITUTED FOR GATE VALVE ON THE CUSTOMER SIDE. SUPPLIED BY PARK EQUIPMENT COMPANY, OR APPROVED EQUAL.

DETECTOR CHECK VALVE

N.T.S.

SL-WA-20

METER VAULT															
DOMESTIC															
METER SIZE	T	U	V	W	X	Y	Z	METER SIZE	T	U	V	Z			
3"	4'-6"	25"	8"	11-1/2"	24"	9"	6'-10"	3"	4'-6"	25"	8"	16-1/2"	19"	9"	6'-10"
4"	4'-6"	22"	9"	13-1/2"	29"	10"	7'-7"	4"	4'-6"	22"	9"	19-1/2"	23"	10"	7'-7"
6"	5'-2"	26"	10-1/2"	13-1/2"	33"	13"	8'-2"	6"	5'-2"	26"	10-1/2"	19-1/2"	27"	13"	8'-2"
8"	6'-0"	31"	11-1/2"					8"	6'-0"	31"	11-1/2"	25-1/2"	30"	17"	9'-1"
10"	7'-0"	37"	13"					10"	7'-0"	37"	13"	29-1/2"	41"	21"	10'-7"

3" TO 10" METER

N.T.S.

SL-WA-21

SL-WA-22

No.	DATE	REVISION

No.	DATE	REVISION

DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:


WATER LINE  
METER VAULT DETAILS

JOB No.: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-17

SL-WA-19

SHEET OF

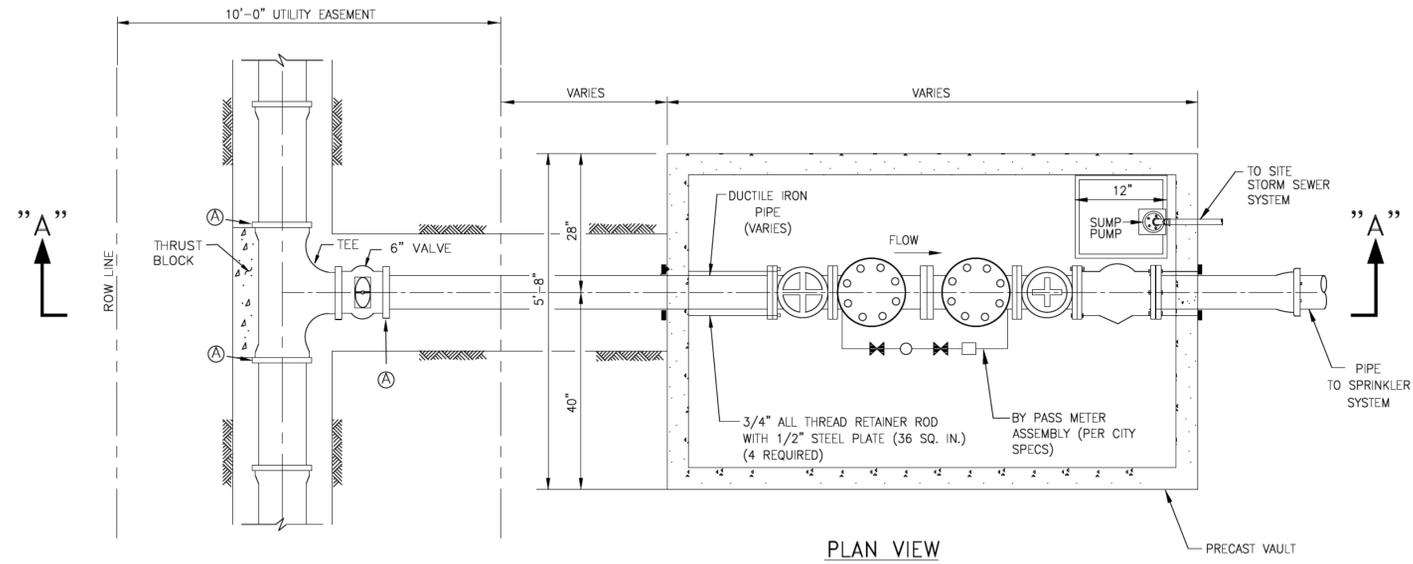


TYPICAL FIRE SERVICE METER Ⓐ = RESTRAINED JOINT

NOTES:

1. FIRE HYDRANT REQUIRED WITHIN 50' LINEAR FEET OF THE FIRE DEPARTMENT CONNECTION.
2. FIRE VALVE MAY BE SUBSTITUTED FOR GATE VALVE ON THE CUSTOMER SIDE. SUPPLIED BY PARK EQUIPMENT COMPANY, OR APPROVED EQUAL.
3. ALL FIRE LINE VAULTS SHALL BE EQUIPPED WITH A SUMP PUMP CAPABLE OF MAINTAINING WATER LEVELS BELOW THE CENTER LINE OF THE CHECK VALVES. OUTLET SHALL BE CONNECTED TO SITE STORM SEWER SYSTEM.
4. SUMP PUMP MAY BE ELIMINATED IF BOX CAN BE DRAINED VIA GRAVITY TO SITE STORM SEWER SYSTEM.
5. ALL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 13 "STANDARDS FOR THE INSTALLATION OF SPRINKLER SYSTEMS".
6. REFER TO GENERAL NOTES, WATER LINE AND STORM SEWER NOTES.
7. ALL FITTINGS AND PIPE JOINTS WITHIN 10' OF A FITTING SHALL HAVE RESTRAINT JOINTS

SL-WA-23


SL-WA-23A

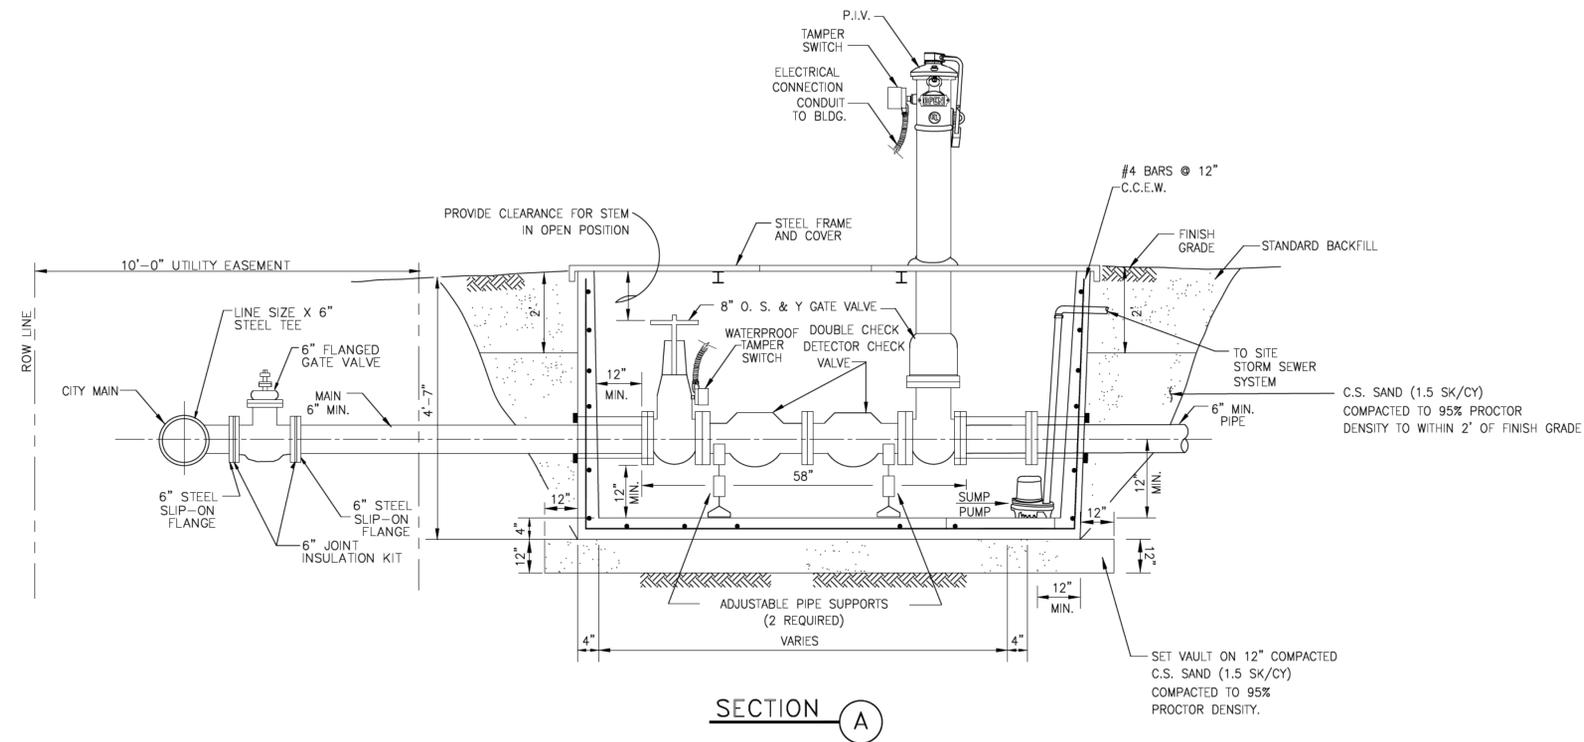

TYPICAL FIRE SERVICE METER

No.	DATE	REVISION
 <p>CITY OF SUGAR LAND, TEXAS ENGINEERING DEPARTMENT</p>		
CONSTRUCTION PLANS FOR:		
WATER LINE FIRE SERVICE METER VAULT		
JOB No.: DATE: DESIGNED BY: DRAWN BY: CHECKED BY: SCALE:	SL-18 SHEET OF	DATE: _____ DESIGN ENGINEER: _____


SL-WA-24

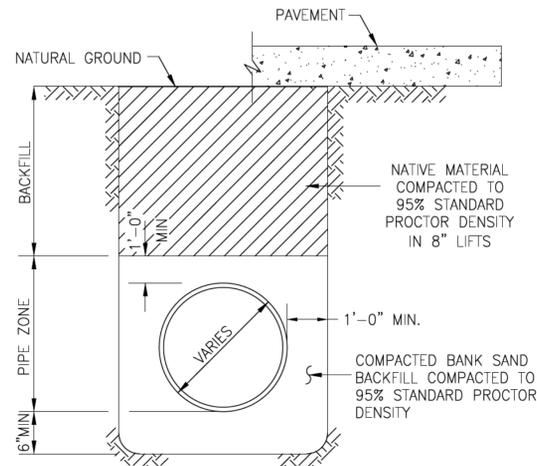

**P.V.C. PIPE BEDDING & BACKFILL**  
N.T.S.  
\*SEE CONSTRUCTION NOTES

**SANITARY FORCE MAIN & WATER LINE  
BEDDING AND BACKFILL**

SL-BB-01

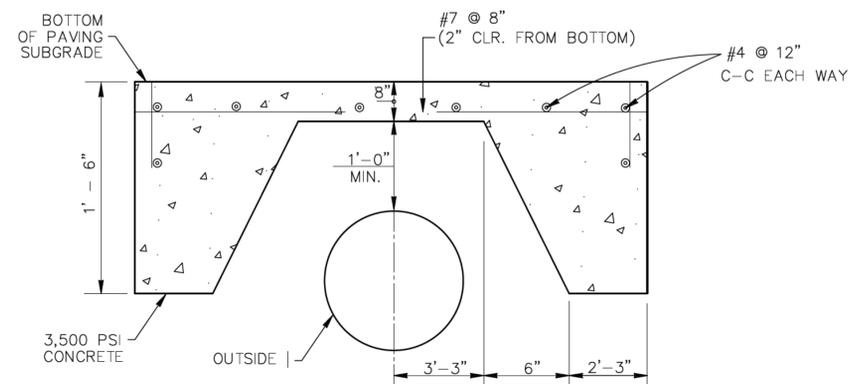


**PROTECTIVE SLAB DETAIL**  
**ZERO LOAD TRANSFER CONCRETE SLAB**

SL-BB-04


**CONSTRUCTION NOTES**

1. CONTRACTOR SHALL CONTACT SUGAR LAND ENGINEERING DEPARTMENT IMMEDIATELY IF WET SAND CONDITIONS ARE ENCOUNTERED.
2. LIMESTONE AND RECYCLED CONCRETE DIMENSIONS SHOWN ARE TYPICAL BUT MAY BE VARIED BY ORDER OF CITY ENGINEER.
3. LIMESTONE OR RECYCLED CONCRETE SHALL BE IN ACCORDANCE WITH TXDOT SPECIFICATION No. 248 FLEXIBLE BASE, TYPE A, GRADE 2 AGGREGATE.
4. NO BEDDING SHALL BE INSTALLED IN WET CONDITIONS. WHEN WELL POINTING OR IN WET SAND CONDITIONS, MAINTAIN GROUND WATER 1 (FT) BELOW BOTTOM OF TRENCH FOR A MINIMUM OF 24-HRS AFTER BEDDING AND BACKFILL IS IN PLACE.
5. ALL MATERIALS SHALL BE FROM THE APPROVED PRODUCTS LIST UNLESS SPECIFICALLY APPROVED BY THE CITY ENGINEER.
6. SANITARY SEWER BEDDING FOR WET SAND CONDITIONS SHALL BE AS PER MODIFIED "A".
7. ALL SAND BEDDING FOR WATER LINES SHALL BE CLEAN, MECHANICALLY COMPACTED BANK SAND.
8. REFER TO: MANHOLE DETAILS, SANITARY, C.S.S., GENERAL, WATER CROSSING, WATER DISTRIBUTION DETAILS AND NOTES.
9. ALL BEDDING WILL BE COMPACTED TO 95% STANDARD PROCTOR DENSITY.
10. A GEOTECHNICAL REPORT MAY BE REQUIRED TO ANALYZE THE BEARING CAPACITY OF EXISTING SOILS AND MAKE A DETERMINATION IF ADDITIONAL BEDDING AND BACKFILL IS APPROPRIATE.

SL-BB-05

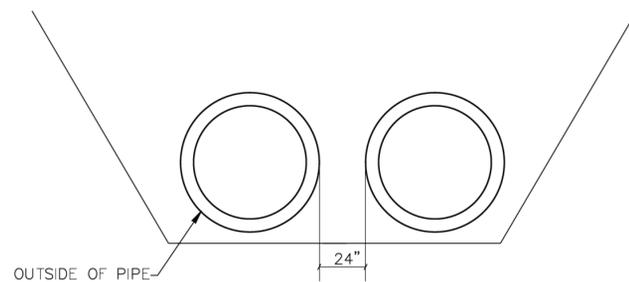


**PIPE SEPARATION**

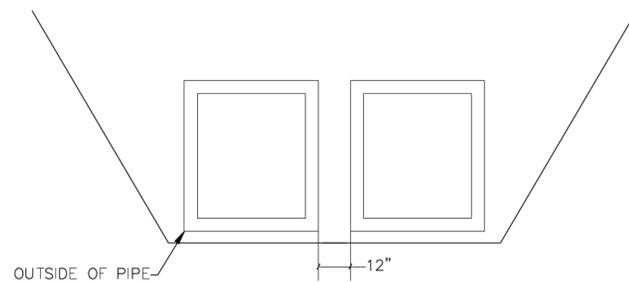

**RCB SEPARATION**

SL-BB-16

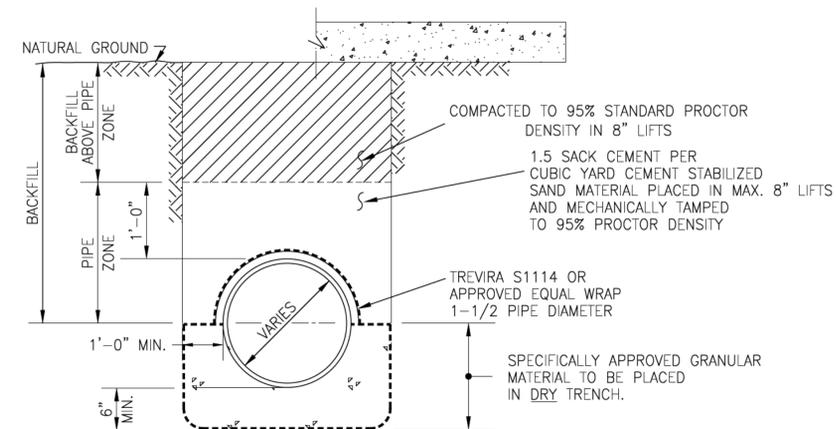

**MODIFIED "A"**  
N.T.S.

NOTE: C.S.S. SHALL BE INSTALLED A MIN. 1' ABOVE TOP OF PIPE.

**SANITARY SEWER  
BEDDING AND BACKFILL**

SL-BB-03

**REFER TO:**

1. GENERAL NOTES
2. C.S.S. NOTES

No.	DATE	REVISION

SEAL: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGN ENGINEER: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT







CONSTRUCTION PLANS FOR:

WATER LINE, SANITARY SEWER  
FORCE MAIN BEDDING DETAILS

JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-19

SHEET OF

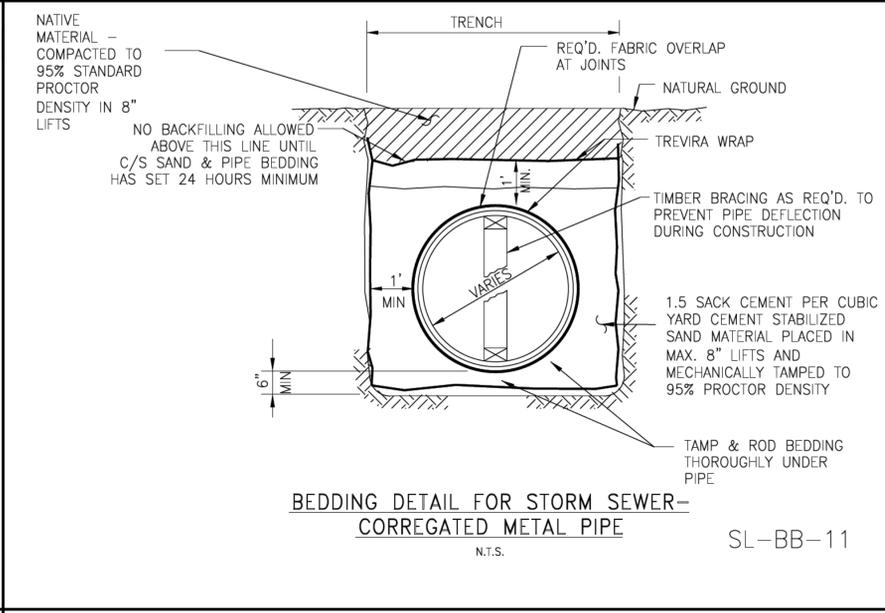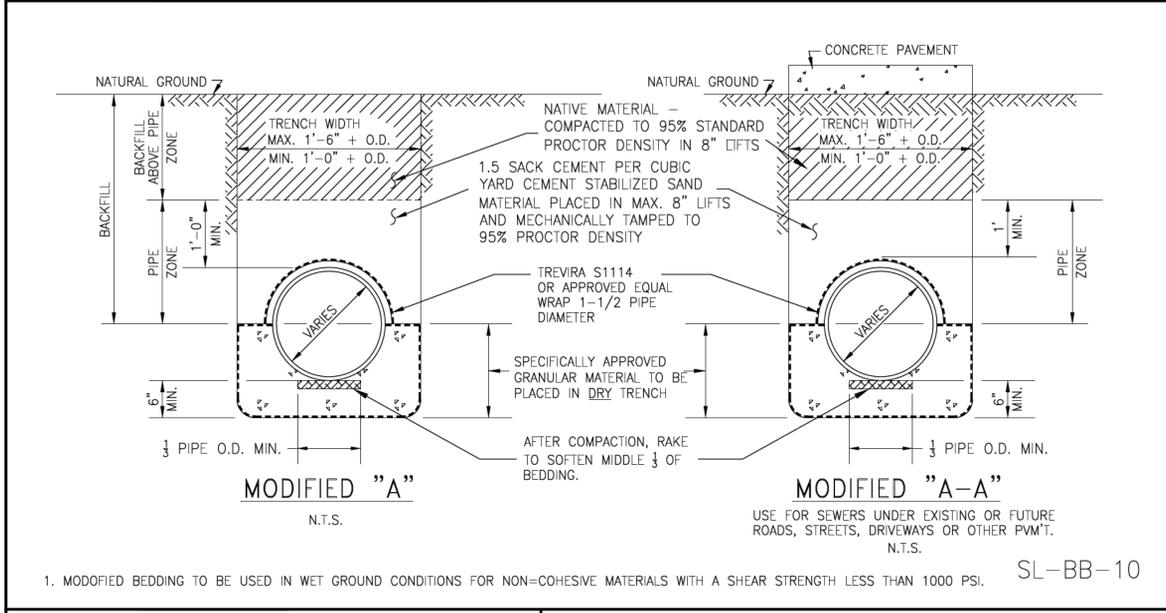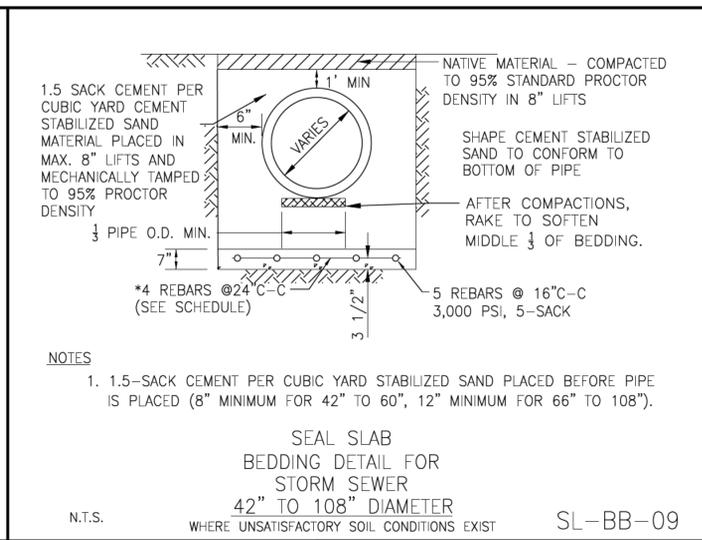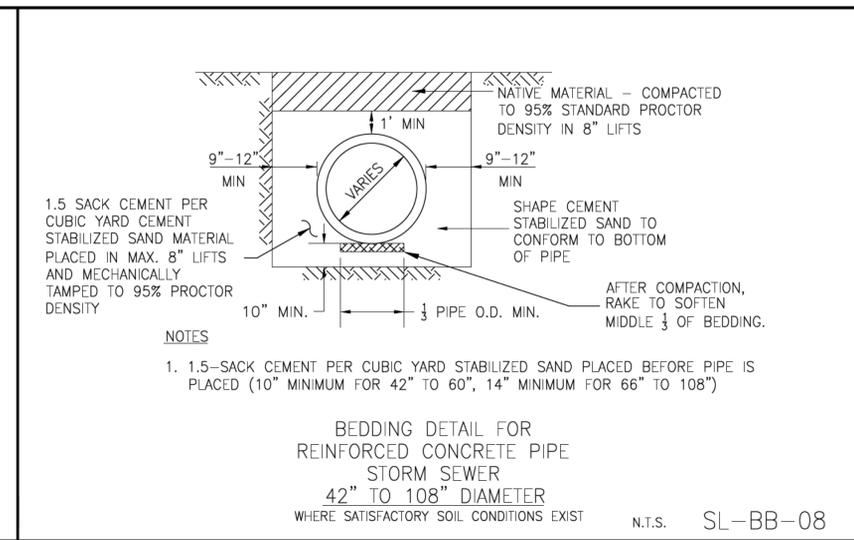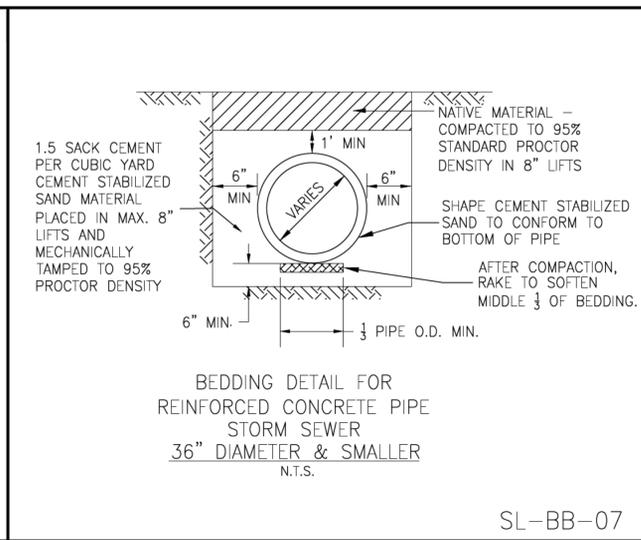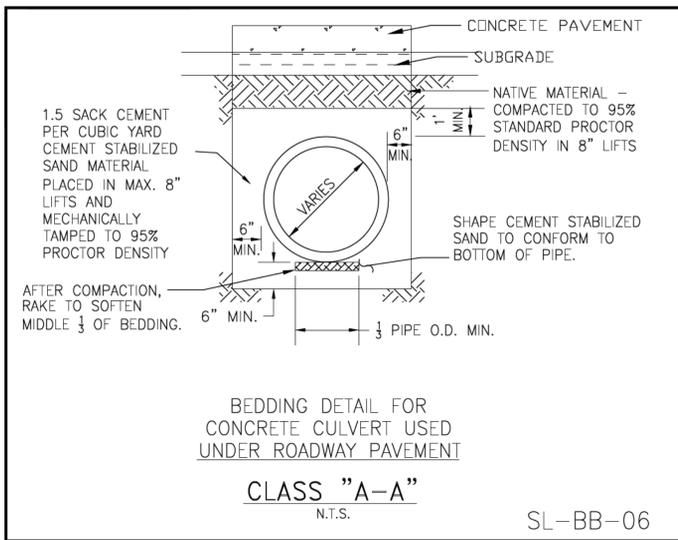




CONSTRUCTION NOTES

- CONTRACTOR SHALL CONTACT SUGAR LAND ENGINEERING DEPARTMENT IMMEDIATELY IF WET SAND CONDITIONS ARE ENCOUNTERED.
- SPECIFICALLY APPROVED GRANULAR MATERIAL DIMENSIONS SHOWN ARE TYPICAL BUT MAY BE VARIED BY ORDER OF CITY ENGINEER.
- SPECIFICALLY APPROVED GRANULAR MATERIAL SHALL BE IN ACCORDANCE WITH TXDOT SPECIFICATION No. 247 FLEXIBLE BASE, TYPE A, GRADE 2 AGGREGATE.
- NO BEDDING SHALL BE INSTALLED IN WET CONDITIONS. WHEN WELL POINTING OR IN WET SAND CONDITIONS, MAINTAIN GROUND WATER 1' (FT.) BELOW BOTTOM OF TRENCH FOR A MINIMUM OF 24-HRS AFTER BEDDING AND BACKFILL IS IN PLACE.
- R.C.P. AND BOX CULVERTS SHALL BE INSTALLED WITH APPROVED GASKETS ONLY.
- MANHOLES SHALL BE PROVIDED WHERE MODIFIED "A" OR MODIFIED "A-A" BEDDING IS USED. STACKS ARE NOT ALLOWED.
- REFER TO: MANHOLE DETAILS, INLETS, OUTFALL AND END TREATMENT DETAILS, C.S.S., GENERAL NOTES, AND STORM NOTES.
- SPECIFIC DESIGNS MUST BE SUBMITTED AND APPROVED BY THE CITY ENGINEER FOR MANHOLE ACCESS TO BOX CULVERTS AS REQUIRED.
- ALL BACKFILL WITHIN THE R.O.W. SHALL BE COMPACTED TO 95% STANDARD PROCTOR DENSITY.
- A GEOTECHNICAL REPORT MAY BE REQUIRED TO ANALYZE THE BEARING CAPACITY OF EXISTING SOILS AND MAKE A DETERMINATION IF ADDITIONAL BEDDING AND BACKFILL IS APPROPRIATE.
- EXCAVATE A HOLE \$ BELL HOLES FOR BELL PIPES (NO ADDITIONAL PAYMENT)

TYPICAL SEAL SLAB BAR SCHEDULE (OR AS DIRECTED BY ENGINEER)

PIPE SIZE	LGT #4 BARS	NO #5 BARS	NO LONGIT
42"	5'4"	5	
48"	6'8"	6	
54"	6'8"	6	
60"	8'0"	7	
66"	8'0"	7	
72"	9'4"	8	
78"	9'4"	8	
84"	9'4"	8	
90"	10'8"	9	
96"	10'8"	9	
102"	12'0"	10	
108"	12'0"	10	

SL-BB-15

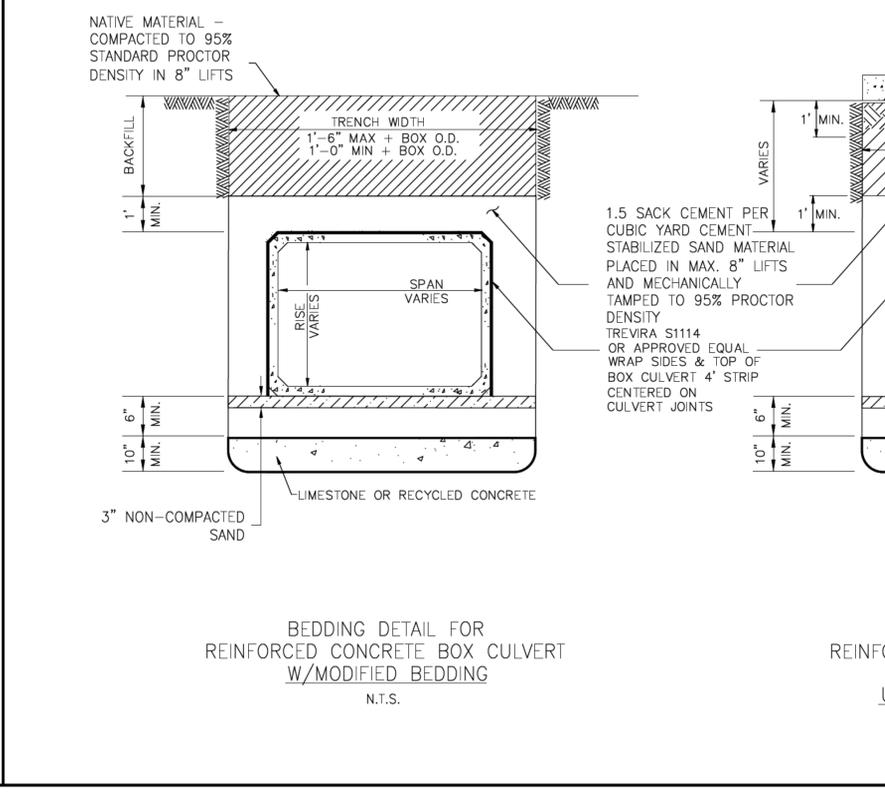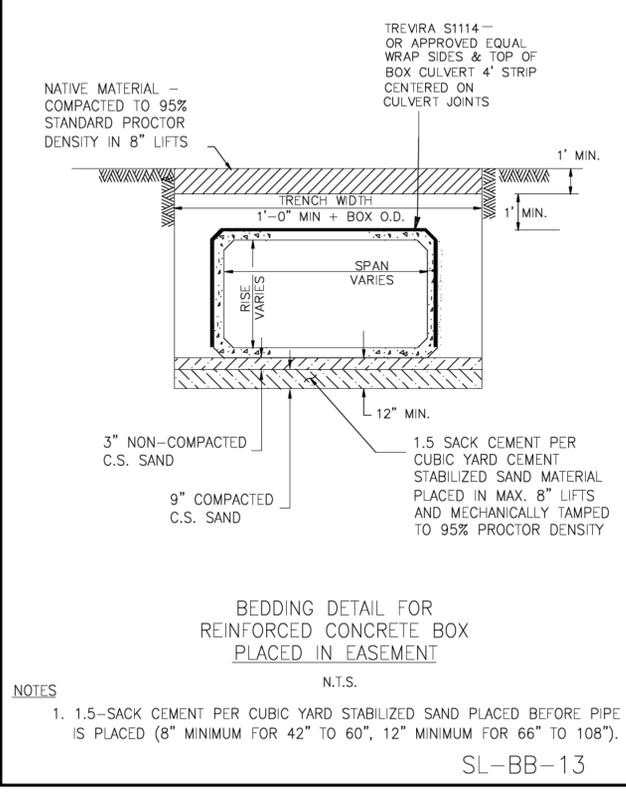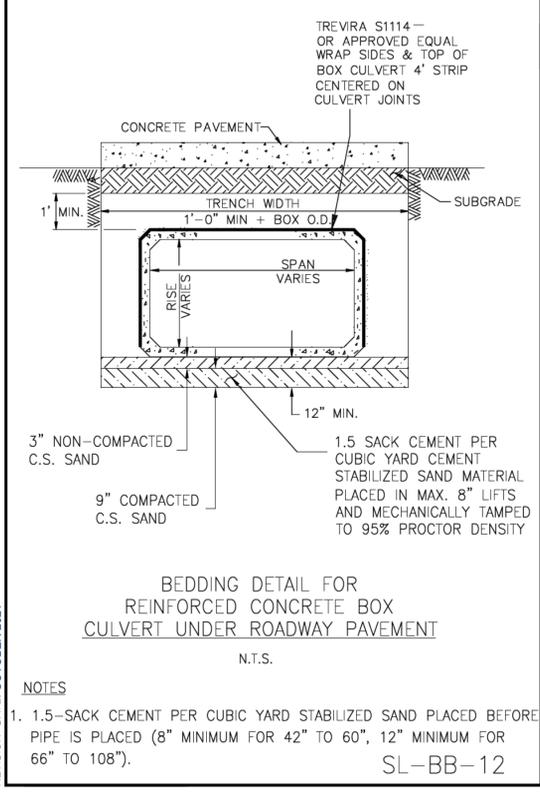

REVISION DATE: OCTOBER 2021

REVISION

DATE

REVISION

SEAL:

DESIGN ENGINEER:

DATE

CITY OF SUGAR LAND, TEXAS

CITY OF SUGAR LAND, TEXAS ENGINEERING DEPARTMENT


CONSTRUCTION PLANS FOR:

STORM SEWER PIPE BEDDING AND BACKFILL DETAILS

JOB No.:  
DATE:  
DESIGNED BY:  
DRAWN BY:  
CHECKED BY:  
SCALE:

SL-20

SHEET OF

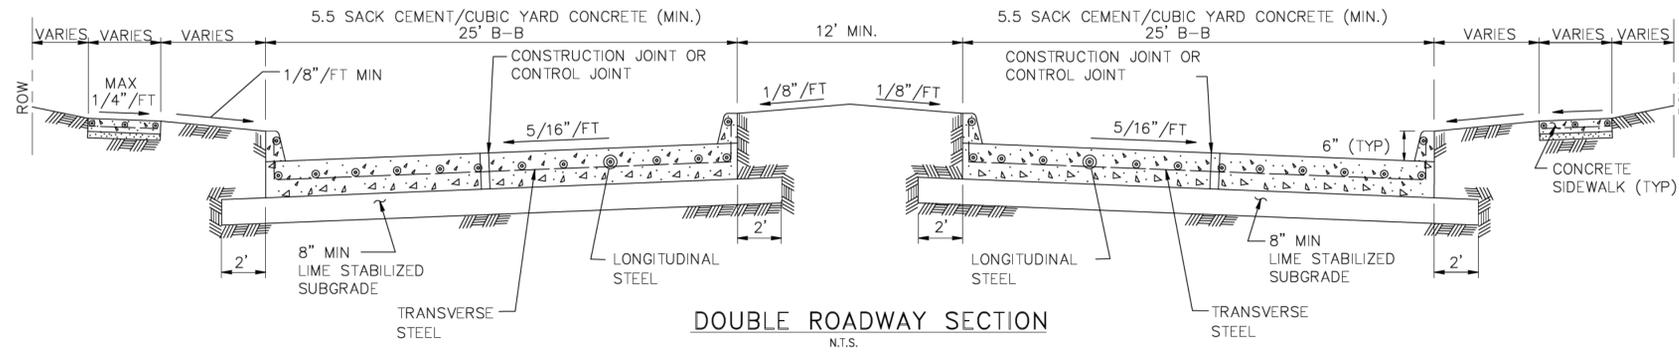


**DOUBLE ROADWAY SECTION**  
N.T.S.

SL-ST-01

**CONSTRUCTION NOTES:**


- 6 INCH, 5.5 SACK CEMENT PER CUBIC YARD CONCRETE, 3500 PSI REINFORCED CONCRETE WITH #4 BARS 24 INCHES C-C, E.W. IS THE MINIMUM ACCEPTABLE PAVEMENT CONSTRUCTION FOR LOCAL STREETS
- 7 INCH, 5.5 SACK CEMENT PER CUBIC YARD CONCRETE, 3500 PSI REINFORCED CONCRETE WITH #4 BARS 18 INCHES C-C, IS THE MINIMUM ACCEPTABLE PAVEMENT CONSTRUCTION FOR COLLECTOR STREETS
- EIGHT (8) INCH, 5.5 SK. 3500 PSI @ 28 DAYS, REINFORCED WITH #4 18" C.C. EACH WAY IS THE MINIMUM ACCEPTABLE FOR ARTERIAL STREETS.
- HARD AGGREGATE IS NOT ALLOWED IN STREET PAVEMENT MIX. ADMIXTURES REQUIRE CITY OF SUGAR LAND PUBLIC WORKS DEPARTMENT APPROVAL.
- TRANSVERSE EXPANSION JOINTS SHALL BE PLACED AT ALL POINTS OF CURVATURE, POINTS OF TANGENCY AND ALL INTERSECTION CURB RETURN POINTS. MAXIMUM SPACING SHALL BE 200' AND BE SEALED WITH SEALANT CONFORMING TO TXDOT ITEM 360 (& ITEM 438) AND TXDOT DMS-6310, CLASS-2.
- TRANSVERSE CONTROL JOINTS ARE REQUIRED AT MAXIMUM SPACING OF 20'-0" C-C, AND VERTICAL CURB JOINTS TO BE SEALED WITH SPECIAL JOINT SEALANT ASTM-D-1190-74 OR AASHTO-M173-60 FOR PAVEMENT 8" THICK AND GREATER. (ELASTOMERIC TYPE HOT Poured)
- PAVEMENT FINISH SHALL BE BAKER BROOM FINISH. CURING COMPOUND REQUIRED ON ALL CONCRETE.
- STORM WATER POLLUTION PROTECTION SHALL BE DESIGNED, CONSTRUCTED, MAINTAINED AND SHALL BE IN TOTAL COMPLIANCE WITH THE STORM QUALITY MANUAL OF THE CITY OF SUGAR LAND. CITY ENGINEER'S APPROVAL.
- REFER TO GENERAL, C.S.S., AND PAVEMENT NOTES.
- FOR PAVEMENT WIDTH OF 20'-FT AND WIDER, ADD A LONGITUDINAL CONTROL JOINT.

SL-ST-12

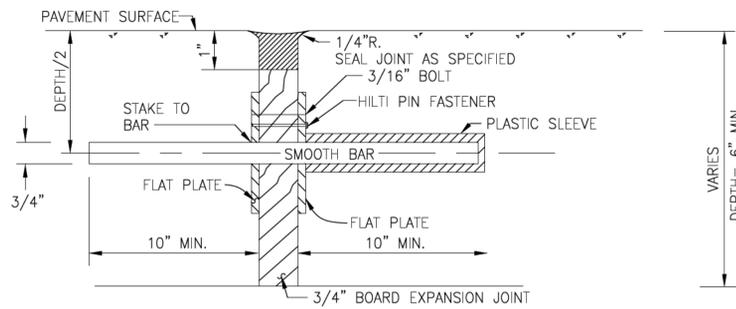

**DOWEL TYPE EXPANSION JOINT**  
N.T.S.


SL-ST-03

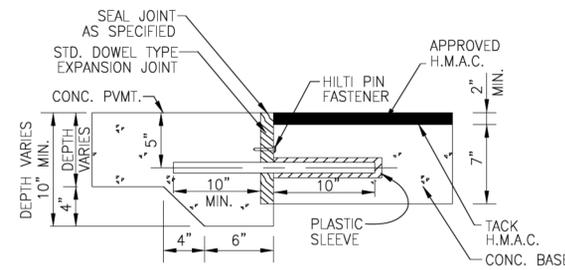

**DOWEL TYPE EXPANSION JOINT**  
N.T.S.


(CONC. PAVING TO CONC. BASE)

SL-ST-06

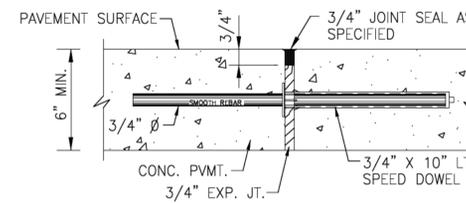


**SPEED DOWEL EXPANSION JOINT**  
N.T.S.

SL-ST-08

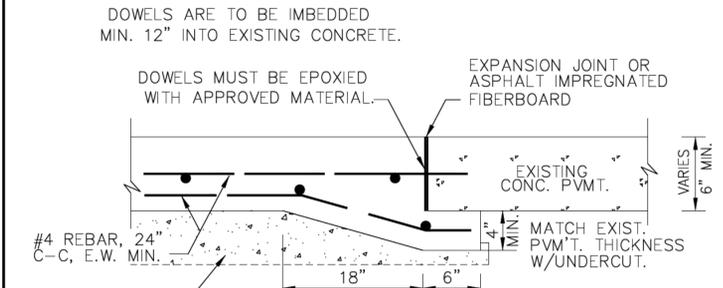

**UNDERCUT DETAIL WITH HEADER**  
N.T.S.


SL-ST-09

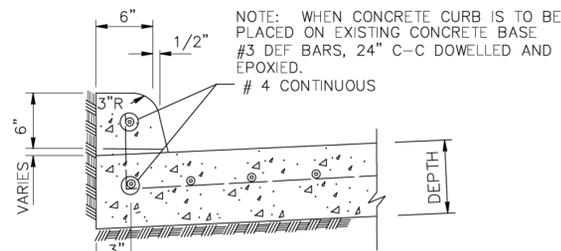

**CONCRETE CURB**  
N.T.S.

CONSTRUCTION NOTE:  
ALL NEW CURB REQUIRES 3,000 P.S.I. @ 28-DAYS.


SL-ST-04

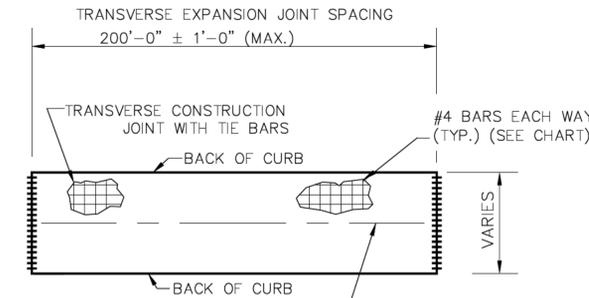

**PAVING PANEL**  
N.T.S.

SL-ST-05


PAVEMENT THICKNESS	SPACING (C-C)
6"	24"
7"	18"
8"	18"

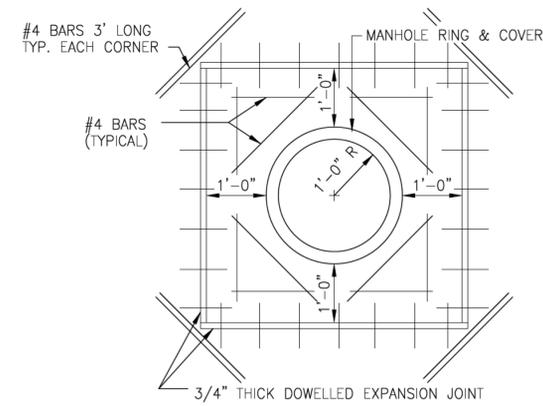

**MANHOLE BLOCKOUT**  
N.T.S.


(STORM & SANITARY)  
IN PAVEMENT

SL-ST-10

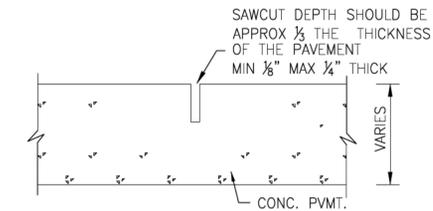

**CONTROL JOINT**  
N.T.S.

SL-ST-11

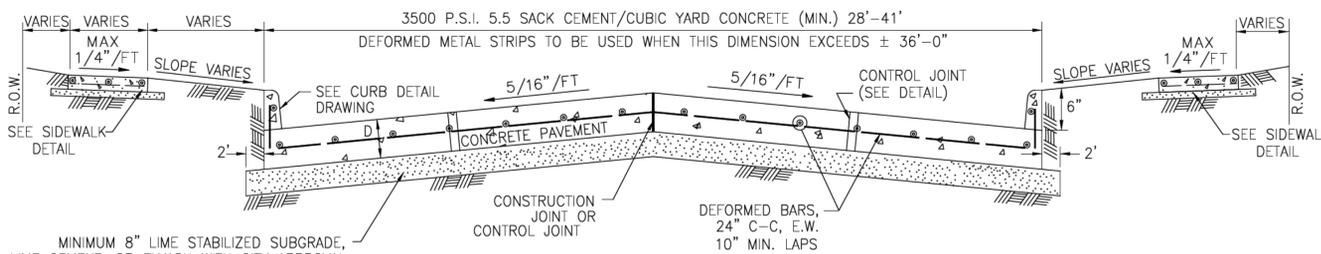


SL-ST-02

**SINGLE ROADWAY SECTION**  
N.T.S.


**NOTES:**

- FOR P.V.M.T DEPTHS OF 6" USE 1/2" DEFORMED BARS, 24" C-C, 10" LAPS. ALL REINFORCING STEEL SHALL CONFORM TO GRADE 60, A.S.T.M. NO. A615. LAP SPLICES TO BE A MINIMUM OF 10 INCHES. STAGGER SPLICES IN ADJACENT BARS.

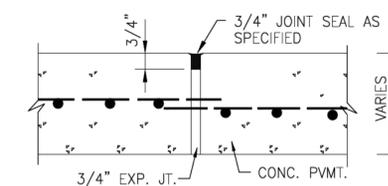

**CONSTRUCTION JOINT SEAL**  
N.T.S.

SL-ST-12

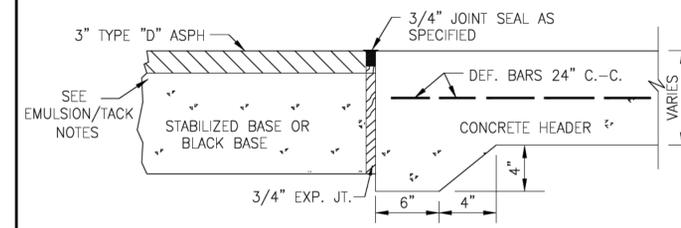

**PAVING HEADER**  
N.T.S.

(FOR USE IN CONNECTING CONC. P.V.M.T. TO ASPHALT P.V.M.T.)  
(PROP. OR EXIST.)

SL-ST-07

No.	DATE	REVISION

DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:


CONCRETE PAVEMENT  
CONSTRUCTION DETAILS I

JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-21

SHEET OF

REVISION DATE: OCTOBER 2021

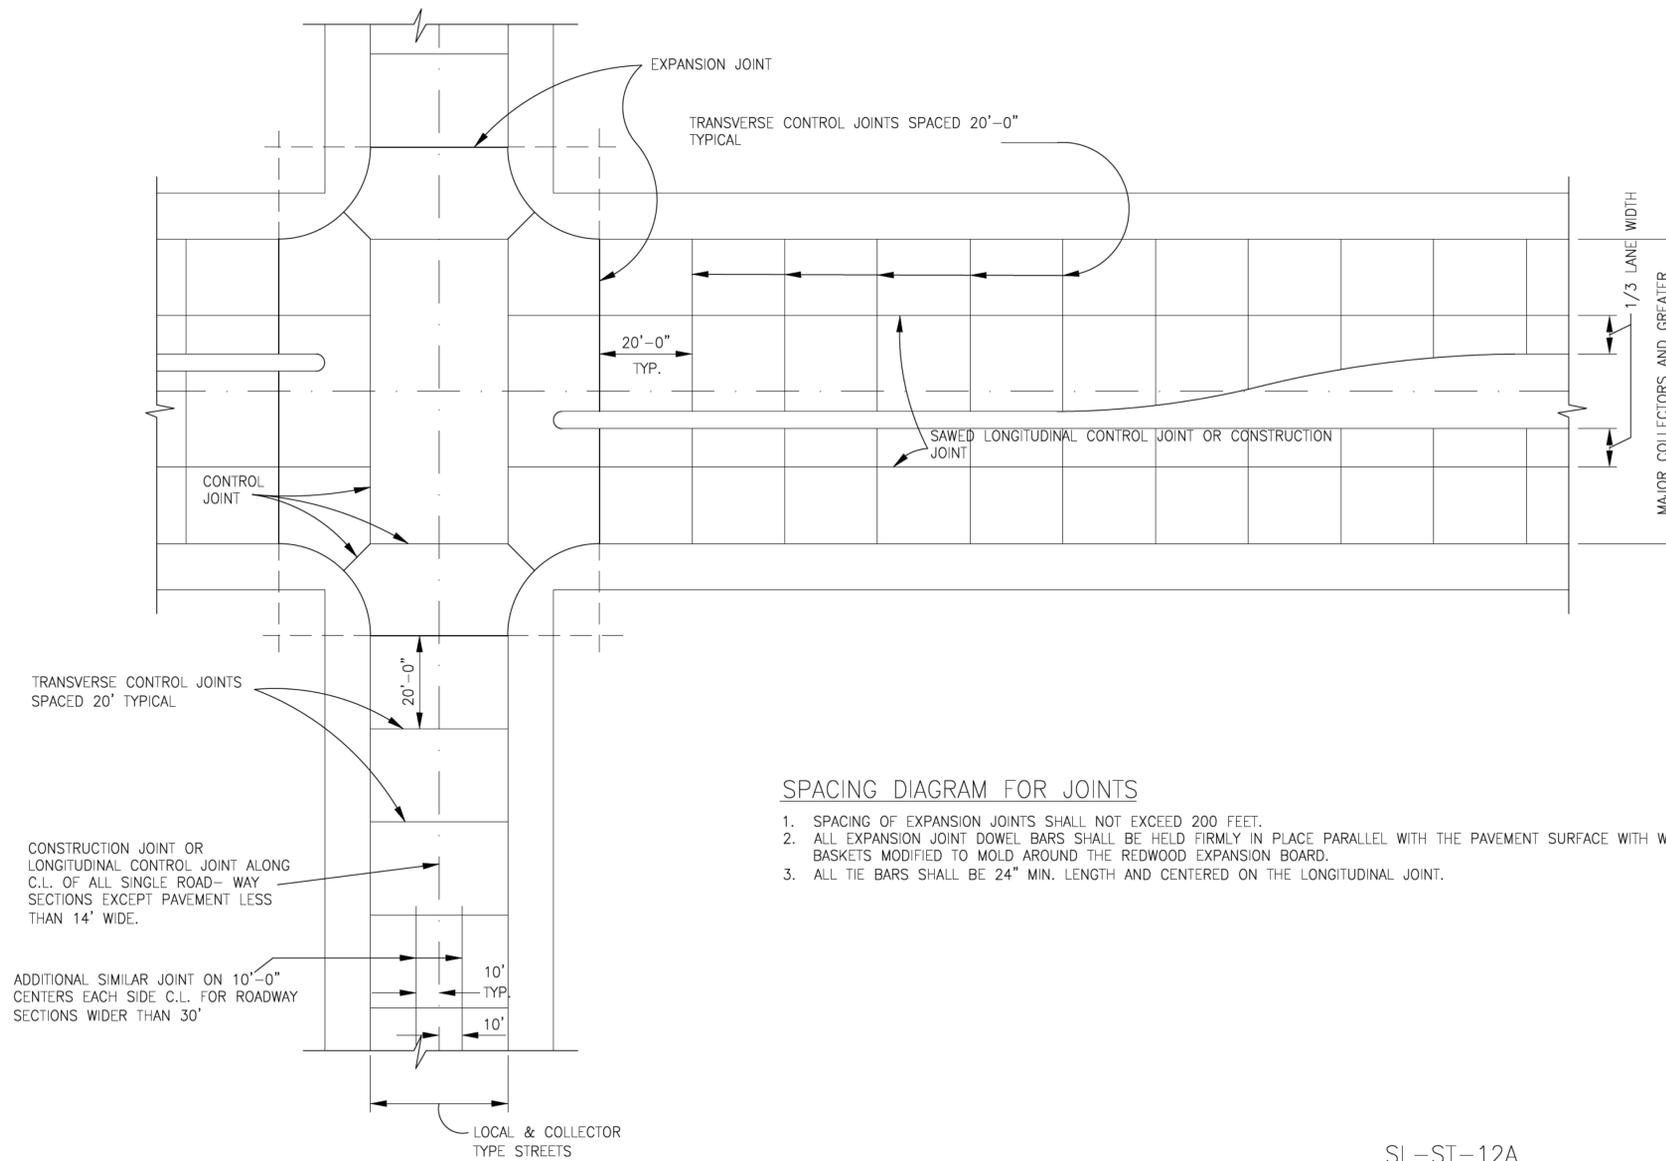


**SPACING DIAGRAM FOR JOINTS**

1. SPACING OF EXPANSION JOINTS SHALL NOT EXCEED 200 FEET.
2. ALL EXPANSION JOINT DOWEL BARS SHALL BE HELD FIRMLY IN PLACE PARALLEL WITH THE PAVEMENT SURFACE WITH WIRE BASKETS MODIFIED TO MOLD AROUND THE REDWOOD EXPANSION BOARD.
3. ALL TIE BARS SHALL BE 24" MIN. LENGTH AND CENTERED ON THE LONGITUDINAL JOINT.


SL-ST-12A

No.	DATE	REVISION
SEAL:		
DESIGN ENGINEER: _____ DATE _____		
 CITY OF SUGAR LAND, TEXAS ENGINEERING DEPARTMENT		
CONSTRUCTION PLANS FOR:		
CONCRETE PAVEMENT CONSTRUCTION DETAILS II		
JOB No.:	DESIGNED BY:	SL-22
DATE:	DRAWN BY:	
CHECKED BY:	SCALE:	
SHEET		OF

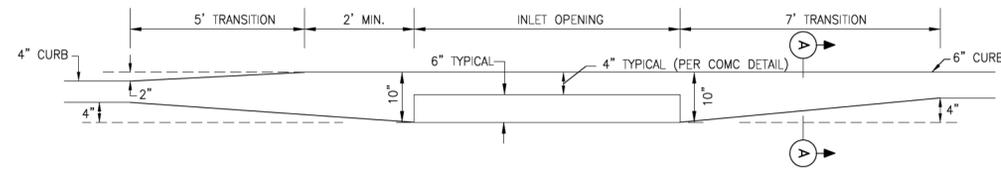


TYPICAL CURB TRANSITION FOR INLET INSTALLATION

SL-ST-13

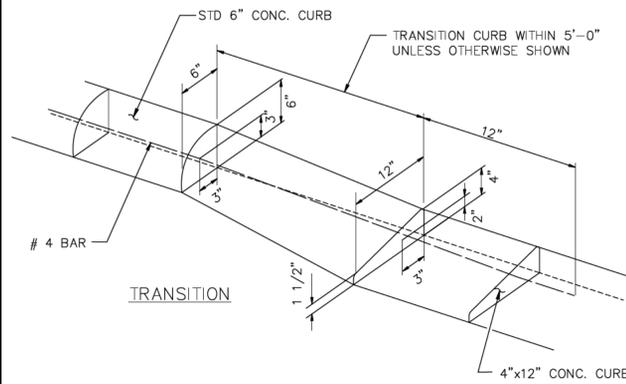


TYPICAL CURB TRANSITION  
N.T.S.

SL-ST-15

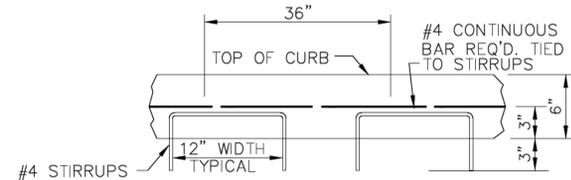


TYPICAL CONCRETE CURB  
REINFORCING  
N.T.S.

SL-ST-16

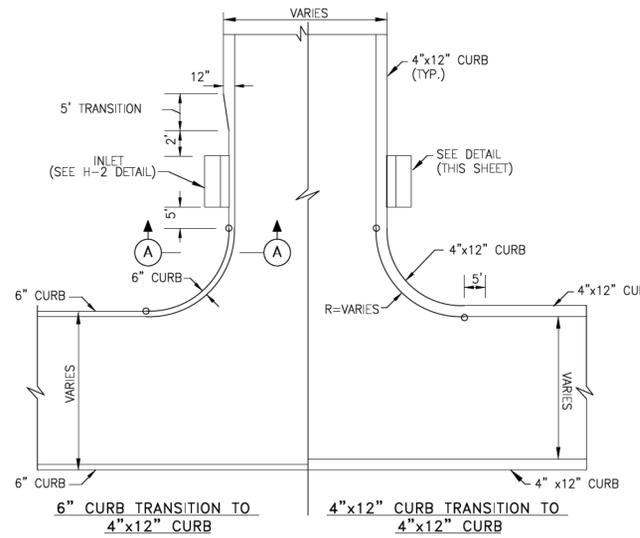

TYPICAL 4"X12" CURB W/INLET TRANSITION  
FOR CURB RETURNS  
N.T.S.

SL-ST-14

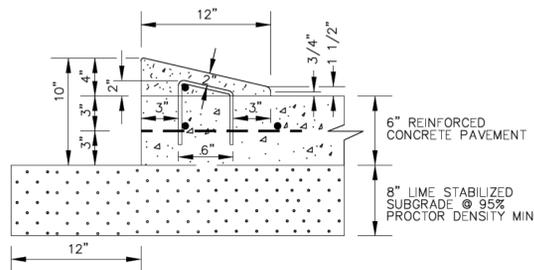


4"X12" MOUNTABLE CONCRETE CURB  
N.T.S.

NOTES:

- 1.0 LBS. OF APPROVED NON-METALLIC FIBER MESH PER C/Y IN 4"X12" CURBS.
- #3 RE-BAR STIRRUPS TO BE PLACED AT INTERVALS OF 2' (FT) C-C.
- #4 RE-BAR LONGITUDINAL SHALL BE TIED TO EACH STIRRUP
- MOUNTABLE CURB ONLY ALLOWED ON < 41' (FT), UNDIVIDED, RESIDENTIAL ROADWAYS WITHIN SUBDIVISIONS.

SL-ST-17

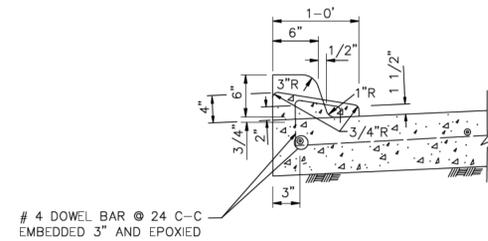


4-INCH x 12-INCH TRANSITION CURB  
N.T.S.

SL-ST-18

4"X12" MOUNTABLE CONCRETE CURB AND  
TRANSITION CURB NOTES:

- 6-INCH CONCRETE CURB TO BE CONSTRUCTED ON ALL ESPLANADES, ISLANDS AND NON-RESIDENTIAL STREETS. RESIDENTIAL STREETS MAY BE CONSTRUCTED WITH EITHER 6-INCH CONCRETE CURB OR 4-INCH x 12-INCH CONCRETE CURB AS NOTED ON PLANS.
- ALL 4-INCH x 12-INCH CONCRETE CURBS TO BE POURED SEPARATE FROM PROPOSED CONCRETE PAVEMENT.
- TRANSITIONS FROM 6-INCH CONCRETE CURB TO 4-INCH x 12-INCH CONCRETE CURB TO BE ACCOMPLISHED WITHIN 5 FEET (TYP.), UNLESS OTHERWISE SHOWN. REINFORCING STEEL AS SHOWN IN "4-INCH x 12-INCH TRANSITION CURB" DETAIL IS TO BE INSTALLED.

SL-ST-20

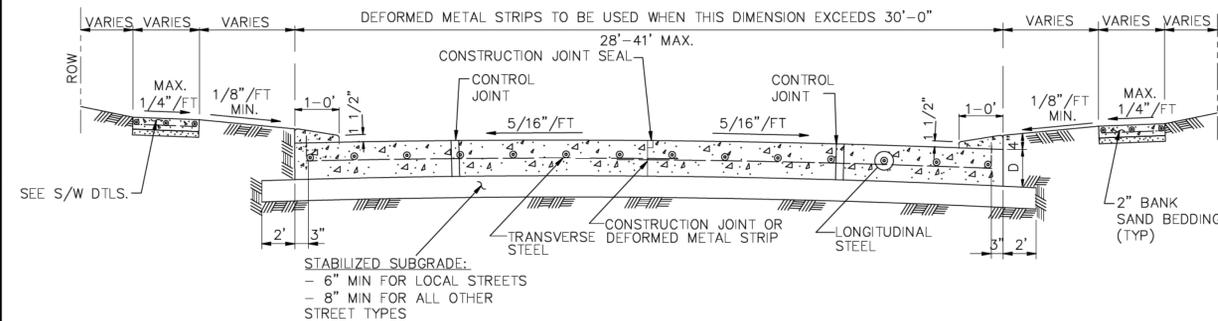

TYPICAL SINGLE ROADWAY SECTION FOR  
CONCRETE PAVEMENT WITH 4"X12" CURB

\* SEE 4" x 12" MOUNTABLE CURB DETAIL  
(THIS SHEET)  
N.T.S.

SL-ST-19

CONSTRUCTION NOTES:

- 6 INCH, 5.5 SACK CEMENT PER CUBIC YARD CONCRETE, 3500 PSI REINFORCED CONCRETE WITH #4 BARS 24 INCHES C-C, E.W. IS THE MINIMUM ACCEPTABLE PAVEMENT CONSTRUCTION FOR RESIDENTIAL STREETS.
- 7 INCH, 5.5 SACK CEMENT PER CUBIC YARD CONCRETE, 3500 PSI REINFORCED CONCRETE WITH #4 BARS 24 INCHES C-C, IS THE MINIMUM ACCEPTABLE PAVEMENT CONSTRUCTION FOR COLLECTOR STREETS
- EIGHT (8) INCH, 5.5 SK, 3500 PSI @ 28 DAYS, REINFORCED WITH #4 18" C.C. EACH WAY IS THE MINIMUM ACCEPTABLE FOR ARTERIAL STREETS.
- TRANSVERSE EXPANSION JOINTS SHALL BE PLACED AT ALL POINTS OF CURVATURE, POINTS OF TANGENCY AND ALL INTERSECTION CURB RETURN POINTS MAXIMUM SPACING SHALL BE 200' AND BE SEALED CONFORMING TO TXDOT ITEM 360 (& ITEM 438) AND TXDOT DMS-6310, CLASS-2.
- TRANSVERSE CONTROL JOINTS ARE REQUIRED AT MAXIMUM SPACING OF 20'-0" C-C, AND VERTICAL CURB JOINTS TO BE SEALED WITH SPECIAL JOINT SEALANT ASTM-D-1190-74 OR AASHTO-M173-60 FOR PAVEMENT 8" THICK AND GREATER. (ELASTONETRIC TYPE HOT POURED)
- PAVEMENT FINISH SHALL BE BAKER BROOM FINISH. CURING COMPOUND ON ALL CONCRETE.
- STORM WATER POLLUTION PROTECTION SHALL BE DESIGNED, CONSTRUCTED, MAINTAINED AND SHALL BE IN TOTAL COMPLIANCE WITH THE STORM WATER QUALITY MANUAL OF THE CITY OF SUGAR LAND.
- UNSTABLE SUBGRADE SHALL BE EXCAVATED AND REPLACED WITH CEMENT STABILIZED SAND.
- USE 1"x2" REDWOOD STAKES FOR HEADERS.
- EDGE ALL SIDES WITH EDGING TOOL.
- DOWEL SHALL BE 3/4" DIAMETER, WITH MINIMUM 8" PENETRATION (BOTH SIDES).
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE CITY OF SUGAR LAND OF ANY BIRDBATH PROBLEMS PRIOR TO CONSTRUCTION OF DRIVEWAY.
- REFER TO GENERAL, C.S.S., AND PAVEMENT NOTES.
- 1.0 LBS. OF APPROVED POLYPROPYLENE FIBER MESH PER C/Y IN 4"X12" CURBS REQUIRED.

SL-ST-20

No.	DATE	REVISION

SEAL: \_\_\_\_\_  
DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:


RESIDENTIAL CURB  
CONSTRUCTION DETAILS

JOB No.:  
DATE:  
DESIGNED BY:  
DRAWN BY:  
CHECKED BY:  
SCALE:


SL-23

SHEET OF




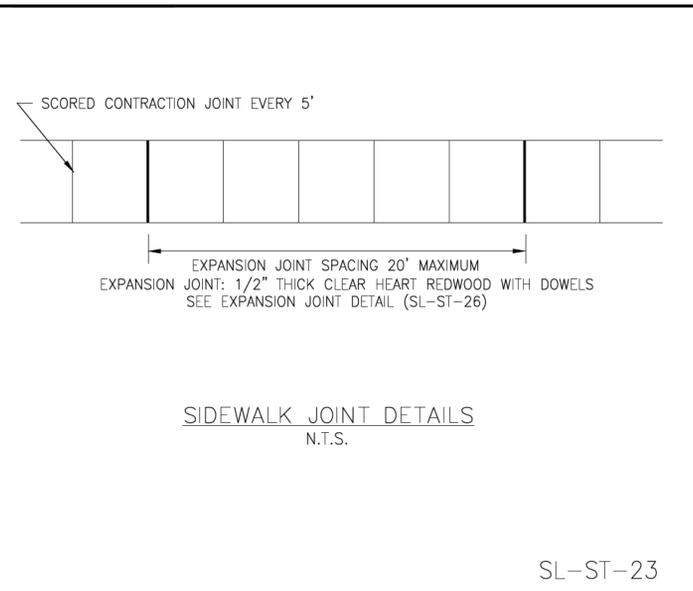

SL-ST-23

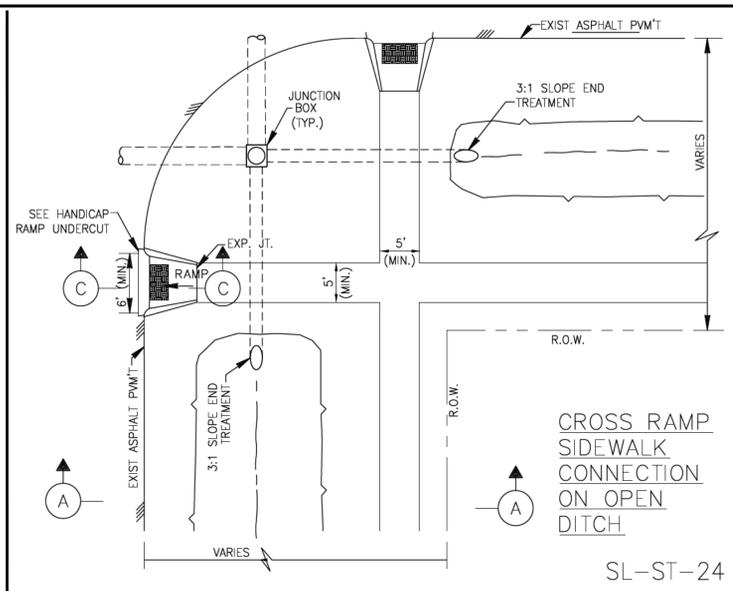

SL-ST-24

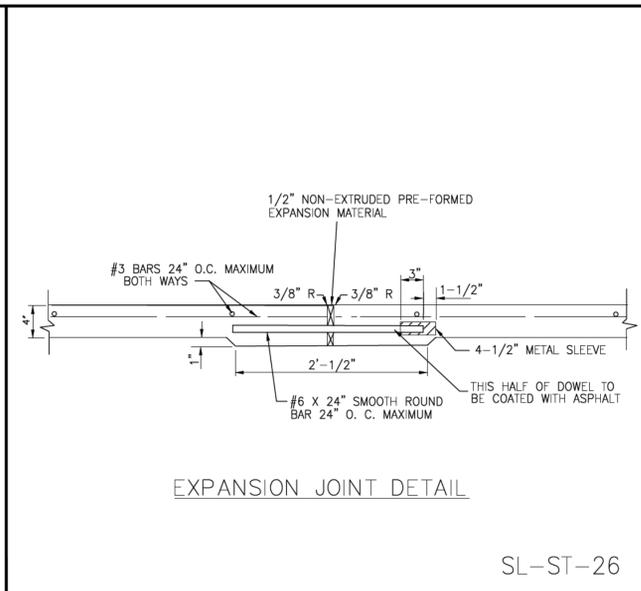


SL-ST-26

NOTES:


- EXISTING CURB AND GUTTER TO BE SAW CUT, REMOVED AND REPLACED. DOWEL STEEL FOR MINIMUM REINFORCING OVERLAP OF 10 INCHES (10") DOWELS SHALL BE EIGHTEEN INCHES (18") LONG AND EPOXIED A MINIMUM OF (8") EIGHT INCHES INTO EXISTING PAVEMENT.
- IF SIDEWALKS ARE NEITHER EXISTING NOR PROPOSED WHERE WHEELCHAIR RAMP ACCESS IS REQUIRED, CONCRETE SIDEWALKS SURFACE 4 1/2" THICK SHALL BE INSTALLED TO PROVIDE ACCESS TO THE PEDESTRIAN PUSH BUTTONS.
- DETECTABLE WARNINGS REQUIRED BY T.A.S. SECTIONS 4.1 AND 4.7 SHALL COMPLY WITH T.A.S. SECTION 4.29
- THE MATERIAL USED TO PROVIDE CONTRAST SHALL BE AN INTEGRAL PART OF THE WALKING SURFACE. DETECTABLE WARNINGS USED ON INTERIOR SURFACE SHALL DIFFER FROM ADJOINING WALKING SURFACES IN RESILIENCY OR SOUND-ON-CANE.
- DETECTABLE WARNING SURFACE SHALL COVER THE ENTIRE WIDTH AND DEPTH OF RAMP.
- DETECTABLE WARNINGS SHALL BE INSTALLED WITH PAVERS IN ACCORDANCE WITH MANUFACTURER'S REQUIREMENTS.
- CONCRETE PAVER UNITS SHALL MEET ALL REQUIREMENTS OF ASTM C-935, C-33, AND SHALL BE PLACED IN A TWO BY TWO UNIT BASKET WEAVE PATTERN, UNLESS SHOWN OTHERWISE IN THE PLANS.
- CONCRETE PAVER UNITS SHALL HAVE A TRUNCATED DOME TOP SURFACE FOR DETECTABLE WARNING TO PEDESTRIANS. DOMES SHALL BE ALIGNED IN THE DIRECTION OF PEDESTRIAN TRAVEL.
- CONCRETE PAVER UNIT COLOR FOR THE RAMP SHALL BE A CONTRASTING COLOR THAT PROVIDES A LIGHT REFLECTIVE THAT SIGNIFICANTLY CONTRASTS WITH THE ADJACENT SURFACES. ADJACENT SURFACES INCLUDE SIDE FLARES.
- CONCRETE PAVER UNITS SHALL BE SAW CUT ONLY, AND ANY CUT UNIT SHALL NOT BE LESS THAN 25% OF A FULL UNIT.

CONSTRUCTION NOTES:


- THE MAXIMUM WIDTH BETWEEN EXPANSION JOINTS SHALL NOT EXCEED 20'-0"
- EXPANSION JOINT IS TO BE 1/2" THICK CLEAR HEART REDWOOD WITH DOWELS.
- SCORED CONTRACTION JOINTS SHALL BE EVERY 5' OR EQUAL TO WIDTH OF SIDEWALK.
- ALL EARTHEN AREAS ARE TO BE SODDED UNLESS SHOWN OTHERWISE ON DRAWINGS.
- 4 INCH, 5 SACK CEMENT PER CUBIC YARD CONCRETE, 3000 PSI. REINFORCED CONCRETE WITH #3 BARS, 18 INCHES C-C, FOR SIDEWALKS, #4 BARS 18' C-C FOR WHEEL CHAIR RAMPS IS THE MINIMUM ACCEPTED. MINIMUM 3 LONGITUDINAL BARS. FIBER REINFORCING SIDEWALKS-STEEL AND POLYPROPYLENE BLENDED FIBER REINFORCEMENT SYSTEM SUCH AS NOVOMESH e3 AS MANUFACTURED BY S.I. CONCRETE SYSTEMS (OR PRE-APPROVED EQUAL) MAY BE USED AS AN ALTERNATE TO CONVENTIONAL REBAR REINFORCING AT A DOSAGE RATE OF 24 LBS. PER CUBIC YARD OF CONCRETE.
- USE RADIUS TOOL ON ALL EXPOSED EDGES.
- TOP OF THE SIDEWALK ELEVATION TO BE TOP OF CURB.
- MEMBRANE CURING COMPOUND IS REQUIRED AS DESCRIBED IN ITEM 526 IN THE TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION.
- REFER TO GENERAL NOTES AND CONCRETE/PAVING NOTES.
- SIDEWALK EXPANSION JOINTS SHALL CONFORM TO STREET EXPANSION JOINT STANDARDS.

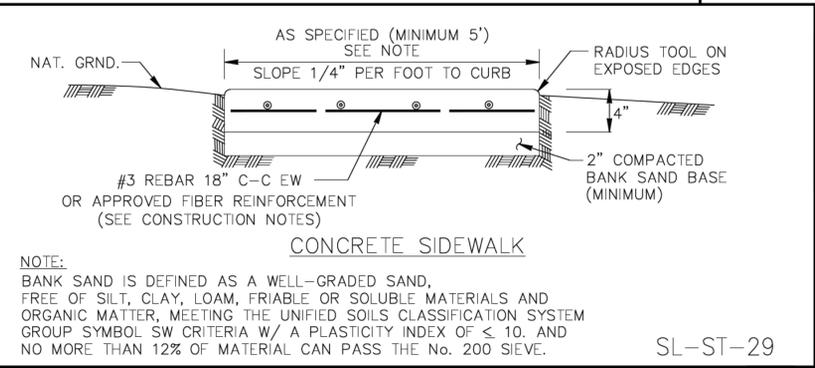


SL-ST-29

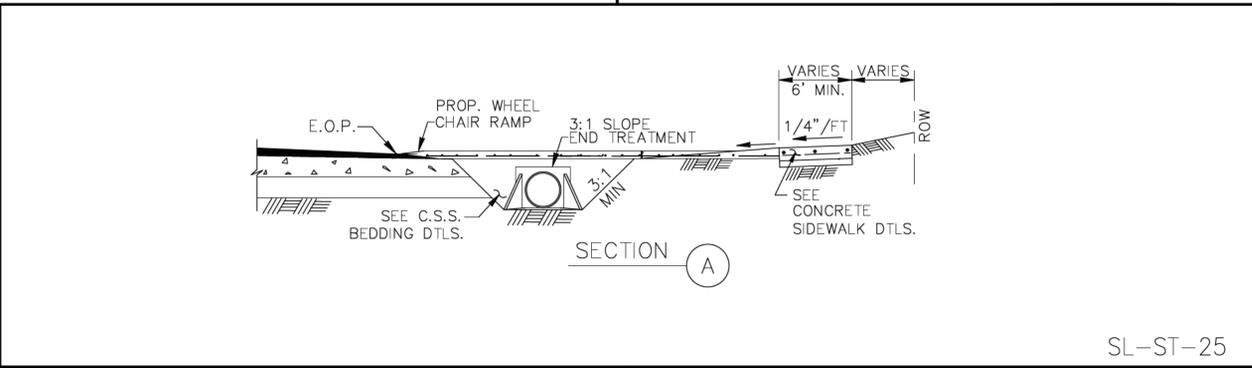


SL-ST-25

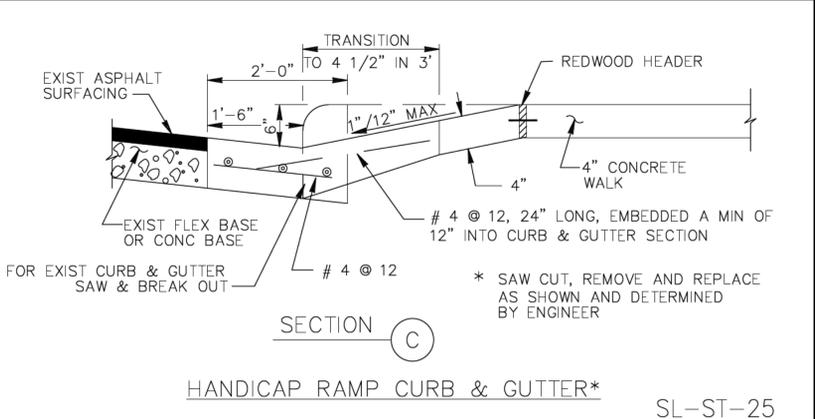



SL-ST-25

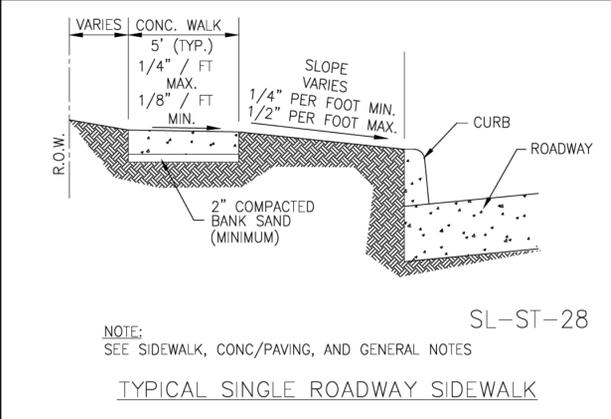


SL-ST-28

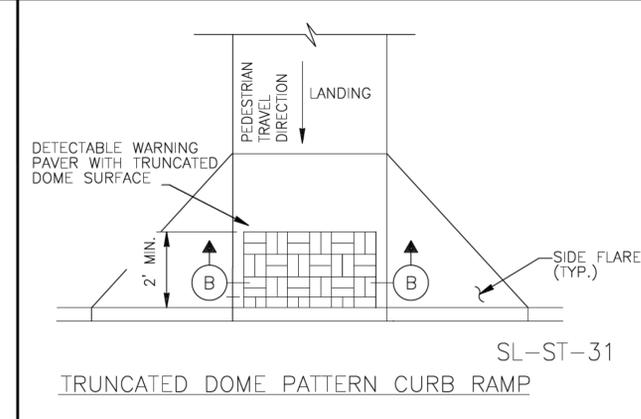


SL-ST-31

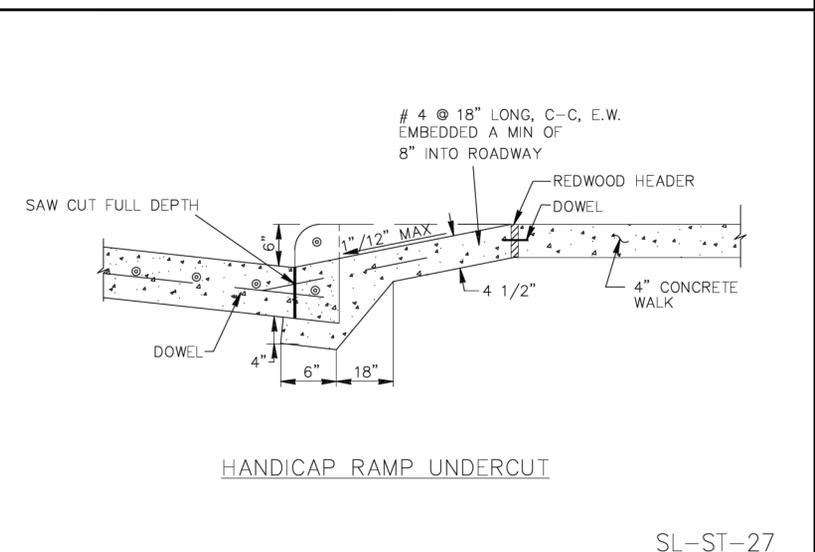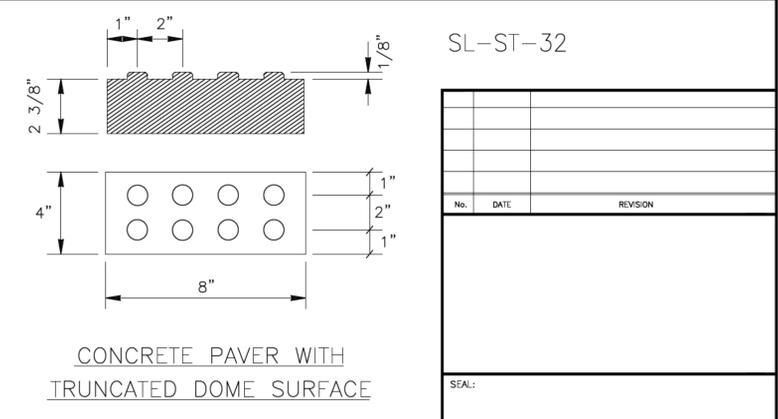

SL-ST-27

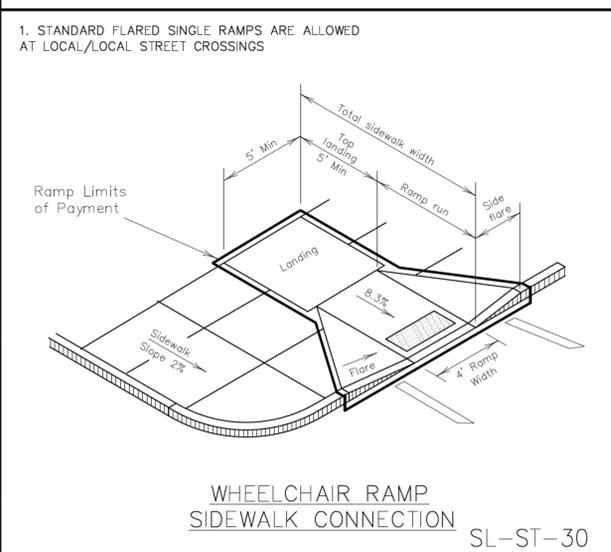






SL-ST-30

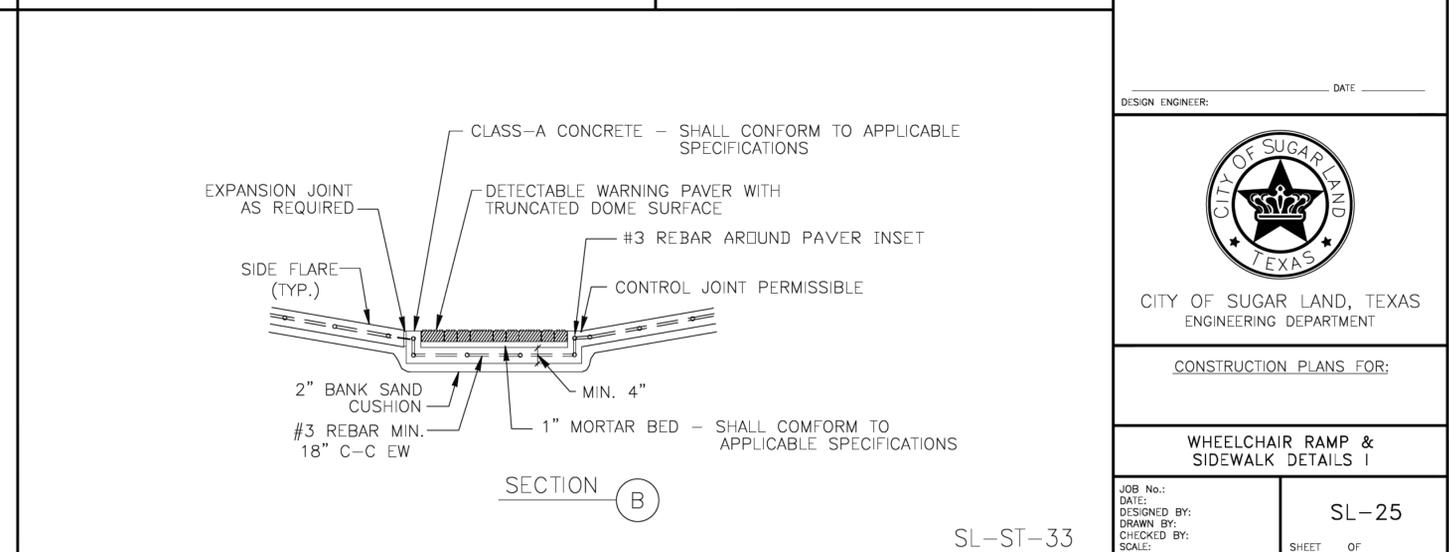

REVISION DATE: OCTOBER 2021













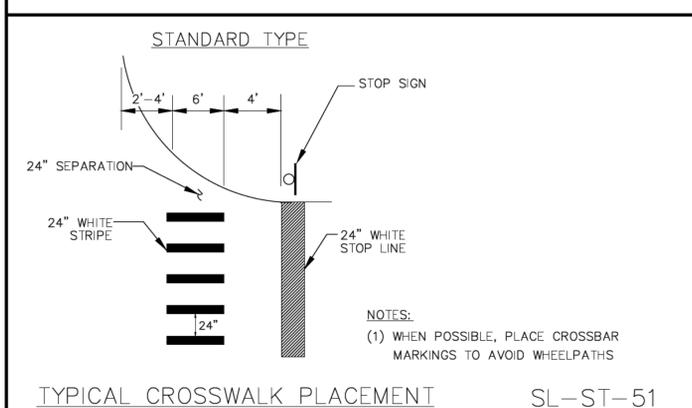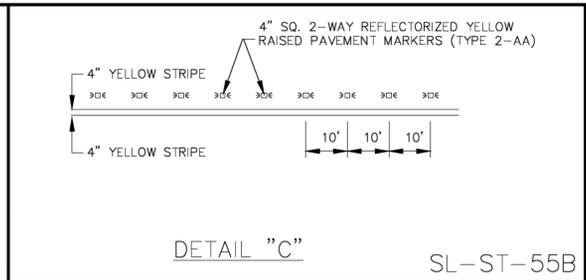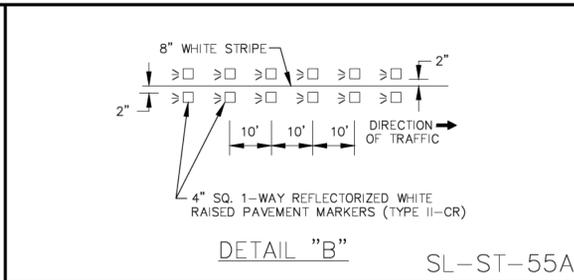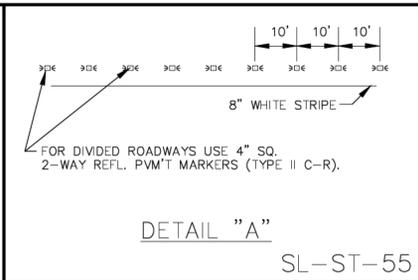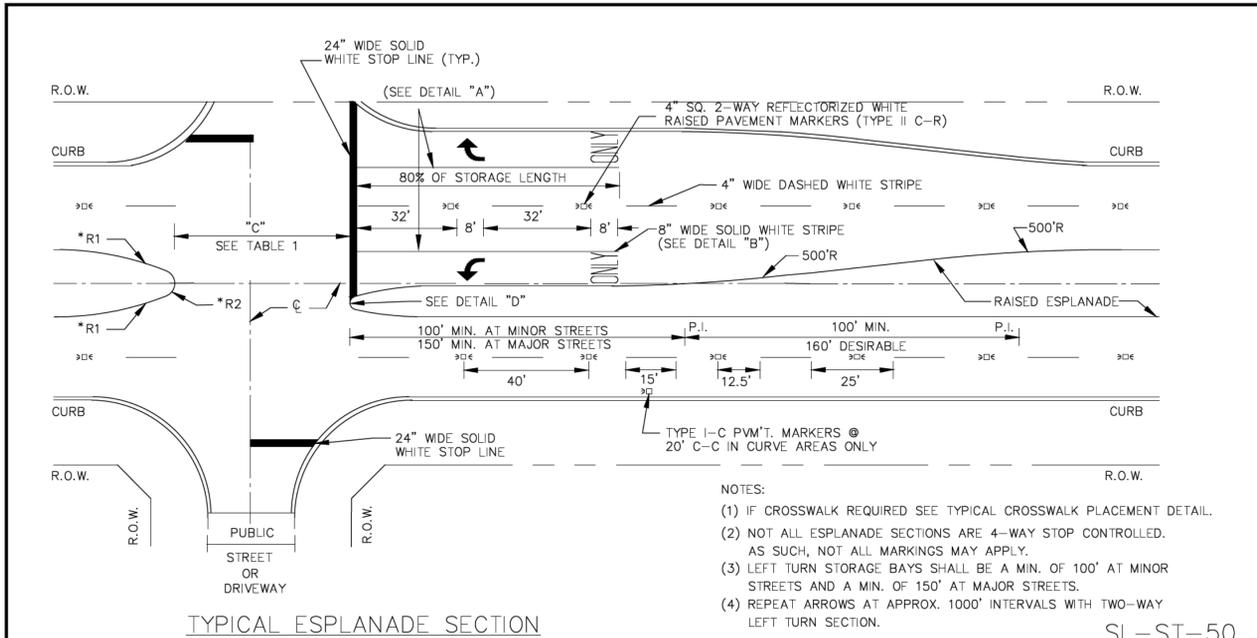




**TABLE 1**  
TYPICAL MEDIAN OPENING "C"

MEDIAN INTERRUPTION	(1) NO LTB	(1) 1 LTB	(1) 2 LTB
PRIVATE DRIVE	45'	52.5'	60'
UNDIVIDED STREET	<40' 44'	45' 50' 52.5' (2) 55' (2)	60' 60'
DIVIDED STREET	D+22'	D+22'	D+22'

**NOTES:**  
 (1) LTB = LEFT TURN BAY  
 (2) DISTANCE FROM CENTERLINE OF OPENING TO MEDIAN NOSE WITH LEFT TURN LANE IS 30' FOR RIGHT ANGLE INTERSECTIONS, FOR INTERSECTIONS OTHER THAN 90°, APPLY DESIGN VEHICLE TURNING TEMPLATE TO DETERMINE DIMENSION TO MEDIAN NOSE CUT OFF.  
 (3) D = WIDTH OF DIVIDED STREET

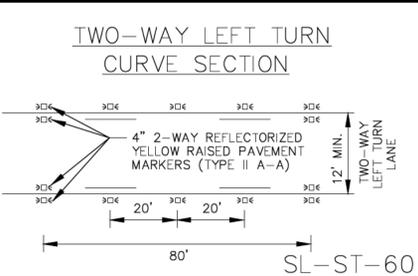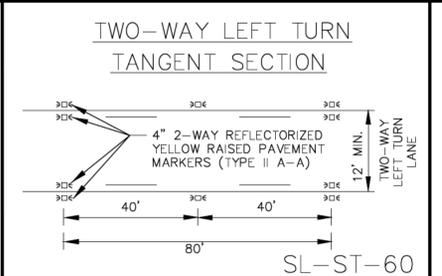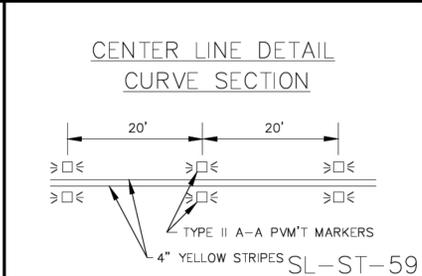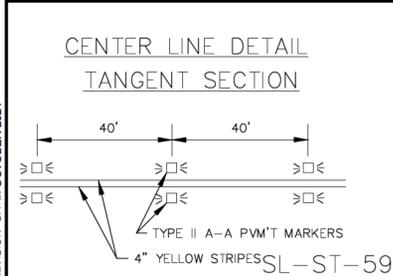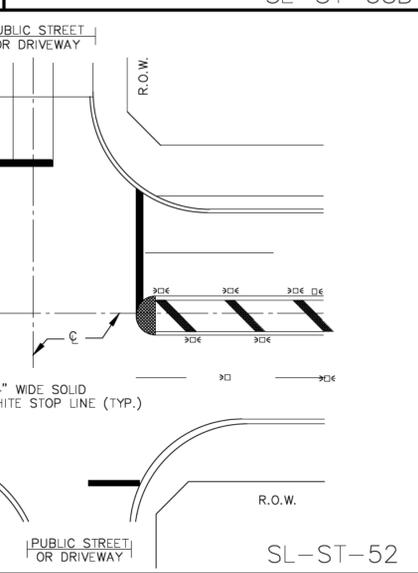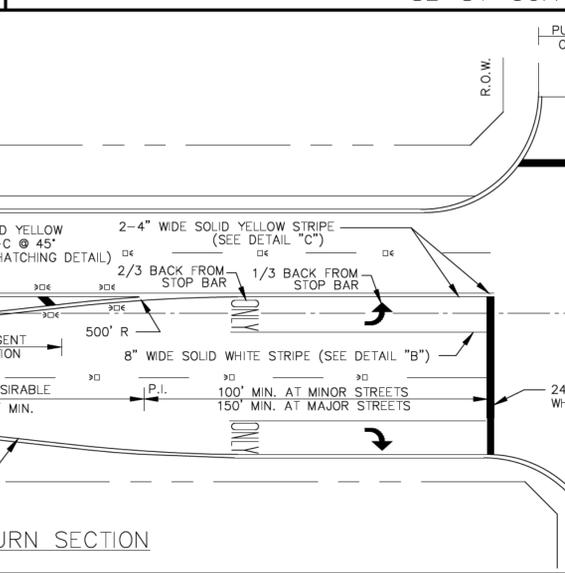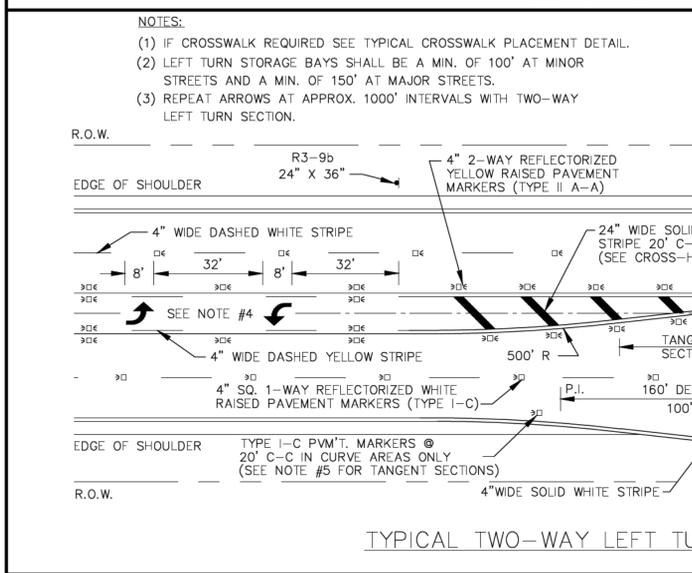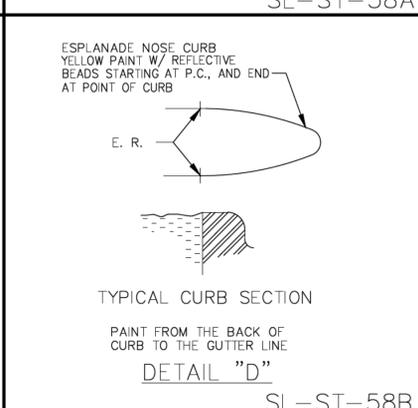

- NOTES:**
- ALL INTERSECTIONS WHERE A STOP SIGN IS LOCATED SHALL HAVE A STOP BAR. STOP BARS SHALL BE LOCATED WHERE PEDESTRIAN CROSSWALKS ARE PROVIDED, 4' BEHIND CROSSWALKS.
  - STOP BARS SHALL BE 24" WIDE, AND CONSIST OF SOLID WHITE LINES EXTENDING ACROSS APPROACH LANES TO INDICATE THE POINT AT WHICH THE STOP IS INTENDED OR REQUIRED TO BE MADE.
  - ON APPROACH - BEGINNING WITH STOP BAR, INSTALL A 4" WIDE SOLID WHITE LINE FOR 50 FT BACK FROM STOP BAR SKIP 25' AND BEGIN NORMAL NORMAL LANE LINES.
  - ON EXIT - BEGINNING WITH CROSSWALK, OR 12' FROM CURB LINE OF INTERSECTING STREET, INSTALL A 4" WIDE SOLID WHITE LINE FOR 50' AND BEGIN NORMAL LANE LINE.
  - CROSSWALKS SHALL BE A MINIMUM INSIDE WIDTH OF 5' AT LOCATIONS WHERE ADDITIONAL VISIBILITY IS REQUIRED, WHERE TRAFFIC CONTROL DEVICES ARE NOT PRESENT, AND IN SCHOOL ZONES CONTINENTAL CROSSWALKS SHALL BE USED.
  - ALL PAVEMENT MARKINGS WITHIN CITY ROW SHALL BE THERMOPLASTIC (GRADES AND ABOVE) IN ACCORDANCE WITH C.O.S.L. APPROVED PRODUCT LIST.
  - PAVEMENT MARKINGS MUST BE SHOWN ON THE APPROVED CONSTRUCTION PLANS. ALL PAVEMENT MARKINGS MUST BE RETRO-REFLECTIVE MATERIAL APPLIED TO THE ROAD SURFACE IN A MOLTEN STATE BY SCREED/EXTRUSION SUSPENDED EXTRUSION, OR SPRAY MEANS, WITH A SURFACE APPLICATION OF GLASS BEADS.
  - THE COLOR OF RAISED PAVEMENT MARKERS UNDER BOTH DAYLIGHT AND NIGHTTIME CONDITIONS SHALL CONFORM TO THE COLOR OF THE MARKING FOR WHICH THEY SERVE AS A POSITIONING GUIDE OR FOR WHICH THEY SUPPLEMENT OR SUBSTITUTE.
  - ALL TRAFFIC BUTTONS AND MARKERS SHALL BE INSTALLED ADJACENT TO STRIPES (APPROX. 2').
  - ALL BUTTONS SHALL BE INSTALLED WITH AN APPROVED EPOXY.
  - A BLUE REFLECTORIZED BUTTON SET 6" OFF CENTERLINE OF ROADWAY SHALL BE INSTALLED ADJACENT TO ALL FIRE HYDRANTS.
  - PAVEMENT SURFACE AREAS PRIOR TO PLACEMENT OF PAVEMENT MARKINGS AND/OR RAISED PAVEMENT MARKERS SHALL BE CLEANED IN ACCORDANCE WITH C.O.S.L. STANDARDS. CONCRETE SURFACES SHALL BE CLEANED BY ABRASIVE BLASTING MEDIUM. ASPHALT PAVEMENT SURFACES SHALL BE CLEANED BY BRUSHING, WASHING, COMPRESSED AIR, AND/OR HIGH-PRESSURE WATER. AREAS MUST BE FREE OF CURING MEMBRANCE, DIRT, GREASE, LOOSE AND/OR FLAKING EXISTING MARKERS AND OTHER FORMS OF DEBRIS.
  - ALL ESPLANADE NOSES, AND CURBS IN LEFT TURN BAYS SHALL BE PAINTED WITH YELLOW REFLECTORIZED PAINT, AND SHALL COMPLY WITH THE TEXAS MANUAL ON UNIFORM TRAFFIC DEVICES, A.D.A., T.A.S., AND C.O.S.L. STANDARDS AND ALL REVISIONS THEREOF.
  - ALL ROADWAYS WITHOUT CURB SHALL HAVE A SOLID 4" WHITE REFLECTORIZED STRIPE 12" INSIDE THE EDGE OF PAVEMENT.
  - WITHIN A TANGENT SECTION THE TYPE I-C PAVEMENT MARKERS CAN BE PLACED AT 40' C-C ON ROADWAYS WITHOUT CURB AND GUTTERS.
  - ALL STREET CROSSINGS SHALL COMPLY WITH T.A.S. AND A.D.A., SEE HANDICAP CROSS DETAIL.
  - ALL PAVEMENT MARKINGS, AND/OR RAISED PAVEMENT MARKERS SHALL COMPLY WITH THE TEXAS MANUAL ON UNIFORM TRAFFIC DEVICES, A.D.A., T.A.S., AND C.O.S.L. STANDARDS AND ALL REVISIONS THEREOF.
  - ALL MARKINGS SHALL HAVE A UNIFORM CROSS-SECTION, AND THE DENSITY AND QUALITY OF THE MARKING'S SHALL BE UNIFORM THROUGHOUT THEIR THICKNESS.
  - PAVEMENT MARKING'S PLACED THAT ARE NOT IN ALIGNMENT OR SEQUENCE, AS SHOWN ON THE PLANS OR STATED IN THE PROJECT SPECIFICATION'S SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE.
  - FOR SKEW INTERSECTIONS AND STREET WIDTHS NOT SHOWN, COORDINATE WITH THE C.O.S.L., ENGINEERING DEPARTMENT AT (281) 275-2780.
  - PRIOR TO PLACING MARKING, CONTACT COSL TO COORDINATE AND REVIEW IN THE FIELD. COORDINATE WITH THE C.O.S.L., ENGINEERING DEPARTMENT AT (281) 275-2780

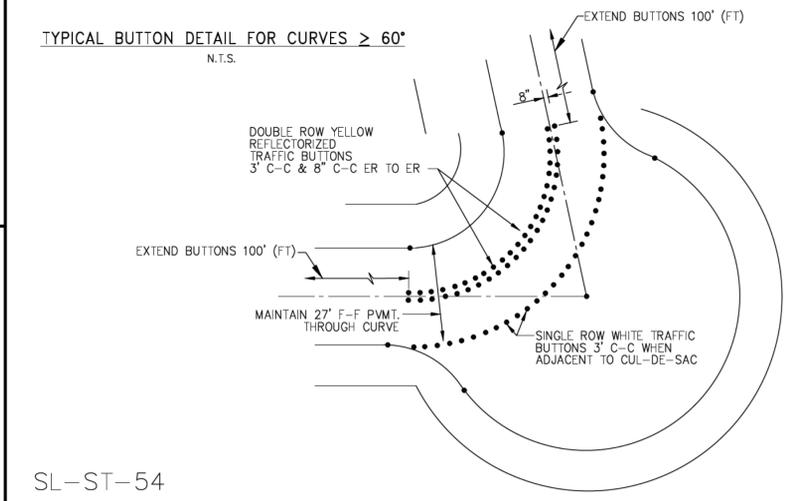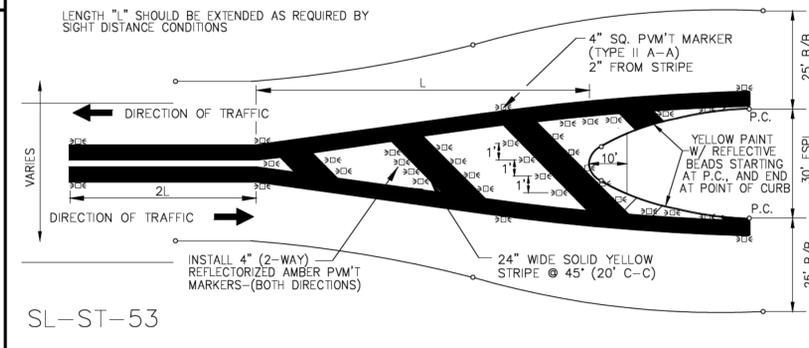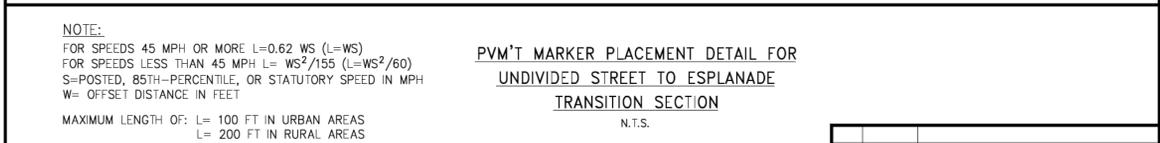

No.	DATE	REVISION

SEAL: \_\_\_\_\_ DATE: \_\_\_\_\_

DESIGN ENGINEER: \_\_\_\_\_

**CITY OF SUGAR LAND, TEXAS**  
ENGINEERING DEPARTMENT


CONSTRUCTION PLANS FOR:

**PAVEMENT MARKING DETAILS**

JOB No.: \_\_\_\_\_  
 DATE: \_\_\_\_\_  
 DRAWN BY: \_\_\_\_\_  
 CHECKED BY: \_\_\_\_\_  
 SCALE: \_\_\_\_\_


**SL-28**  
SHEET OF \_\_\_\_\_

REVISION DATE: OCTOBER 2021

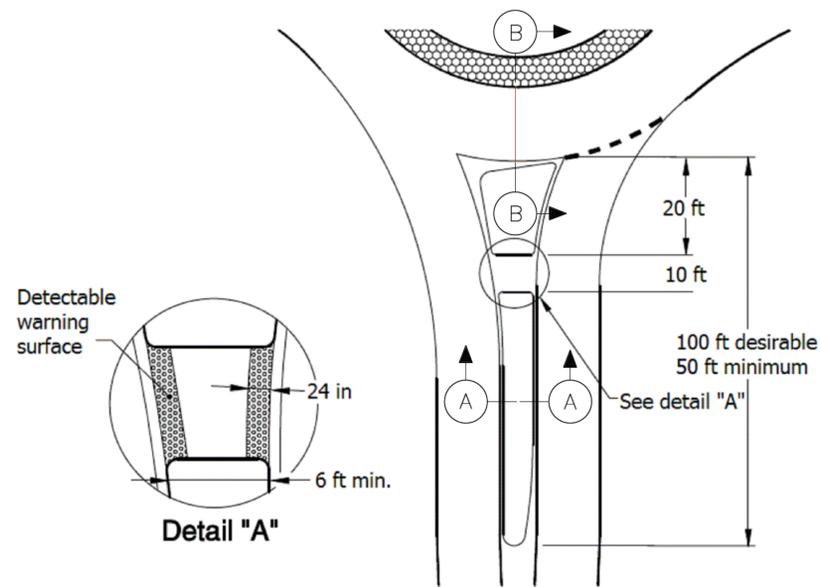

SPLITTER ISLAND DIMENSIONS  
N.T.S

SL-RB-01

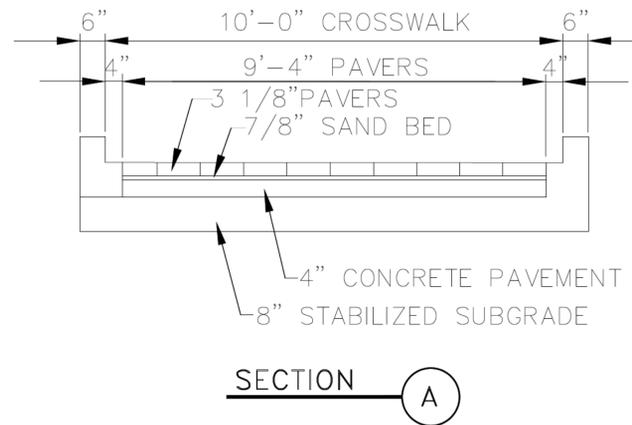


CROSS SECTION OF SPLITTER ISLAND CUT THROUGH

SL-RB-03

SL-RB-06


GENERAL NOTES

- CROSSWALK AND TRUCK APRON PAVERS SHALL BE PAVESTONE 80MIL OR APPROVED EQUAL
- ADJUST SAND BED TO MATCH TOP OF PAVERS FLUSH WITH TOP OF 4" MOUNTABLE CURB

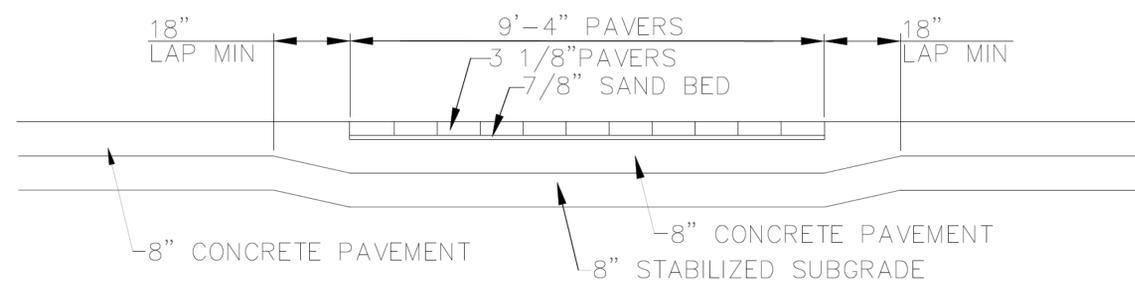

CROSS SECTION OF CROSS WALK WITH PAVERS

SL-RB-04

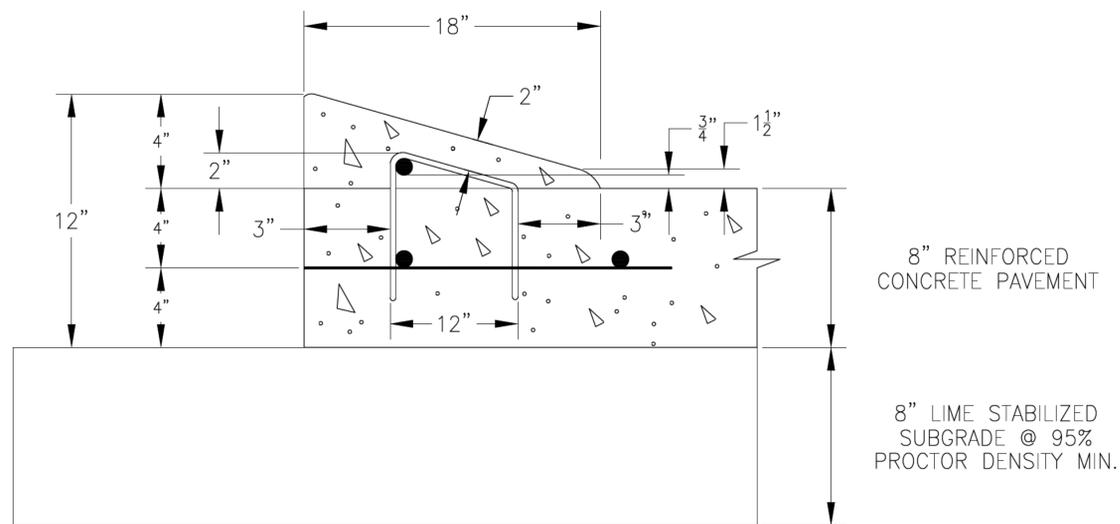


4"x18" MOUNTABLE CURB DETAIL FOR ROUNDABOUT  
N.T.S

SL-RB-02

NOTES

- 1.0 LBS. OF APPROVED NON-METALLIC FIBER MESH PER C/Y IN 4"x18" CURBS.
- #3 RE-BAR STIRRUPS TO BE PLACED AT INTERVALS OF 2' (FT) C-C.
- #4 RE-BAR LONGITUDINAL SHALL BE TIED TO EACH STIRRUP.

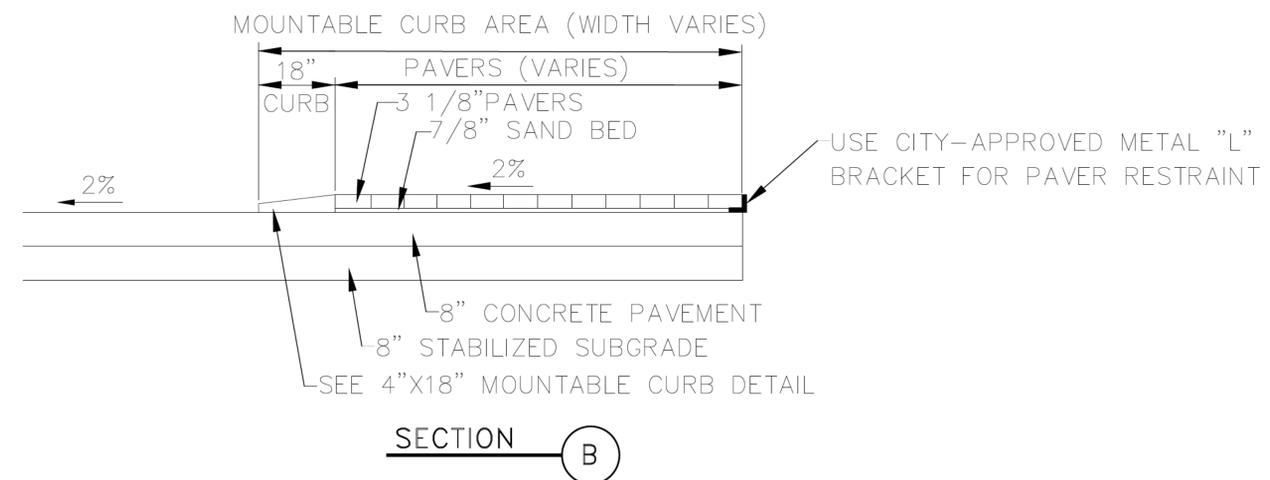

CROSS SECTION OF TRUCK APRON

SL-RB-05

No.	DATE	REVISION

DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:

ROUNDABOUT CONSTRUCTION DETAILS I


JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-29  
SHEET OF






**WEDGE ANCHOR SYSTEM**

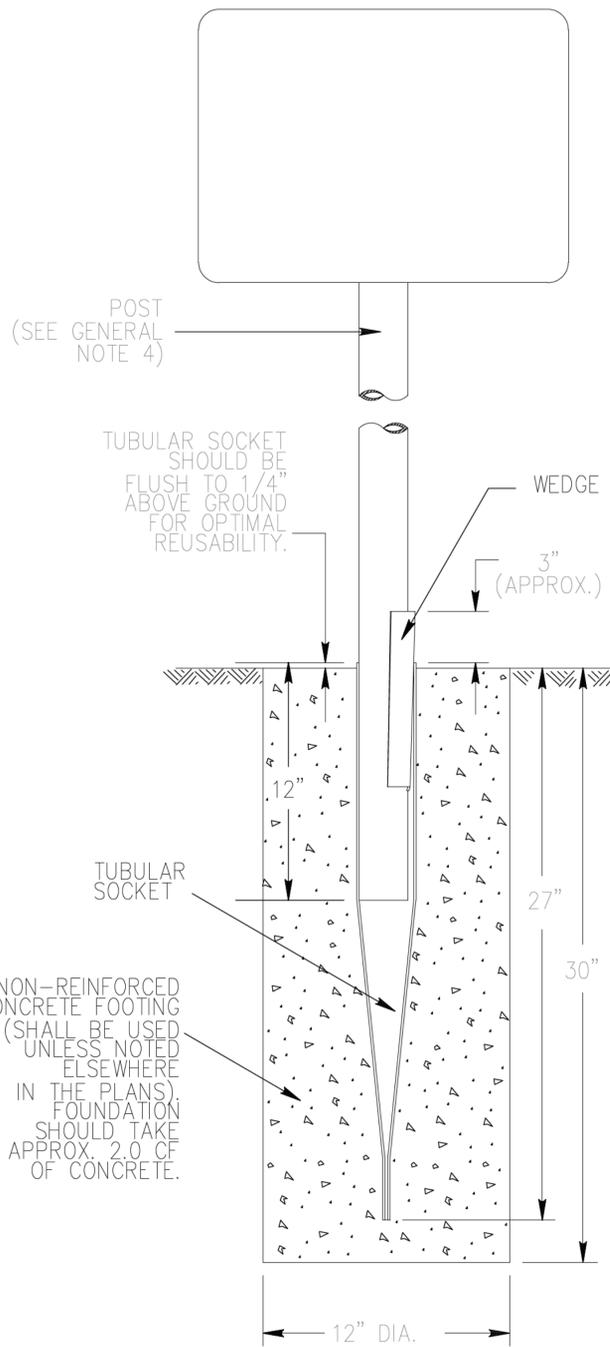

SM RD SGN ASSM TY TWT(X)WA(P)

SL-ST-62

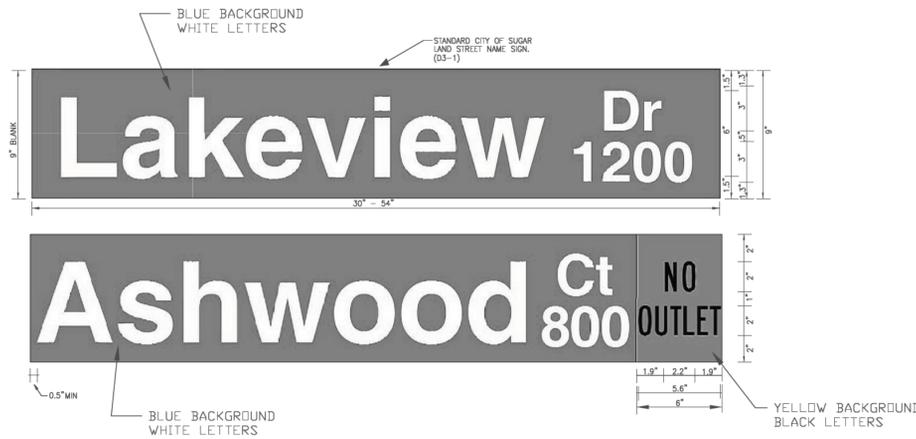

**DETAIL OF STANDARD STREET NAME SIGN**

**NOTES:**

1. HELVETICA BOLD, MEDIUM STYLE; WITH 6" UPPER CASE LETTERS AND 4" LOWER CASE LETTERS.
2. REFER TO C.O.S.L. DESIGN STANDARDS FOR MORE INFO.
3. "NO OUTLET" USE HIGHWAY B PLUS FONT. NO OUTLET TO BE PLACED ON THE SAME SIGN END FOR DOUBLE-SIDED STREET NAME SIGNS.

SL-ST-66

**NOTICE TO BE AFFIXED TO THE BACK OF ALL COSL STREET SIGNS**




**SIGN I.D. TAG DETAIL**

SL-ST-68

**MAST ARM:**


1. 2-EACH ASTRO FOR 4 SECTION AND LARGER TRAFFIC SIGNAL HEADS.

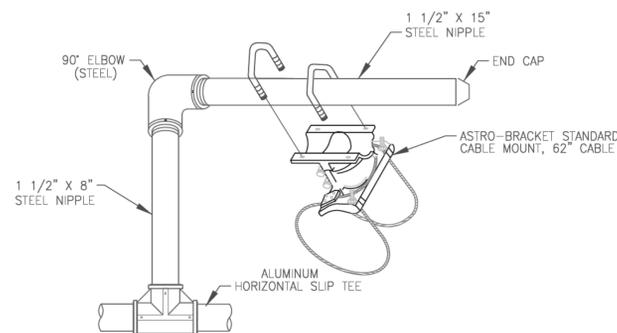

NOTE: ROTATE TEE ACCORDING TO PLANS

**ASTRO BRACKET CABLE MOUNT DETAIL**

SL-ST-63

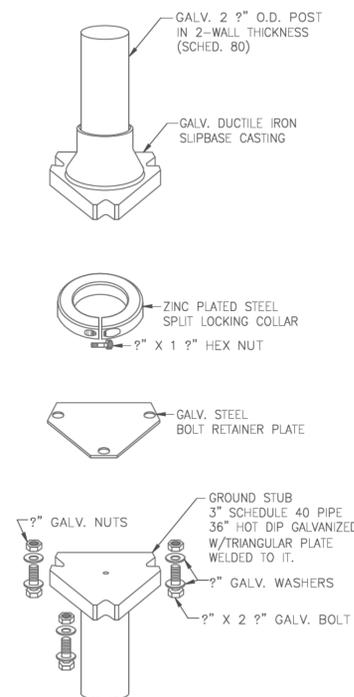

**POZ-LOCK SLIPBASE SYSTEM**


N.T.S.

SL-ST-64

**GENERAL CONSTRUCTION NOTES:**

1. SECURELY ATTACH STREET NAME SIGN TO TRAFFIC SIGNAL SUPPORT WIRES WITH MULTI-LEVELING, WIND DUMPING BRACKETS.
2. SUPPORT WIRES SHOULD NOT BE PROHIBITED FROM INDEPENDENT MOVEMENT.
3. INSTALL ONE STREET NAME SIGN APPROXIMATE 2" FROM POLE ABOVE ON-COMING TRAFFIC ON EACH TRAFFIC SIGNAL SPAN.
4. THE FIRST LETTER OF EACH WORD SHALL BE UPPER CASE, SUBSEQUENT LETTERS SHALL BE LOWER CASE, ALL INDIVIDUAL LETTERS FOR EXAMPLE "F.M." SHALL BE UPPER CASE. STREET SUFFIXES & "NO OUTLET" SHALL BE UPPER CASE.
5. ALL SHEETING SHALL BE "DIAMOND GRADE" OR APPROVED EQUAL.
6. USE ANODIZED BLANKS ONLY.
7. STREET SIGN FONTS SHALL BE HELVETICA BOLD, MEDIUM STYLE.
8. MINIMUM SIGN THICKNESS: 9" SIGNS = .080", 14" SIGNS = .1875"
9. FOR SIGNS LOCATED IN A STATE-HIGHWAY ROW CONSULT WITH CITY'S TRAFFIC DEPARTMENT FOR DETAILS

SL-ST-68

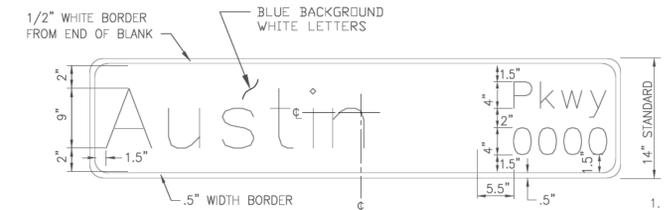

**DETAIL OF SIGN FOR MAST FOR TRAFFIC SIGNAL POLES**

CORNER RADII = 2"  
PLINE WIDTH = .5"

**NOTES:**

1. HELVETICA BOLD, MEDIUM STYLE; WITH 9" UPPER CASE LETTERS AND 6" LOWER CASE LETTERS. REFER TO C.O.S.L. DESIGN STANDARDS FOR MORE INFO.
2. SIGNS WITHIN STATE ROW SHALL MEET STATE STANDARDS.
3. SIGNS WITHIN STATE ROW SHALL MEET STATE STANDARDS.

SL-ST-67

No.	DATE	REVISION

DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:

SIGN  
CONSTRUCTION DETAILS

JOB No.: \_\_\_\_\_  
DATE: \_\_\_\_\_  
DESIGNED BY: \_\_\_\_\_  
DRAWN BY: \_\_\_\_\_  
CHECKED BY: \_\_\_\_\_  
SCALE: \_\_\_\_\_

SL-32

SHEET OF

SL-ST-65

HYPER-CHLORINATED WATER NOTES

1. HYPER-CHLORINATED WATER SHALL NOT BE DISCHARGED TO THE STORM SEWER OR DRAINAGE SYSTEM UNLESS THE CHLORINE CONCENTRATION IS REDUCED TO 4 PPM OR LESS BY CHEMICALLY TREATING THE DECHLORINATE OR BY ONSITE RETENTION UNTIL NATURAL ATTENUATION OCCURS.
2. DISCHARGE OF HIGH FLOW RATE AND VELOCITIES SHALL BE DIRECTED TO VELOCITY DISSIPATION DEVICES.
3. CHLORINE CAN BURN VEGETATION, SO IT SHOULD NOT BE USED TO WATER VEGETATION THAT IS BEING USED FOR STABILIZATION, VEGETATED FILTERS OR BUFFERS, OR OTHER VEGETATION TO BE PRESERVED.
4. HYPER-CHLORINATED WATER MAY BE DISCHARGED TO AN ONSITE RETENTION AREA UNTIL NATURAL ATTENUATION OCCURS. THE AREA MAY BE A DRY STORMWATER RETENTION BASIN, OR A PORTION OF THE SITE MAY BE GRADED TO FORM A TEMPORARY PIT OR BERMED AREA.
5. NATURAL ATTENUATION OF THE CHLORINE MAY BE AIDED BY AERATION. AIR CAN BE ADDED TO THE WATER BY DIRECTING THE DISCHARGE OVER A ROUGH SURFACE BEFORE IT ENTERS THE TEMPORARY RETENTION AREA OR AN AERATION DEVICE CAN BE PLACED IN THE RETENTION AREA.
6. ONSITE DISCHARGE MAY REQUIRE SEVERAL HOURS TO A FEW DAYS BEFORE THE WATER IS SAFE TO DISCHARGE. THE RATE AT WHICH CHLORINE WILL ATTENUATE IS AFFECTED BY SOIL CONDITIONS AND WEATHER CONDITIONS. ATTENUATION WILL OCCUR QUICKEST DURING WARM, SUNNY, AND DRY PERIODS.

SANITARY WASTE NOTES

1. THE CONTRACTOR SHALL PROVIDE AN APPROPRIATE NUMBER OF PORTABLE TOILETS BASED ON THE NUMBER OF EMPLOYEES USING THE TOILETS AND THE HOURS THEY WILL WORK.
2. SANITARY FACILITIES SHALL BE PLACED ON A MINIMUM OF 50 FEET AWAY FROM STORM DRAIN INLETS, CONVEYANCE, CHANNELS OR SURFACE WATERS. IF UNABLE TO MEET THE 50 FOOT REQUIREMENT DUE TO SITE CONFIGURATION, PORTABLE TOILETS SHALL BE A MINIMUM OF 20 FEET AWAY FROM STORM DRAIN INLETS, CONVEYANCE CHANNELS OR SURFACE WATER AND SECONDARY CONTAINMENT SHALL BE PROVIDED IN CASE OF SPILLS.
3. THE LOCATION OF THE PORTABLE TOILETS SHALL BE ACCESSIBLE TO MAINTENANCE TRUCKS WITHOUT DAMAGING EROSION AND SEDIMENT CONTROLS OR CAUSING EROSION OR TRACKING PROBLEMS.
4. SANITARY FACILITIES SHALL BE FULLY ENCLOSED AND DESIGNED IN A MANNER THAT MINIMIZES THE EXPOSURE OF SANITARY WASTE TO PRECIPITATION AND STORMWATER RUNOFF.
5. WHEN HIGH WINDS ARE EXPECTED, PORTABLE TOILETS SHALL BE ANCHORED OR OTHERWISE SECURED TO PREVENT THEM FROM BEING BLOWN OVER.
6. THE COMPANY THAT SUPPLIES AND MAINTAINS THE PORTABLE TOILETS SHALL BE NOTIFIED IMMEDIATELY IF A TOILET IS TIPPED OVER OR DAMAGED IN A WAY THAT THE RESULTS IN A DISCHARGE. DISCHARGED SOLID MATTER SHALL BE VACUUMED INTO A SEPTIC TRUCK BY THE COMPANY THAT MAINTAINS THE TOILETS.
7. THE OPERATOR OF THE MUNICIPAL SEPARATE STORM SEWER SYSTEM (MS4) SHALL BE NOTIFIED IF A DISCHARGE FROM THE PORTABLE TOILETS ENTERS THE MS4 OR A NATURAL CHANNEL.
8. SANITARY FACILITIES SHALL NOT BE PERMITTED ON PUBLIC SIDEWALKS, STREETS OR INLETS.

DEBRIS AND TRASH NOTES

1. ALL WASTE SOURCES AND STORAGE AREAS SHALL BE LOCATED A MINIMUM OF 50 FEET AWAY FROM INLETS, SWALES, DRAINAGE WAYS, CHANNELS AND OTHER WATERS, IF THE SITE CONFIGURATION PROVIDES SUFFICIENT SPACE TO DO SO. IN NO CASE SHALL MATERIAL AND WASTE SOURCES BE CLOSER THAN 20 FEET FROM INLETS, SWALES, DRAINAGE WAYS, CHANNELS, AND OTHER WATERS.
2. CONSTRUCTION WASTE AND TRASH SHALL BE STORED IN A MANNER THAT MINIMIZES ITS EXPOSURE TO PRECIPITATION AND STORMWATER RUNOFF.
3. WHENEVER POSSIBLE, MINIMIZE PRODUCTION OF DEBRIS AND TRASH.
4. INSTRUCT CONSTRUCTION WORKERS IN PROPER DEBRIS AND TRASH STORAGE AND HANDLING PROCEDURES.
5. SEGREGATE POTENTIAL HAZARDOUS WASTE FROM NON-HAZARDOUS CONSTRUCTION SITE DEBRIS.
6. PROHIBIT LITTERING BY WORKERS AND VISITORS.
7. POLICE SITE DAILY FOR LITTER AND DEBRIS.
8. ENFORCE SOLID WASTE HANDLING AND STORAGE PROCEDURES.
9. IF FEASIBLE, RECYCLE CONSTRUCTION AND DEMOLITION DEBRIS SUCH AS WOOD, METAL, AND CONCRETE.
10. TRASH AND DEBRIS SHALL BE REMOVED FROM THE SITE AT REGULAR INTERVALS THAT ARE SCHEDULED TO EMPTY CONTAINERS WHEN THEY ARE 90 PERCENT FULL OR MORE FREQUENTLY.
11. GENERAL CONSTRUCTION DEBRIS MAY BE HAULED TO A LICENSED CONSTRUCTION DEBRIS LANDFILL.
12. USE WASTE AND RECYCLING HAULERS/FACILITIES APPROVED BY THE LOCAL MUNICIPALITY.
13. CHIPPING OF TREES AND BRUSH FOR USE SUCH AS MULCH IS PREFERRED ALTERNATIVE TO OFFSITE DISPOSAL.
14. NO WASTE, TRASH, OR DEBRIS SHALL BE BURIED, BURNED OR OTHER WISE DISPOSED OF ONSITE.
15. CLEARLY MARK ON ALL DEBRIS AND TRASH CONTAINERS WHICH MATERIALS ARE ACCEPTABLE. FOREMAN AND/OR CONSTRUCTION SUPERVISOR SHALL MONITOR ONSITE SOLID WASTE STORAGE AND DISPOSAL PROCEDURES DAILY.

CONCRETE SAWCUTTING WASTE NOTES

1. DURING SAWCUTTING OPERATIONS, THE SLURRY AND CUTTINGS SHALL BE CONTINUOUSLY VACUUMED OR OTHERWISE RECOVERED AND NOT BE ALLOWED TO DISCHARGE FROM THE SITE.
2. IF THE PAVEMENT TO BE CUT IS NEAR A STORM DRAIN INLET, THE INLET SHALL BE BLOCKED BY SANDBAGS OR EQUIVALENT TEMPORARY MEASURES TO PREVENT THE SLURRY FROM ENTERING THE INLET. REMOVE THE SANDBAGS IMMEDIATELY AFTER COMPLETING SAWCUTTING OPERATIONS, SO THEY DO NOT CAUSE DRAINAGE PROBLEMS DURING STORM EVENTS.
3. SLURRY AND CUTTINGS SHALL NOT BE ALLOWED TO REMAIN ON THE PAVEMENT TO DRY OUT.
4. DEVELOP PRE-DETERMINED, SAFE SLURRY DISPOSAL AREAS.
5. COLLECTED SLURRY AND CUTTINGS SHOULD BE IMMEDIATELY HAULED FROM THE SITE FOR DISPOSAL AT A WASTE FACILITY. IF THIS IS NOT POSSIBLE, THE SLURRY AND CUTTINGS SHALL BE DISCHARGED INTO ONSITE CONTAINMENT.
6. THE ONSITE CONTAINMENT MAY BE EXCAVATED OR BERMED PIT LINED WITH PLASTIC MINIMUM OF 10 MILLIMETERS THICK. IF THE PROJECT INCLUDES PLACEMENT OF NEW CONCRETE, SLURRY FROM SAWCUTTING MAY BE DISPOSED OF IN FACILITIES DESIGNATED FOR THE WASHOUT OF CONCRETE TRUCKS INSTEAD CONSTRUCTING A SEPARATE CONTAINMENT.
7. THE CONTAINMENT SHALL BE LOCATED A MINIMUM OF 50 FEET AWAY FROM INLETS, SWALES, DRAINAGE WAYS, CHANNELS, AND OTHER WATERS, IF THE SITE CONFIGURATION PROVIDES SUFFICIENT SPACE TO DO SO. IN NO CASE SHALL THE COLLECTION AREA BE CLOSER THAN 20 FEET FROM INLETS, SWALES, DRAINAGE WAYS, CHANNELS AND OTHER WATERS.
8. SEVERAL, PORTABLE, PRE-FABRICATED, CONCRETE WASHOUT, COLLECTION BASINS ARE COMMERCIALY AVAILABLE AND ARE AN ACCEPTABLE ALTERNATIVE TO AN ONSITE CONTAINMENT PIT.
9. REMOVE WASTE CONCRETE WHEN THE CONTAINMENT IS HALF FULL. ALWAYS MAINTAIN A MINIMUM OF ONE FOOT FREEBOARD.
10. ONSITE EVAPORATION OF SLURRY WATER AND RECYCLING OF THE CONCRETE WASTE IS THE PREFERRED DISPOSAL METHOD. WHEN THIS IS NOT FEASIBLE, DISCHARGE FROM THE COLLECTION AREA SHALL ONLY BE ALLOWED IF A PASSIVE TREATMENT SYSTEM IS USED TO REMOVE THE FINES. MECHANICAL MIXING IS REQUIRED IN THE COLLECTION AREA. THE pH MUST BE TESTED, AND DISCHARGED IS ALLOWED IN IF THE pH DOES NOT EXCEED 8.0. THE pH MAY BE LOWERED BY ADDING SULFURIC ACID TO THE SLURRY WATER.
11. CARE SHALL BE EXERCISED WHEN TREATING THE SLURRY WATER FOR DISCHARGE. MONITORING MUST BE IMPLEMENTED TO VERIFY THAT DISCHARGES FROM THE COLLECTION AREA DO NOT VIOLATE GROUNDWATER OR SURFACE WATER QUALITY STANDARDS.
12. GEOTEXTILE FABRICS SUCH AS THOSE USED FOR SILT FENCE SHOULD NOT BE USED TO CONTROL SAWCUTTING WASTE, SINCE THE GRAIN SIZE IS SIGNIFICANTLY SMALLER THAN THE APPARENT OPENING SIZE OF THE FABRIC.

SPILL AND LEAK RESPONSE NOTES

1. RECORDS OF RELEASES THAT EXCEED THE REPORTABLE QUANTITY (RQ) FOR OIL AND HAZARDOUS SUBSTANCES SHOULD BE MAINTAINED IN ACCORDANCE WITH THE FEDERAL AND STATE REGULATIONS.
2. EMERGENCY CONTACT INFORMATION AND SPILL RESPONSE PROCEDURES SHALL BE POSTED IN A READILY AVAILABLE REA FOR ACCESS BY ALL EMPLOYEES AND SUBCONTRACTORS.
3. SPILL CONTAINMENT KITS SHOULD BE MAINTAINED FOR PETROLEUM PRODUCTS AND OTHER CHEMICALS THAT ARE REGULARLY ONSITE. MATERIALS IN KITS SHOULD BE BASED ON CONTAINMENT GUIDELINES IN THE MATERIALS SAFETY AND DATA SHEETS (MSDS) FOR THE SUBSTANCE MOST FREQUENTLY ONSITE.
4. SPILL KITS ARE INTENDED FOR RESPONSE TO SMALL SPILLS, TYPICALLY LESS THAN 5 GALLONS, OF SUBSTANCES THAT ARE NOT EXTREMELY HAZARDOUS.
5. SIGNIFICANT SPILLS OR OTHER RELEASES WARRANT IMMEDIATE RESPONSE BY TRAINED PROFESSIONALS.
6. SUSPECTED JOB-SITE CONTAMINATION SHOULD BE IMMEDIATELY REPORTED TO REGULATORY AUTHORITIES AND PROTECTIVE ACTIONS TAKEN.
7. THE CONTRACTOR SHOULD BE REQUIRED TO DESIGNATE A SITE SUPERINTENDENT, FOREMAN, SAFETY OFFICER, OR OTHER SENIOR PERSON WHO IS ONSITE DAILY TO BE THE SPILL AND LEAK RESPONSE COORDINATOR (SLRC) AND MUST HAVE KNOWLEDGE OF AND BE TRAINED IN CORRECT SPILL AND LEAK RESPONSE PROCEDURES.

SUBGRADE STABILIZATION NOTES

1. MINIMIZE THE DISCHARGE OF THE CHEMICAL STABILIZERS BY THE CONTRACTOR LIMITING THE AMOUNT OF STABILIZING AGENT ONSITE TO THAT WHICH CAN BE THOROUGHLY MIXED AND COMPACTED BY THE END OF EACH WORKDAY.
2. STABILIZERS SHALL BE APPLIED AT RATES THAT RESULT IN NO RUN OFF.
3. STABILIZATION SHALL NOT OCCUR IMMEDIATELY BEFORE AND DURING RAINFALL EVENTS.
4. NO TRAFFIC OTHER THAN WATER TRUCKS AND MIXING EQUIPMENT SHALL BE ALLOWED TO PASS OVER THE AREA BEING STABILIZED UNTIL AFTER COMPLETION OF MIXING THE CHEMICAL.
5. AREA ADJACENT AND DOWNSTREAM OF STABILIZED AREAS SHALL BE ROUGHENED TO INTERCEPT CHEMICAL RUNOFF AND REDUCE RUNOFF VELOCITY.
6. GEOTEXTILE FABRICS SUCH AS THOSE USED FOR SILT FENCE SHOULD NOT BE USED TO TREAT CHEMICAL RUNOFF, BECAUSE THE CHEMICALS ARE DISSOLVED IN THE WATER AND WON'T BE AFFECTED BY A BARRIER AND THE SUSPENDED SOLIDS ARE SIGNIFICANTLY SMALLER THAN THE APPARENT OPENING SIZE OF THE FABRIC.
7. IF SOIL STABILIZERS ARE STORED ONSITE, THEY SHALL BE CONSIDERED HAZARDOUS MATERIAL AND SHALL BE MANAGED ACCORDING TO THE CRITERIA OF CHEMICAL MANAGEMENT TO CAPTURE ANY ACCIDENTAL LIME OR CHEMICAL OVERFLOW.
8. THE CONTRACTOR SHALL INSTALL BMP'S TO ALL INLETS AND OPENINGS CONNECTED TO THE STORM SEWER SYSTEMS TO PREVENT LIME FROM ENTERING THE MS4 SYSTEM.

SANDBLASTING WASTE NOTES

1. THE CONTRACTOR SHOULD BE REQUIRED TO DESIGNATE THE SITE SUPERINTENDENT, FOREMAN, OR OTHER PERSON WHO IS RESPONSIBLE FOR SANDBLASTING TO ALSO BE RESPONSIBLE FOR SANDBLASTING WASTE MANAGEMENT.
2. PROHIBIT THE DISCHARGE OF SANDBLASTING WASTE.
3. USE ONLY INERT, NON-DEGRADABLE SANDBLAST MEDIA.
4. USE APPROPRIATE EQUIPMENT FOR THE JOB; DO NOT OVER-BLAST.
5. WHENEVER POSSIBLE, BLAST IN A DOWNWARD DIRECTION.
6. CEASE BLASTING ACTIVITIES IN HIGH WINDS OR IF WIND DIRECTION COULD TRANSPORT GRIT TO DRAINAGE FACILITIES.
7. INSTALL DUST SHIELDING AROUND SANDBLASTING AREAS.
8. COLLECT AND DISPOSE OF ALL SPENT SANDBLAST GRIT, USE DUST CONTAINMENT FABRICS AND DUST COLLECTION HOPPERS AND BARRELS.
9. NON-HAZARDOUS SANDBLAST GRIT MAY BE DISPOSED IN PERMITTED CONSTRUCTION DEBRIS LANDFILLS OR PERMITTED SANITARY LANDFILLS.
10. IF SANDBLAST MEDIA CANNOT BE FULLY CONTAINED, CONSTRUCT SEDIMENT TRAPS DOWNSTREAM FROM BLASTING AREA WHERE APPROPRIATE.
11. USE SAND FENCING WHERE APPROPRIATE IN AREAS WHERE BLAST MEDIA CANNOT BE FULLY CONTAINED.
12. IF NECESSARY, INSTALL MISTING EQUIPMENT TO REMOVE SANDBLAST GRIT FROM THE AIR PREVENT RUNOFF FROM MISTING OPERATIONS FROM ENTERING DRAINAGE SYSTEMS.
13. USE VACUUM GRIT COLLECTION SYSTEMS WHERE POSSIBLE.
14. KEEP RECORDS OF SANDBLASTING MATERIALS, PROCEDURES, AND WEATHER CONDITIONS ON A DAILY BASIS.
15. TAKE ALL REASONABLE PRECAUTIONS TO ENSURE THAT SANDBLASTING GRIT IS CONTAINED AND KEPT AWAY FROM DRAINAGE STRUCTURES.
16. SAND BLASTING MEDIA SHOULD ALWAYS BE STORED UNDER COVER AWAY FROM DRAINAGE STRUCTURES.
17. ENSURE THAT STORED MEDIA OR GRIT IS NOT SUBJECTED TO TRANSPORT BY WIND.
18. ENSURE THAT ALL SANDBLASTING EQUIPMENT AND STORAGE CONTAINERS COMPLY WITH CURRENT LOCAL, STATE, AND FEDERAL REGULATIONS.
19. CAPTURE AND TREAT RUNOFF, WHICH COMES INTO CONTACT WITH SANDBLASTING MATERIALS OR WASTE.

No.	DATE	REVISION

SEAL: \_\_\_\_\_  
 \_\_\_\_\_ DATE \_\_\_\_\_  
 DESIGN ENGINEER:




CITY OF SUGAR LAND, TEXAS  
 ENGINEERING DEPARTMENT


CONSTRUCTION PLANS FOR:

GENERAL EROSION CONTROL NOTES

JOB No.:	SL-33
DATE:	
DESIGNED BY:	
DRAWN BY:	
CHECKED BY:	
SCALE:	SHEET OF

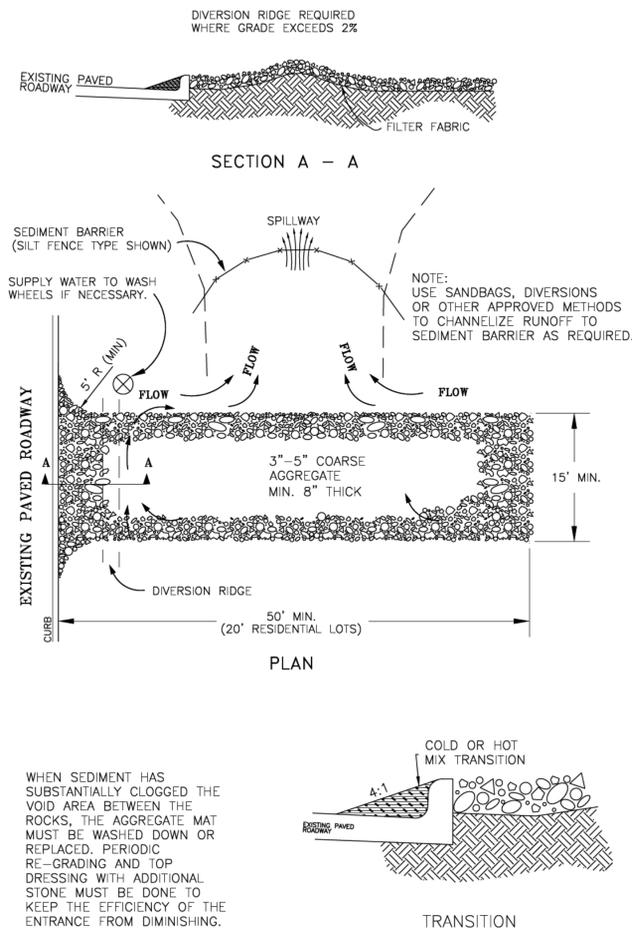

SL-ER-01

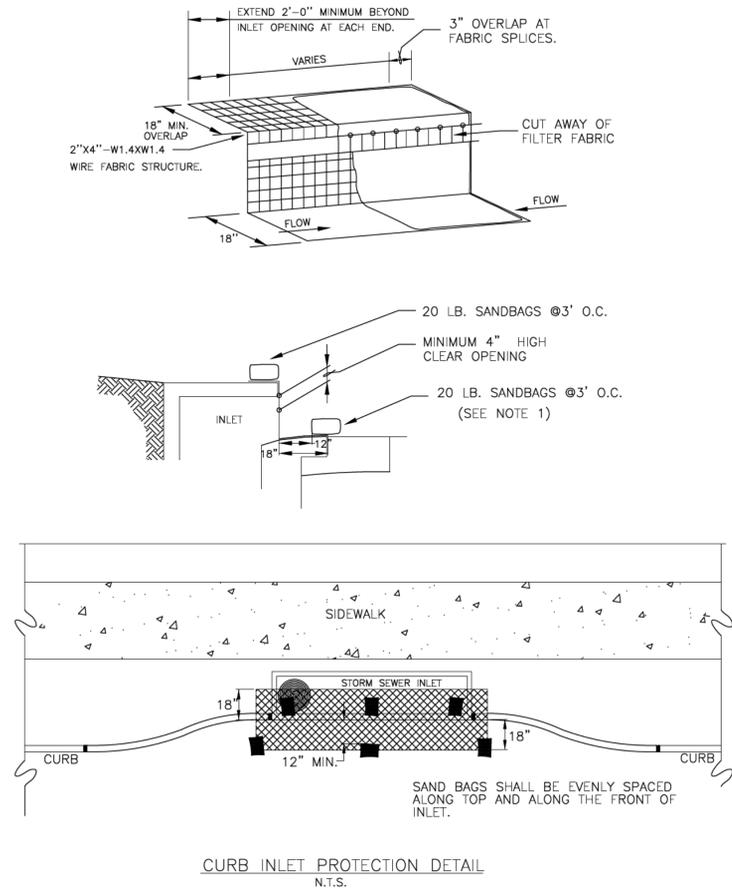


NOTES:

1. A SECTION OF FILTER FABRIC SHALL BE REMOVED AS SHOWN ON THIS DETAIL TO PROVIDE A 4" MINIMUM CLEAR OPENING. FABRIC MUST BE SECURED TO WIRE BACKING WITH CLIPS OR HOG RINGS AT THIS LOCATION
2. INSPECTION SHALL BE MADE BY CONTRACTOR AND SILT ACCUMULATION MUST BE REMOVED WHEN DEPTH REACHES 2".
3. CONTRACTOR SHALL MONITOR THE PERFORMANCE OF INLET PROTECTION DURING EACH RAINFALL EVENT AND IMMEDIATELY REMOVE THE INLET PROTECTION IF THE STORMWATER BEGINS TO OVERTOP THE CURB.
4. INLET PROTECTIONS SHALL BE REMOVED AS SOON AS THE SOURCE OF THE SEDIMENT IS STABILIZED.

INLET OPENING	MINIMUM NUMBER OF SAND BAGS	
	TOP	FRONT
5'	2	3
10'	3	3
15'	3	4
20'	4	4


SL-ER-02

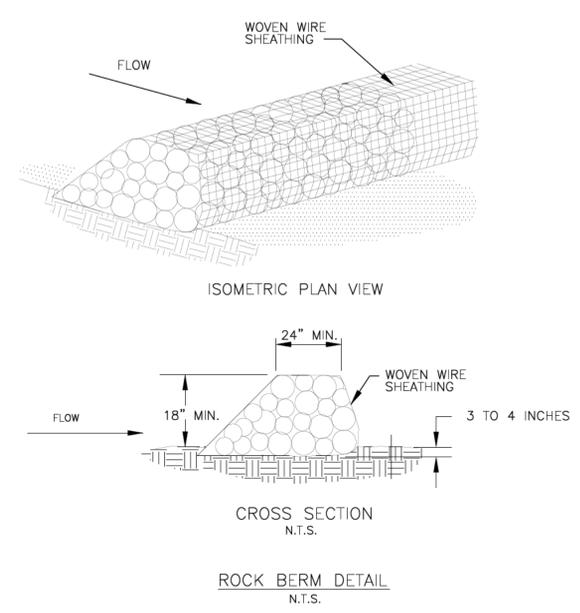


ROCK BERM GENERAL NOTES

1. USE ONLY OPEN GRADED ROCK 4-8 INCHES IN DIAMETER FOR STREAM FLOW CONDITION. USE OPEN GRADED ROCK 2-5 INCHES IN DIAMETER FOR OTHER CONDITIONS.
2. THE ROCK BERM SHALL BE SECURED WITH A WOVEN WIRE SHEATHING HAVING A MAXIMUM OPENING OF 1 INCH AND A MINIMUM WIRE SIZE OF 20 GAUGE AND SHALL BE BURIED IN A TRENCH APPROXIMATELY 3 TO 4 INCHES DEEP.
3. THE ROCK BERM SHALL BE INSPECTED EVERY TWO WEEKS OR AFTER EACH 1/2" RAIN EVENT AND SHALL BE REPLACED WHEN THE STRUCTURE CEASES TO FUNCTION AS INTENDED DUE TO SILT ACCUMULATION AMONG THE ROCKS, WASHOUT, CONSTRUCTION TRAFFIC DAMAGE, ETC.
4. WHEN SILT REACHES A DEPTH EQUAL TO ONE-THIRD OF THE HEIGHT OF THE BERM OR ONE FOOT, WHICHEVER IS LESS, THE SILT SHALL BE REMOVED AND DISPOSED OF PROPERLY.
5. WHEN THE SITE IS COMPLETELY STABILIZED, THE BERM AND ACCUMULATED SILT SHALL BE REMOVED AND DISPOSED OF IN AN APPROVED MANNER.
6. ROCK BERM SHOULD BE USED AS CHECK DAMS FOR CONCENTRATED FLOW AND ARE NOT INTENDED FOR USE IN PERIMETER PROTECTION.

SL-ER-03

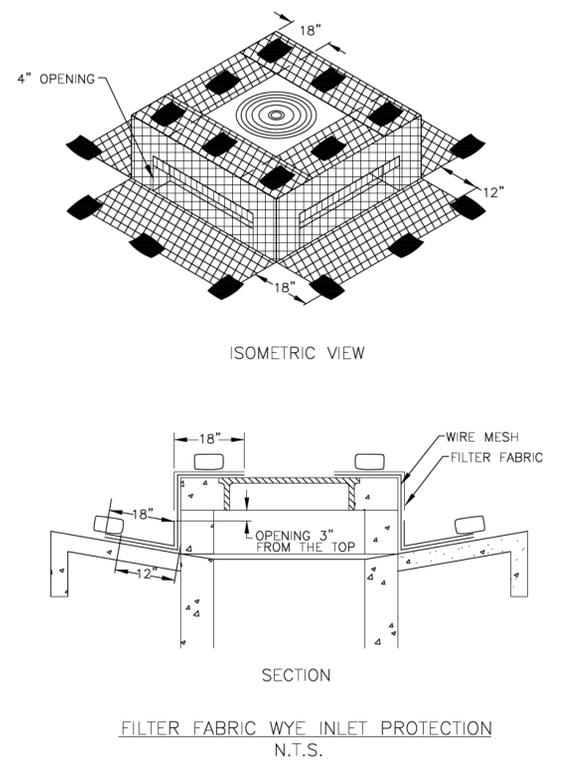


SL-ER-04

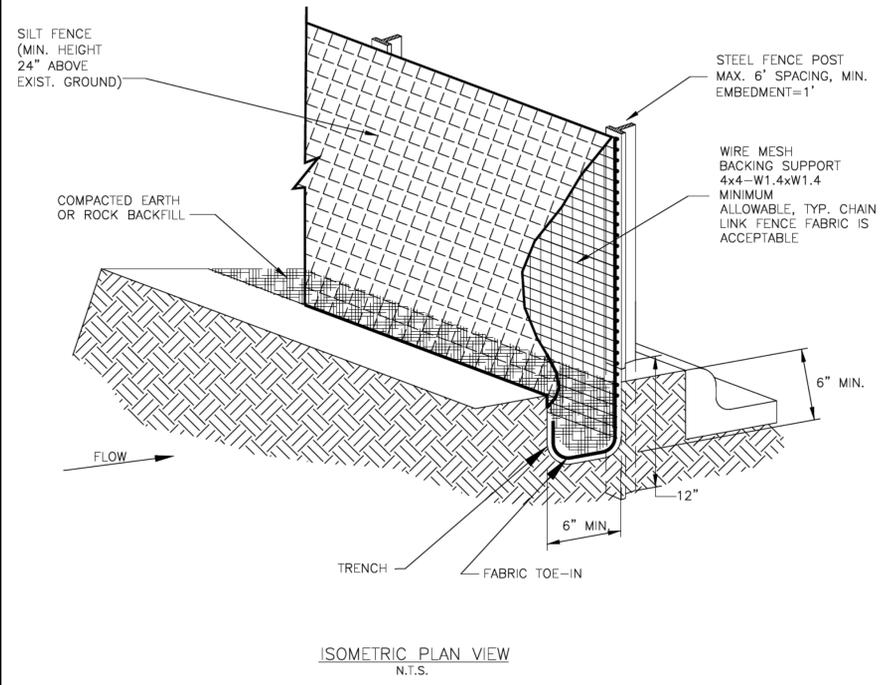

SILT FENCE GENERAL NOTES

1. STEEL POSTS WHICH SUPPORT THE SILT FENCE SHALL BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POST MUST BE EMBEDDED A MINIMUM OF ONE FOOT.
2. THE TOE OF THE SILT FENCE SHALL BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWNSLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW. WHERE FENCE CANNOT BE TRENCHED IN (E.G. PAVEMENT), WEIGHT FABRIC FLAP WITH ROCK ON UPHILL SIDE TO PREVENT FLOW FROM SEEPING UNDER FENCE.
3. THE TRENCH MUST BE A MINIMUM OF 6 INCHES DEEP AND 6 INCHES WIDE TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND AND BACKFILLED WITH COMPACTED MATERIAL.
4. SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IN TURN IS ATTACHED TO THE STEEL FENCE POST. THERE SHALL BE A 3' FOOT OVERLAP, SECURELY FASTENED WHERE ENDS OF FABRIC MEET.
5. INSPECTION SHALL BE MADE EVERY TWO WEEKS AND AFTER EACH 1/2" RAINFALL. REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
6. SILT FENCE SHALL BE REMOVED WHEN THE SITE IS COMPLETELY STABILIZED SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.
7. ACCUMULATED SILT SHALL BE REMOVED WHEN IT REACHES A DEPTH OF HALF THE HEIGHT OF THE FENCE. THE SILT SHALL BE DISPOSED OF AT AN APPROVED SITE AND IN SUCH A MANNER AS TO NOT CONTRIBUTE TO ADDITIONAL SILTATION.


NOTE: STONE OVERFLOW STRUCTURES OF OTHER OUTLET CONTROL DEVICES SHALL BE INSTALLED AT ALL LOW POINTS ALONG THE FENCE OR EVERY 300 FEET IF THERE IS NO APPARENT LOW POINT

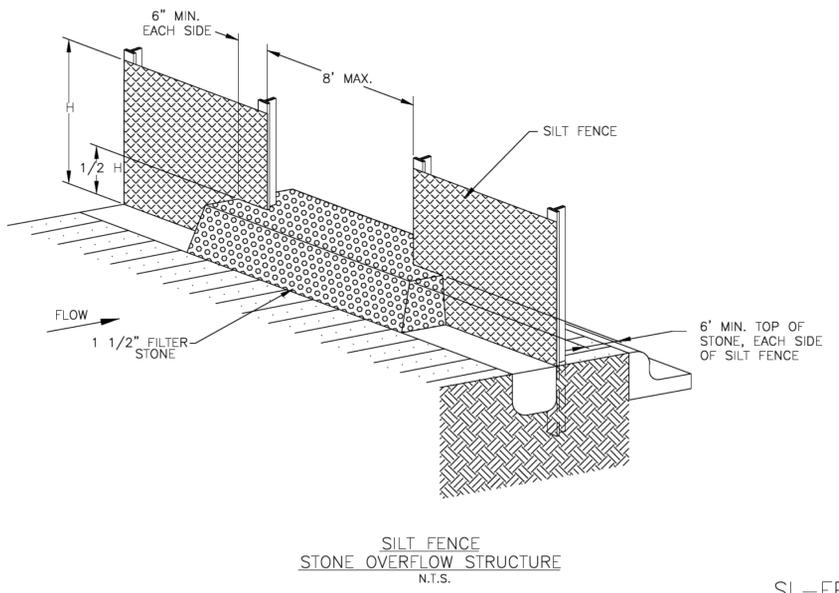

SL-ER-05


No.	DATE	REVISION
SEAL:		
DESIGN ENGINEER: _____ DATE: _____		
 CITY OF SUGAR LAND, TEXAS ENGINEERING DEPARTMENT		
CONSTRUCTION PLANS FOR:		
EROSION CONTROL DETAILS I		
JOB No.:	DATE:	SL-34
DESIGNED BY:	DRAWN BY:	
CHECKED BY:	CHECKED BY:	
SCALE:	SCALE:	
SHEET		OF

REVISION DATE: OCTOBER 2021

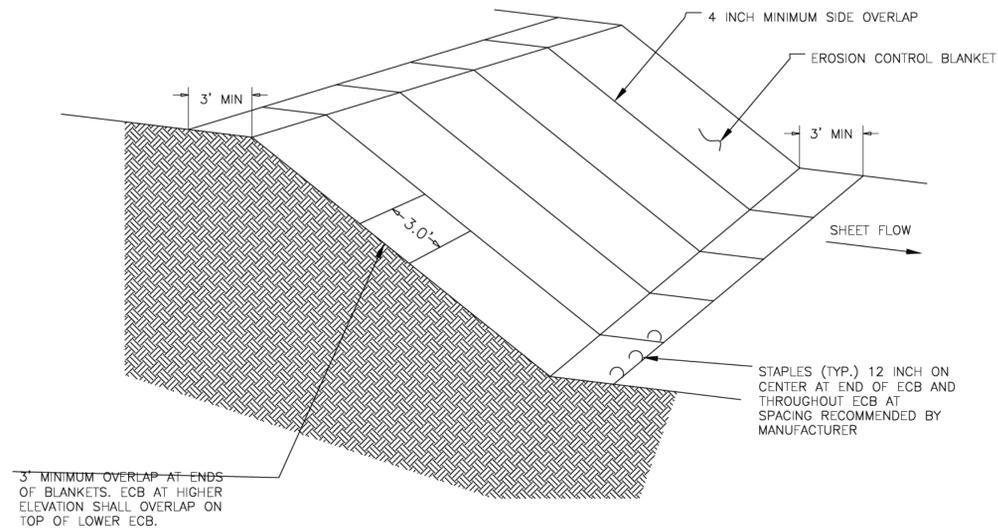


EROSION CONTROL BLANKETS  
N.T.S.

SL-ER-06

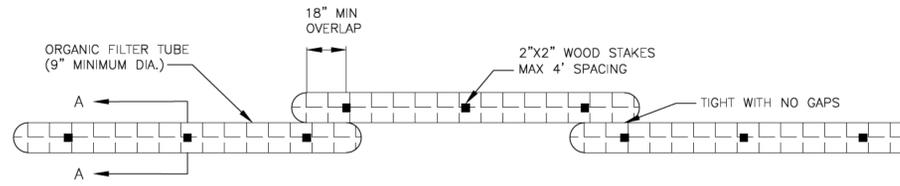

ORGANIC FILTER TUBE PERIMETER CONTROL PLAN VIEW  
N.T.S.

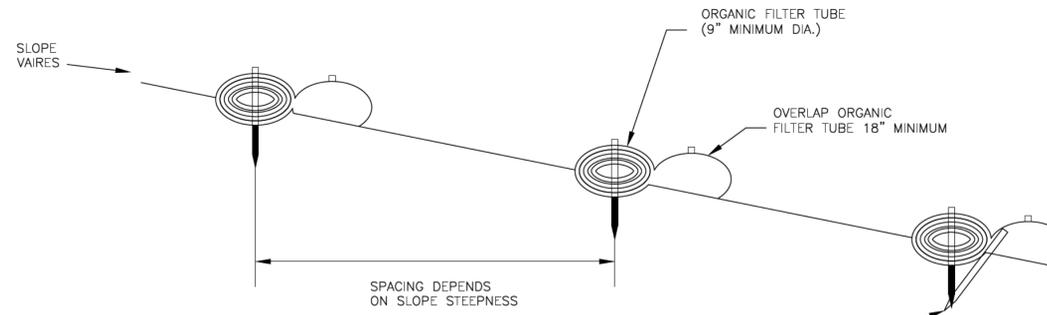


ORGANIC FILTER TUBE PERIMETER CONTROL PROFILE  
N.T.S.


FOR SLOPES OF 2:1 OR STEEPER, A SECOND STAKE AGAINST THE DOWNSLOPE FACE OF THE TUBE MAY BE NEEDED DEPENDING ON SOIL TYPE

ORGANIC FILTER TUBES NOTES

1. TYPE OF NETTING, FILTER MATERIAL, DIAMETER OF TUBE, AND SPACING OF TUBES SHALL BE SPECIFIED BY THE DESIGNER BASED ON THE FOLLOWING SITE PARAMETERS:
  - SIZE OF CONTRIBUTING DRAINAGE AREA
  - STEEPNESS OF SLOPE
  - GROUND CONDITIONS (SOIL OR PAVEMENT)
2. DESIGNER SHALL SHOW ON THE DRAWINGS THE LOCATIONS WHERE TUBE ARE TO BE TURNED UPSLOPE. UPSLOPE LENGTHS SHALL BE MINIMUM OF 10 FEET.

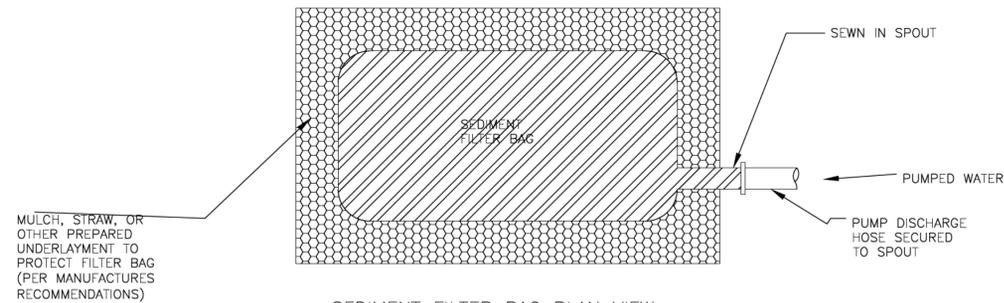

SEDIMENT FILTER BAG PLAN VIEW  
N.T.S.

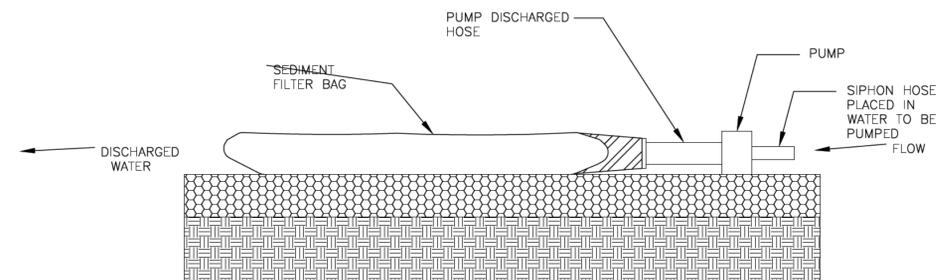


SEDIMENT FILTER BAG PROFILE  
N.T.S.


NOTE: A FILTRATION BAG IS NOT REQUIRED IF THE DRAINAGE SYSTEM CAN BE ADEQUATELY PROTECTED

DEWATERING CONTROLS  
N.T.S.

SL-ER-07

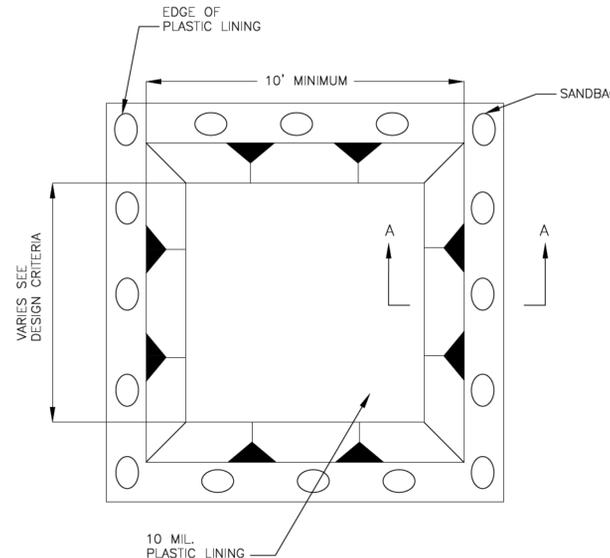

CONCRETE WASHOUT PLAN VIEW  
N.T.S.

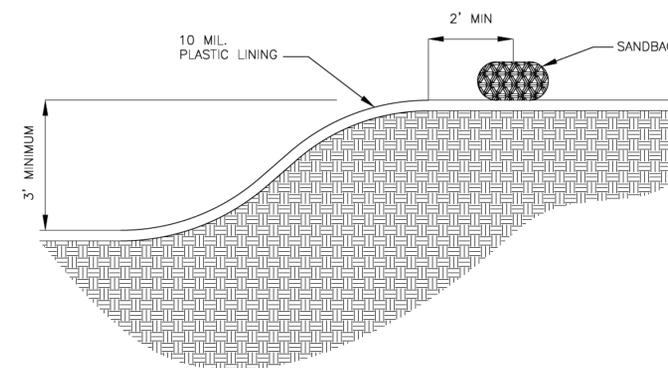

CONCRETE WASHOUT SECTION A-A  
N.T.S.

CONCRETE WASHOUT NOTES

1. SANDBAGS MAYBE REPLACED BY A SOIL BERM TO ANCHOR THE PLASTIC BAG

CONCRETE WASHOUT AREA  
N.T.S.

SL-ER-08

FILTER TUBE  
N.T.S.

No.	DATE	REVISION

SEAL: \_\_\_\_\_  
DESIGN ENGINEER: \_\_\_\_\_ DATE: \_\_\_\_\_



CITY OF SUGAR LAND, TEXAS  
ENGINEERING DEPARTMENT

CONSTRUCTION PLANS FOR:

EROSION CONTROL DETAILS II

JOB No.:  
DATE:  
DESIGNED BY:  
DRAWN BY:  
CHECKED BY:  
SCALE:

SL-35

SHEET OF